

# BECKHOFF New Automation Technology

Manual | EN

## C9900-U332-0010

Battery pack





# Table of contents

|          |   |           |
|----------|---|-----------|
| <b>1</b> | <b>Notes on the documentation</b>           | <b>5</b>  |
| <b>2</b> | <b>For your safety</b>                      | <b>6</b>  |
| 2.1      | Description of safety symbols               | 6         |
| 2.2      | Intended use                                | 6         |
| 2.3      | Fundamental safety instructions             | 7         |
| 2.4      | Operator's obligation to exercise diligence | 7         |
| 2.5      | Notes on information security               | 8         |
| <b>3</b> | <b>Product overview</b>                     | <b>9</b>  |
| 3.1      | Structure                                   | 9         |
| 3.2      | Name plate                                  | 10        |
| <b>4</b> | <b>Commissioning</b>                        | <b>11</b> |
| 4.1      | Transport and unpacking                     | 11        |
| 4.2      | Dimensions                                  | 12        |
| 4.3      | Control cabinet installation                | 13        |
| 4.4      | Connect battery pack                        | 16        |
| <b>5</b> | <b>Decommissioning</b>                      | <b>18</b> |
| <b>6</b> | <b>Maintenance</b>                          | <b>21</b> |
| <b>7</b> | <b>Technical data</b>                       | <b>22</b> |
| <b>8</b> | <b>Appendix</b>                             | <b>23</b> |
| 8.1      | Service and support                         | 23        |
| 8.2      | Approvals                                   | 24        |



# 1 Notes on the documentation

This description is intended exclusively for trained specialists in control and automation technology who are familiar with the applicable national standards.

For installation and commissioning of the components, it is absolutely necessary to observe the documentation and the following notes and explanations.

The qualified personnel is obliged to always use the currently valid documentation.

The responsible staff must ensure that the application or use of the products described satisfies all requirements for safety, including all the relevant laws, regulations, guidelines, and standards.

## Disclaimer

The documentation has been prepared with care. The products described are, however, constantly under development.

We reserve the right to revise and change the documentation at any time and without notice.

No claims to modify products that have already been supplied may be made on the basis of the data, diagrams, and descriptions in this documentation.

## Trademarks

Beckhoff®, TwinCAT®, TwinCAT/BSD®, TC/BSD®, EtherCAT®, EtherCAT G®, EtherCAT G10®, EtherCAT P®, Safety over EtherCAT®, TwinSAFE®, XFC®, XTS® and XPlanar® are registered and licensed trademarks of Beckhoff Automation GmbH.

If third parties make use of designations or trademarks used in this publication for their own purposes, this could infringe upon the rights of the owners of the said designations.

## Patents

The EtherCAT Technology is covered, including but not limited to the following patent applications and patents:

EP1590927, EP1789857, EP1456722, EP2137893, DE102015105702

and similar applications and registrations in several other countries.

## EtherCAT®

EtherCAT® is registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany

## Copyright

© Beckhoff Automation GmbH & Co. KG, Germany.

The distribution and reproduction of this document as well as the use and communication of its contents without express authorization are prohibited.

Offenders will be held liable for the payment of damages. All rights reserved in the event that a patent, utility model, or design are registered.

## 2 For your safety

The Safety chapter first explains the safety symbols used in the documentation and their meanings. They contain fundamental safety instructions that are essential for the avoidance of personal injuries and damage to property.

### Exclusion of liability

Beckhoff shall not be liable in the event of non-compliance with this documentation and thus the use of the battery packs outside the documented operating conditions.

## 2.1 Description of safety symbols

The following safety symbols are used in these operating instructions. In order to avoid personal injuries and damage to property, read and follow the safety and warning notices.

### Warning of personal injuries:

#### **DANGER**

Disregarding the safety notice will lead to death or serious injuries.

#### **WARNING**

Disregarding the safety notice may lead to death or serious injuries.

#### **CAUTION**

Disregarding the safety notice may lead to minor injuries.

### Warning of damage to property:

#### **NOTICE**

Disregarding the notice may lead to damage to property.

## 2.2 Intended use

The battery pack is designed for DIN rail mounting in control cabinets of machine and system engineering. It serves PCs with 24 V power supply unit and integrated C9900-U209 UPS as external energy storage. The battery pack is designed for PCs with Intel Atom® or Celeron®-ULV-827E 1.4 GHz processor.

The specified limits for technical data must be adhered to.

The battery pack can be used within the documented operating conditions.

### Improper use

Do not use the battery pack outside the documented operating conditions.

## 2.3 Fundamental safety instructions

The following safety instructions must be observed when handling the battery pack.

### Application conditions

- Do not use the battery pack under extreme environmental conditions.
- Never use the battery pack in potentially explosive atmospheres.
- Provide openings in the control cabinet walls for sufficient ventilation of the control cabinet in accordance with DIN EN IEC 62485-2. This avoids the risk of explosion due to gas escaping from the battery packs.
- Never plug or unplug connectors during thunderstorms. There is a risk of electric shock.
- Ensure protective earthing of the battery pack.

### Damage to property and impairment of functions

- Ensure that only trained specialists with a control and automation engineering background, operate the PC to which the battery pack is connected. Use by unauthorized persons can lead to damage to property.
- Extinguish the battery pack with foam halogens in case of fire or with a large amount of spray water in case of large fires.

## 2.4 Operator's obligation to exercise diligence

The operator must ensure that

- the products are only used as intended (see chapter 2.2 [Intended use](#) [▶ 6]).
- the products are only operated in sound condition and in working order.
- only sufficiently qualified and authorized personnel operate the PC to which the battery pack is connected.
- the personnel is instructed regularly about relevant occupational safety and environmental protection aspects, and is familiar with the operating instructions and in particular the safety instructions contained herein.
- the operating instructions are in good condition and complete, and always available for reference at the location where the products are used.

## 2.5 Notes on information security

The products of Beckhoff Automation GmbH & Co. KG (Beckhoff), insofar as they can be accessed online, are equipped with security functions that support the secure operation of plants, systems, machines and networks. Despite the security functions, the creation, implementation and constant updating of a holistic security concept for the operation are necessary to protect the respective plant, system, machine and networks against cyber threats. The products sold by Beckhoff are only part of the overall security concept. The customer is responsible for preventing unauthorized access by third parties to its equipment, systems, machines and networks. The latter should be connected to the corporate network or the Internet only if appropriate protective measures have been set up.

In addition, the recommendations from Beckhoff regarding appropriate protective measures should be observed. Further information regarding information security and industrial security can be found in our <https://www.beckhoff.com/secguide>.

Beckhoff products and solutions undergo continuous further development. This also applies to security functions. In light of this continuous further development, Beckhoff expressly recommends that the products are kept up to date at all times and that updates are installed for the products once they have been made available. Using outdated or unsupported product versions can increase the risk of cyber threats.

To stay informed about information security for Beckhoff products, subscribe to the RSS feed at <https://www.beckhoff.com/secinfo>.



### 3 Product overview

The battery pack C9900-U332 serves as energy storage for PCs with 24 V power supply unit and integrated UPS and continues to supply the PC with energy in the event of a power failure. It allows backing up the data to a hard disk or flash media (e.g. SSD or CFast) and shutting down the PC properly. The battery pack is intended for external mounting in control cabinets of machine and system engineering.

The compact battery pack for PCs with Intel Atom® or Intel® Celeron® ULV 827E currently has a nominal capacity of 1.3 Ah. In 2022, a change to 1.2 Ah will take place.

The internal structure of the battery pack consists of two 12 V batteries in series connection. The VRLA-AGM technology (valve regulated lead acid absorbed glass mat technology) is applied. These are valve regulated lead-acid batteries with fiberglass mats in the separator.

#### 3.1 Structure



Fig. 1: C9900-U332\_Structure

Table 1: Key for C9900-U332 structure

| No. | Component            | Description  |
|-----|----------------------|--|
| 1   | Name plate           | Information on battery pack equipment                                      |
| 2   | 8-pin terminal strip | Connecting the battery pack to the power supply unit of the PC             |
| 3   | Mounting device      | Mounting plate with mounting notches for vertical mounting on the DIN rail |

### 3.2 Name plate

The name plate provides information about the battery pack equipment.

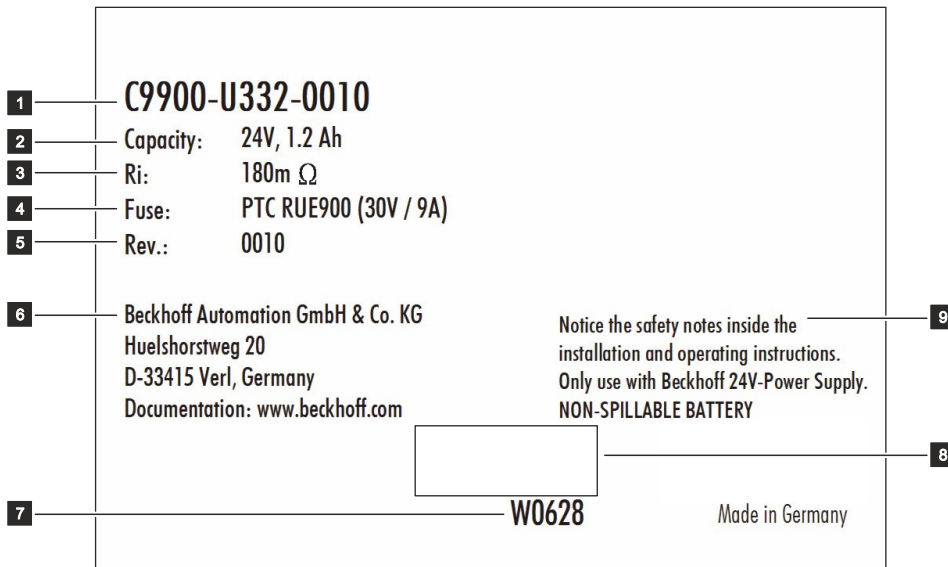



Fig. 2: C9900-U332\_name plate

Table 2: Key for C9900-U332 name plate

| No. | Description  |
|-----|--|
| 1   | Model  |
| 2   | Nominal capacity   |
| 3   | Internal resistance  |
| 4   | Fuse   |
| 5   | Revision   |
| 6   | Address of the vendor  |
| 7   | Coded production date  |
| 8   | Symbols<br><br>Note: here are the symbols applicable to the battery pack such as CE, EAC, UKCA,  . The approvals of your battery pack can be found on the name plate and in chapter 9.2 Approvals [▶ 24]. |
| 9   | Reference to safety and warning instructions, power supply and battery leakage protection  |

## 4 Commissioning

In order to use the battery pack, you must first transport and unpack it. You can then install the battery pack in the control cabinet and connect it to the PC.

### 4.1 Transport and unpacking

Note the specified transport and storage conditions (see Chapter 7 [Technical data](#) [► 22]).

The battery pack contains two leak-proof VRLA batteries. The batteries are permanently installed in a corrosion-resistant stainless steel housing and short-circuit proof with electrical fuse protection.

Despite the robust design of the unit, the components are sensitive to strong vibrations and impacts. Transporting a control cabinet with a built-in battery pack can result in excessive impact on the DIN rail and the battery pack. Therefore, the transport of the battery pack in the control cabinet is not possible. During transport the battery pack must therefore be protected from excessive mechanical stress. Appropriate packaging of the battery pack, in particular the original packaging, can improve the vibration resistance during transport.

On our original packaging you will find the following sticker:

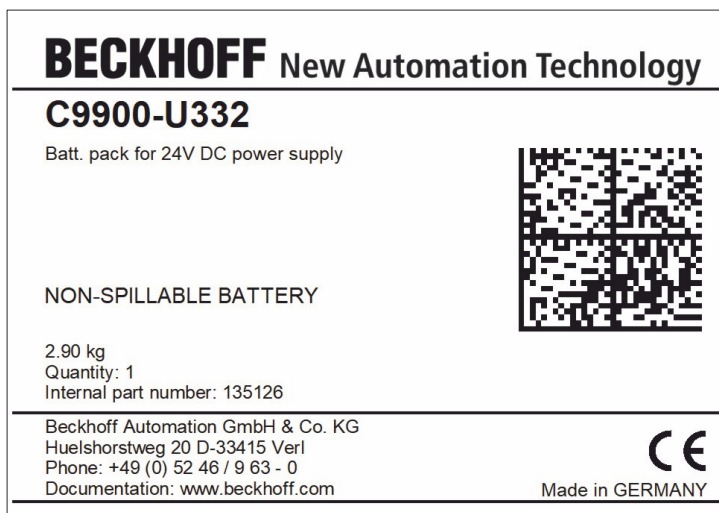


Fig. 3: C9900-U332\_shipping label

Use the original packaging for re-transportation to ensure the required labeling of the battery packs by the sticker.

The battery pack is not regulated for air transport as it meets the requirements of Special Provision - "A67" according to the International Air Transportation Association (IATA) and the International Civil Aviation Organization (ICAO).

In addition, the battery pack meets vibration and differential pressure tests in accordance with International Maritime Dangerous Goods (IMDG) regulations.

#### Unpacking

Proceed as follows to unpack the battery pack:

1. Check the packaging for transport damage.
2. Remove packaging.
3. Keep the packaging for possible future transport.
4. Check your delivery for completeness by comparing it with your order.
5. Check the contents for visible shipping damage.
6. In case of discrepancies between the package contents and the order, or in case of transport damage, please inform Beckhoff Service (see Chapter 8.1 [Service and support](#) [► 23]).

## 4.2 Dimensions

All dimensions are in mm.

Figure 4 shows the dimensions of the battery pack for vertical mounting on the DIN rail.

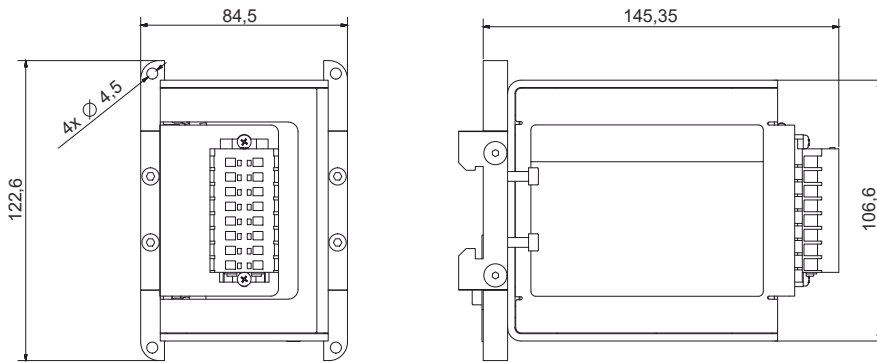


Fig. 4: C9900-U332\_dimensions vertical mounting

Figure 5 shows the dimensions of the battery pack for horizontal mounting on the DIN rail.

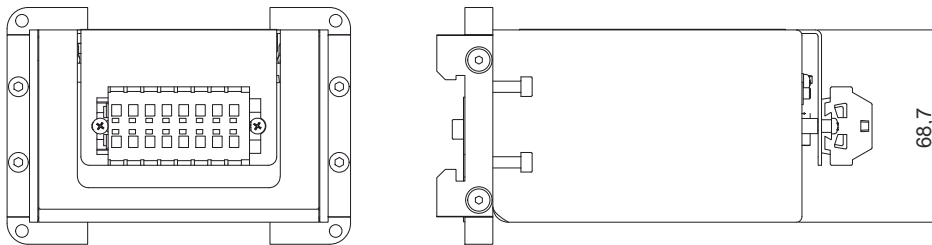


Fig. 5: C9900-U332\_dimensions horizontal mounting

Figure 6 shows the mounting template for mounting without DIN rail.

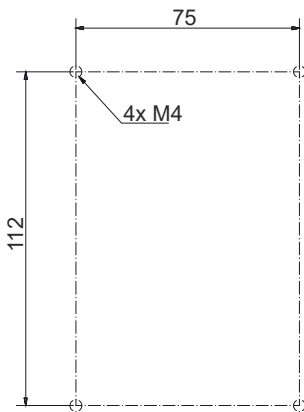


Fig. 6: C9900\_U332\_mounting without DIN rail

## 4.3 Control cabinet installation

### ⚠ WARNING

#### Risk of deflagration

A missing or insufficient ventilation of the control cabinet in which the battery pack is mounted can lead to deflagration in the control cabinet.

- Ensure sufficient ventilation of the control cabinet according to EN 50272-2 (see below).

### NOTICE

#### Extreme environmental conditions

Extreme environmental conditions can cause damage to the battery pack.

- Avoid extreme environmental conditions.
- Protect the battery pack from moisture and heat.

#### Ventilation control cabinet

In the event of a fault or heavy load, hydrogen may leak from the batteries inside the battery pack. Oxygen is present in the control cabinet. If the hydrogen cannot escape from the control cabinet and the hydrogen concentration in the control cabinet exceeds a value of 4 %<sub>vol</sub>, an explosive mixture is formed and deflagration may occur in the control cabinet. To keep the hydrogen concentration in the air low and thus reduce the risk of deflagration, you must ensure appropriate ventilation of the control cabinet in accordance with EN 50272-2. You can achieve this through natural ventilation. Equip the control cabinet with openings for air circulation. Position the openings either on opposite walls or in the same wall at least 2 m apart.

#### Control cabinet installation

The battery pack C9900-U332 is designed for installation in control cabinets of machine and plant technology. The environmental conditions specified for operation must be observed (see chapter 7 [Technical data](#) [[▶ 22](#)]).

If you need the dimensions of the battery pack for mounting, you can get them in chapter 4.2 [Dimensions](#) [[▶ 12](#)].

Three different mounting options are available for the C9900-U332 battery pack:

- Vertical via the rear on the DIN rail
- Horizontally via the rear on the DIN rail
- Via the mounting plate on the rear side without DIN rail

As delivered, the battery pack is designed for vertical mounting on the DIN rail. To mount the battery pack horizontally, you must first convert the mounting latches on the back of the battery pack.

Follow the steps below to convert the mounting notches, as shown in figures 7 and 8:

1. Loosen the screw of the ground connection plate with a 3.0 mm Allen key (section A).
2. Remove the ground connection plate (section B).
3. Remove the screws of the two mounting notches using a 2.5 mm Allen key (section C).
4. Remove the two mounting notches (section D).

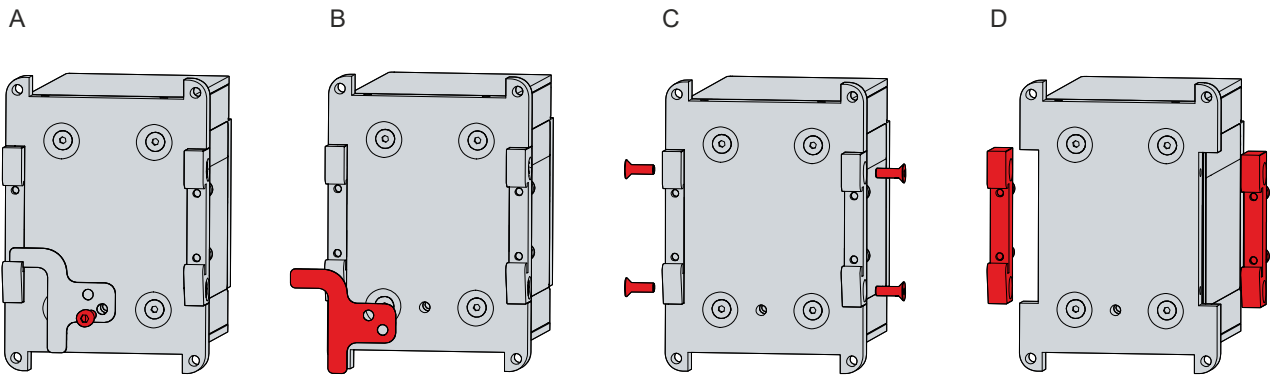


Fig. 7: C9900-U332\_conversion mounting plate

5. Rotate the battery pack by 90 °.
6. Mount the two mounting notches (section E).
7. Mount the ground connection plate (section F).

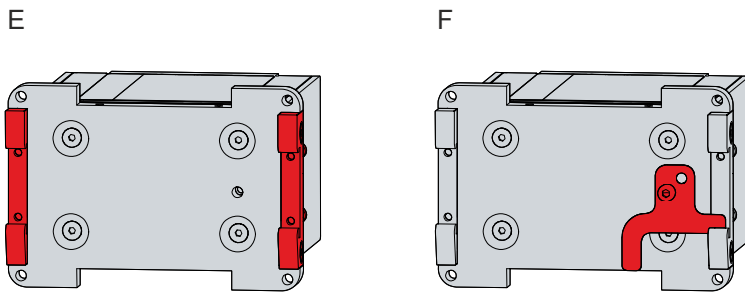


Fig. 8: C9900-U332\_conversion mounting plate

⇒ You have converted the mounting notches for horizontal mounting.

Regardless of whether you want to mount the battery pack vertically or horizontally on the DIN rail, you must proceed in the same way. Two types of DIN rail are commonly used in system engineering:

- TS 35 x 7.5
- TS 35 x 15

A flat DIN rail of type TS 35 x 7.5 is too weak for the battery pack. Accordingly, you may only mount the battery pack on a DIN rail of type TS 35 x 15.

### Mounting on the DIN rail

To mount the battery pack on the DIN rail, follow the steps below shown in Figure 9:

1. Place the battery pack on the DIN rail via the rear side (section A).
2. Tighten the four hexagon socket screws of the mounting notches (section B).

⇒ You have installed the battery pack on the DIN rail.

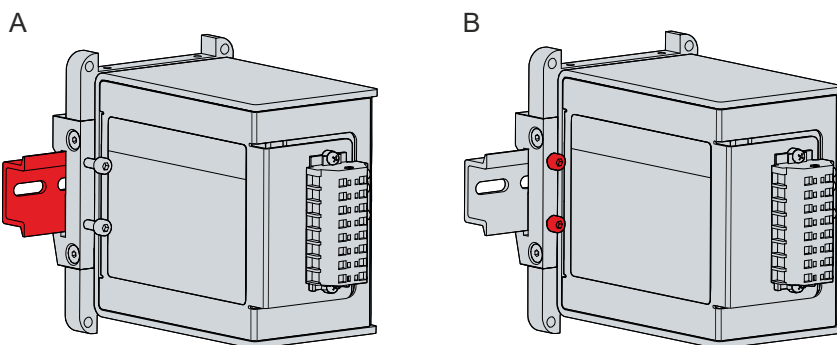


Fig. 9: C9900\_U332\_mounting on DIN rail

### Mounting via mounting plate

In addition to mounting on the DIN rail, you have the option of mounting the battery pack without a DIN rail using the mounting plate on the rear. You can align the battery pack as you wish.

Two requirements must be met for mounting the battery pack via the mounting plate:

- You must remove the mounting notches from the mounting plate (see earlier in the chapter).
- You must provide the wall on which the battery pack is to be mounted with appropriate drill holes.

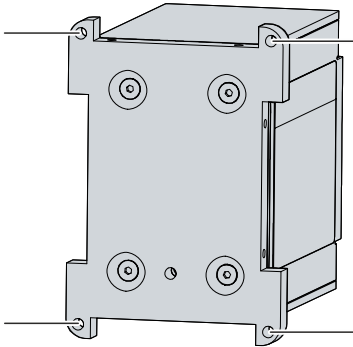


Fig. 10: C9900-U332\_mounting plate

To mount the battery pack via the mounting plate, follow the steps below:

1. Place the battery pack with the marked locations of the mounting plate (see Fig. 10) in front of the prepared drill holes.
2. Insert the M4 fastening screws into the drill holes.
3. Tighten the fastening screws.

## 4.4 Connect battery pack

### ⚠ CAUTION

#### Risk of electric shock

Dangerous touch voltages can lead to electric shock. To avoid electric shock, observe the following:

- Never plug or unplug the battery pack cable during a thunderstorm.
- Provide protective earthing for handling the battery pack.

### NOTICE

#### Incorrect connection procedure

Incorrect procedure when connecting the cable can cause hardware damage.

- Follow the documented procedure for connecting the cable.
- Always connect the cable first and only then switch on the power supply of the connected PC.

After you have mounted the battery pack in the control cabinet, you can connect it to the PC.

#### Grounding

Potential differences are minimized and electrical currents are diverted to the ground through protective earthing or potential equalization of electronic devices. This is to prevent dangerous touch voltages and electromagnetic interference.

#### Connecting the battery pack

You must connect the battery pack to the PC. For this purpose, there is an 8-pin terminal strip (X101) on the battery pack housing (see Fig. 11).

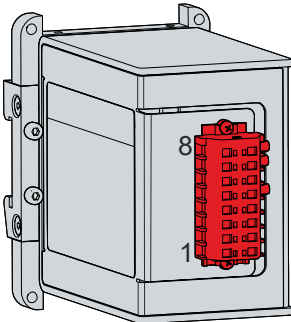


Fig. 11: C9900-U332\_position terminal strip

Table 3: Pin assignment terminal strip

| Pin | Function  |
|-----|---|
| 1   | -   |
| 2   | +   |
| 3   | Terminal for looping through wires of the supply line to the PC |
| 4   | ⊕   |
| 5   | Terminal for looping through wires of the supply line to the PC |
| 6   | Terminal for looping through wires of the supply line to the PC |
| 7   | Terminal for looping through wires of the supply line to the PC |
| 8   | Terminal for looping through wires of the supply line to the PC |

You can connect two wires on each side of a terminal of the terminal strip. For this purpose, you must use double wire end sleeves (see Fig. 12).






Fig. 12: C9900-U332\_double wire end sleeve

PIN 5 and 6 of the battery pack are available for looping through a 24 V power supply to the PC. Accordingly, you can connect a three-core sheathed cable with plus and minus of the supply voltage as well as protective earth to the battery pack and then connect the battery pack to the PC with an eight-core sheathed cable.

If the supply voltage fails, the PC draws the voltage from the charged battery pack, which saves the data and allows the PC to shut down properly.

The intended wiring of the battery pack can be found in the wiring diagram in Figure 13.

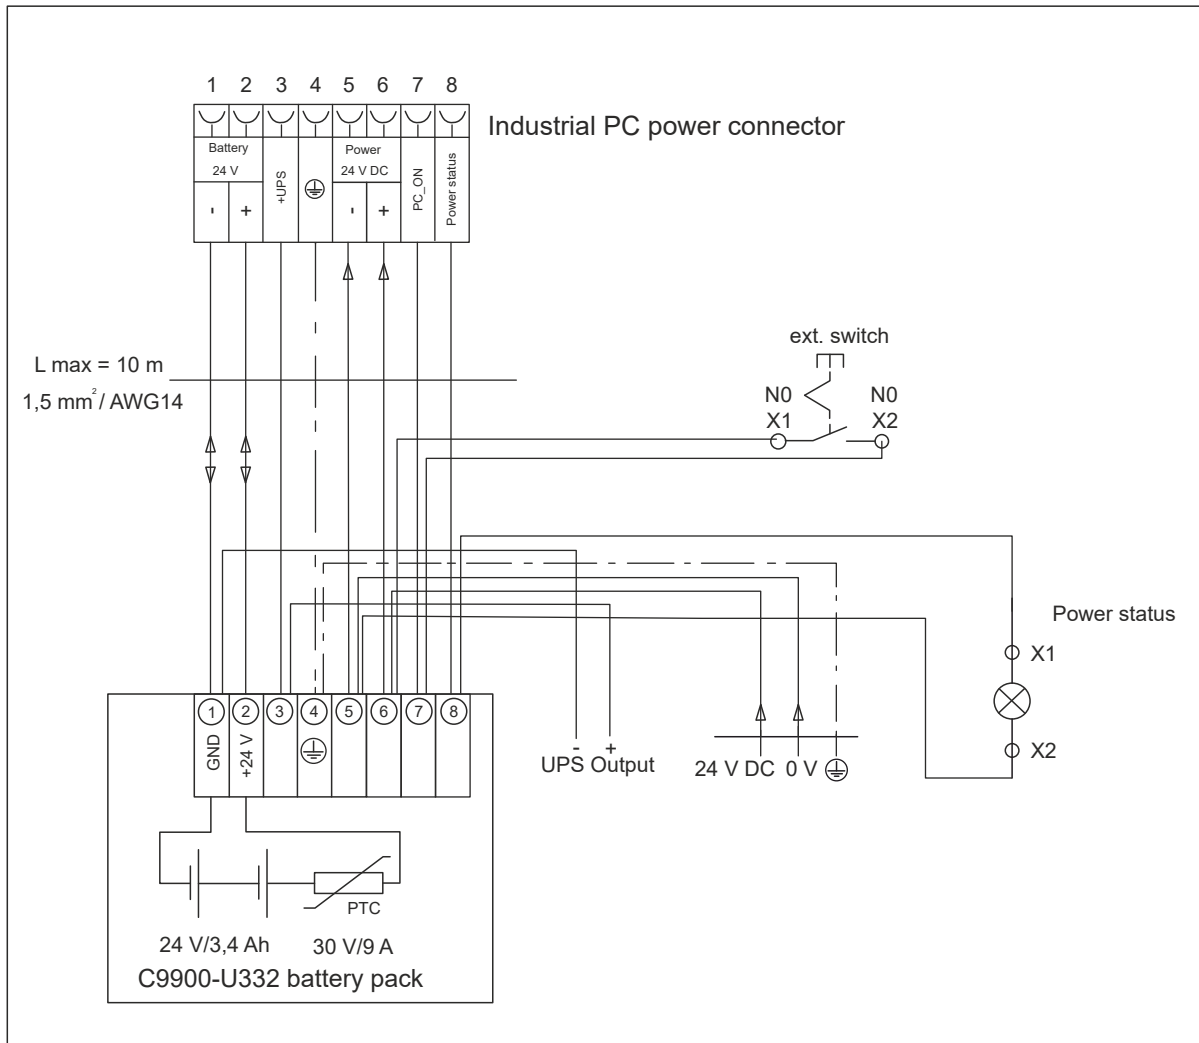


Fig. 13: C9900-U332\_wiring diagram

## 5 Decommissioning

### ⚠ WARNING

#### Risk of injury and hardware damage in the event of a short circuit

The batteries can be charged with large amounts of energy. In the event of a short circuit, these can lead to very high currents, which can damage tools and injure users.

- Avoid injuries due to flying sparks and fires as well as damage to the tool by handling the battery pack safely.

### NOTICE

#### Hardware damage due to power supply

A connected power supply can cause damage to the battery pack during disassembly.

- Disconnect the cable to the PC and thus the power supply before starting disassembly.

When decommissioning the battery pack, you must first remove all cables connected to the battery pack. You can then remove the battery pack from the control cabinet.

If you do not want to continue using the battery pack, you will receive information on the correct disposal of the battery pack in the further course of the chapter.

#### Disassembly from the DIN rail

To remove the battery pack from the DIN rail, follow the steps below, shown in Figure 14:

1. Loosen the four hexagon socket screws on the mounting notches (section A).
  2. Remove the battery pack from the DIN rail (section B).
- ⇒ You have removed the battery pack from the DIN rail.

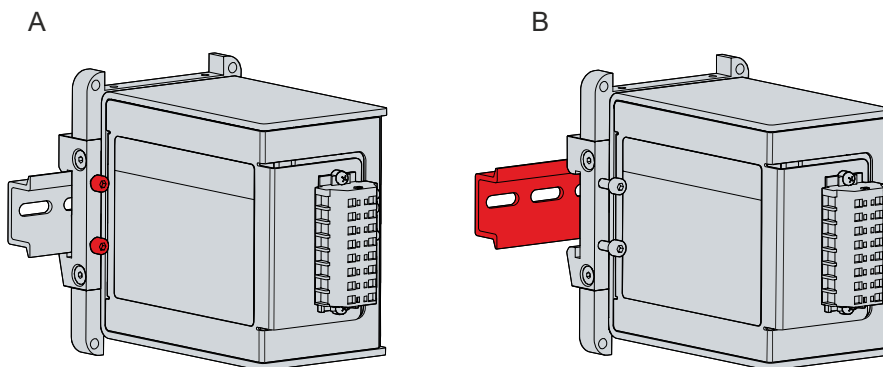


Fig. 14: C9900-U332\_disassembly from the DIN rail

#### Disassembly mounting plate

To remove the battery pack from the control cabinet via the mounting plate, proceed as follows:

1. Hold the battery pack tightly so that it cannot fall down when the fastening screws are loosened.
2. Remove the fastening screws at the marked points (see Fig. 15).
3. Remove the battery pack from the control cabinet.

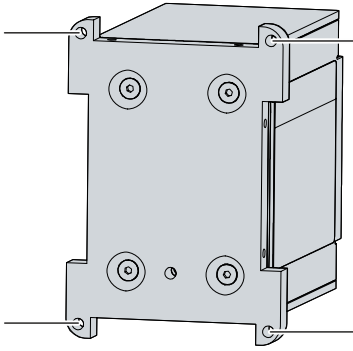


Fig. 15: C9900-U332\_mounting plate

**Disposal of the battery pack**

When disposing of the battery pack, be sure to observe the national electronic waste regulations.

For disposal, you must remove and dismantle the battery pack.

To dismantle the battery pack, follow the steps shown in the figures below:

1. Loosen the screw of the ground connection plate with a 3.0 mm Allen key to remove the ground connection plate (section A).
2. Loosen the four M4 x 12 screws (section B).
3. Remove the mounting plate (section C).

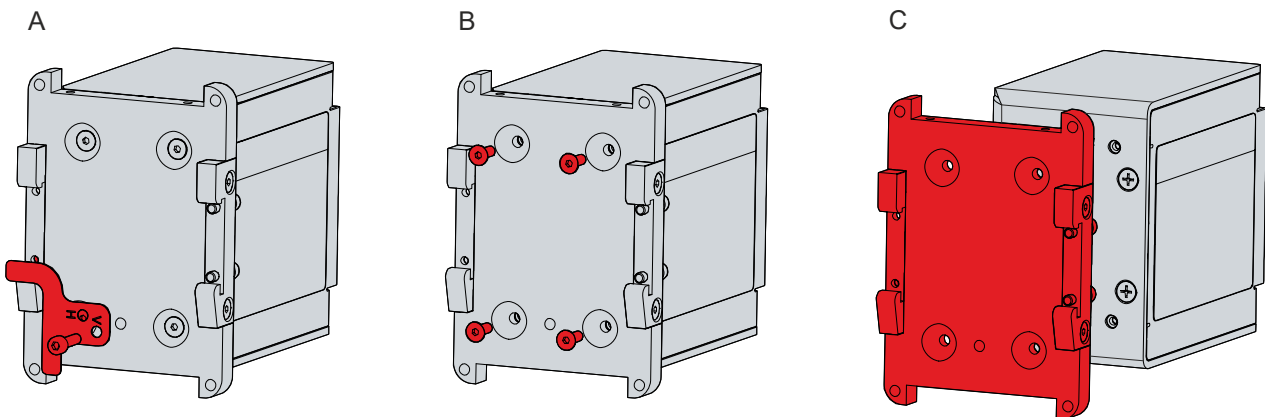


Fig. 16: C9900-U332\_removal mounting plate

4. Remove the two M4 x 6 screws on the back of the battery pack (section D).
5. Remove the two M3 x 10 screws and the clamp on the front of the battery pack (section E).
6. Pull the angle plate over the front from the housing (section F).

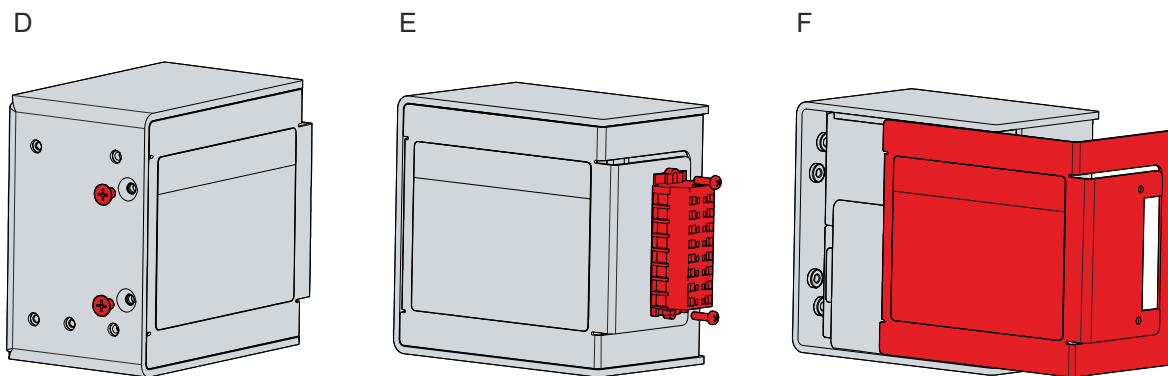


Fig. 17: C9900-U332\_removal angle plate

7. Pull the batteries including the foam insert out of the housing (section G). Ensure safe handling of the batteries to avoid injuries due to short circuits.

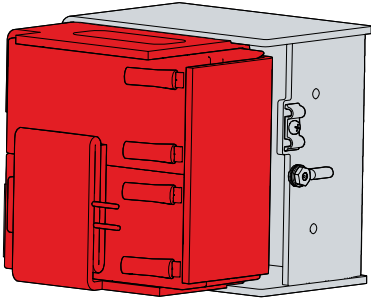


Fig. 18: C9900-U332\_remove of batteries

After you have dismantled the battery pack, you should insulate the terminals of the removed batteries. For this purpose, you can use, for example, insulating tape. You can then dispose of the components as follows:

- Dispose of batteries properly.
- Send plastic parts (polycarbonate, polyamide (PA6.6)) for plastics recycling.
- Take the angle plate to the metal recycling collection point.

## 6 Maintenance

Maintenance measures increase the efficiency of the device by ensuring long-term functionality. Cleaning the device contributes to this.

Beckhoff generally recommends replacing the battery pack 5 years after production. You can find the coded production date of your battery pack on the name plate. The coding is as follows:

- Example: V0916 = 16.09.2021
- V = the coded production year 2021
- 09 = Production month September
- 16 = Manufacturing day

The years of manufacture are coded in letters as follows:

- Letters H to V = production years 2007-2021

### Cleaning

#### NOTICE

##### Unsuitable cleaning agents

The use of unsuitable cleaning agents can damage the device.

- Clean the battery pack only as specified.

It is essential to observe the following points when cleaning the battery pack:

- Make sure that no dust gets into the battery pack.
- Only use a vacuum cleaner to clean the battery pack. The device does not have to be switched off for this.
- Never use compressed air to clean the battery pack.

Avoid the following cleaning agents:

- Detergents with scouring or abrasive components
- Metal cleaning objects such as razor blades or steel spatulas

### Repair

Only the manufacturer may repair the device. If a repair should be necessary, contact Beckhoff Service (see Chapter 9.1 [Service and support](#) [▶ 23]).

## 7 Technical data

| Product designation                         | C9900-U332  |
|---|---|
| Dimensions (W x H x D)                      | 68.7 x 106.6 x 143.8 mm   |
| Weight                                      | 2.4 kg  |
| Electrical data                             | <p>Nominal voltage: 24 V</p> <p>Capacity: 1.3 Ah (2022 change to 1.2 Ah) (discharge over 20 hours)</p> <p>Internal resistance: 180 mOhm</p> <p>Fuse protection: 9 A/30 V via PTC element</p> <p>Final charge voltage: between 27.2 V and 27.4 V</p> |
| Vibration resistance (sinusoidal vibration) | <p>EN 60068-2-6: 10 to 58 Hz: 0.035 mm</p> <p>58 to 500 Hz: 0.5 G (~ 5 m/s<sup>2</sup>)</p>   |
| Shock resistance (shock)                    | EN 60068-2-27: 5 G (~ 50 m/s <sup>2</sup> ), duration: 30 ms  |
| EMC interference immunity                   | conforms to EN 61000-6-2  |
| Permitted ambient temperature               | <p>0 °C to +50 °C (transport / storage)</p> <p>-20 °C to +50 °C (transport)</p>   |
| Permissible relative air humidity           | Maximum 95 %, no condensation   |
| Transport and storage                       | The same values for air humidity and shock resistance are to be observed during transport and storage as in operation. The shock resistance during transport can be improved by appropriate packaging of the battery pack.                          |

## 8 Appendix

### 8.1 Service and support

Beckhoff and its worldwide subsidiaries offer comprehensive service and support, providing fast and competent assistance with all issues relating to Beckhoff products and system solutions.

#### Beckhoff Service

The Beckhoff Service Center supports you in all matters of after-sales service:

- on-site service
- repair service
- spare parts service
- hotline service

Hotline: + 49 (0) 5246/963-460

Fax: + 49 (0) 5246/963-479

email: [service@beckhoff.com](mailto:service@beckhoff.com)

In case of service, please state the coded production date of your battery pack, which you can find on the name plate.

#### Beckhoff Support

Support offers you comprehensive technical assistance, helping you not only with the application of individual Beckhoff products, but also with other, wide-ranging services:

- World-wide support
- design, programming and commissioning of complex automation systems
- extensive training program for Beckhoff system components

Hotline: + 49 (0) 5246/963-157

Fax: + 49 (0) 5246/963-9157

email: [support@beckhoff.com](mailto:support@beckhoff.com)

#### Headquarters

Beckhoff Automation GmbH & Co. KG  
Hülshorstweg 20  
33415 Verl  
Germany

Telephone: + 49 (0) 5246/963-0

Fax: + 49 (0) 5246/963-198

email: [info@beckhoff.de](mailto:info@beckhoff.de)

The addresses of the worldwide Beckhoff subsidiaries and agencies can be found on our website at <http://www.beckhoff.com/>.

You will also find further documentation for Beckhoff components there.

## 8.2 Approvals

The device has the following approvals:

- CE
- EAC
- UKCA

You will find all other applicable approvals on the name plate of your device.



## List of figures

|         |   |    |
|---------|---|----|
| Fig. 1  | C9900-U332_Structure .....                      | 9  |
| Fig. 2  | C9900-U332_name plate .....                     | 10 |
| Fig. 3  | C9900-U332_shipping label.....                  | 11 |
| Fig. 4  | C9900-U332_dimensions vertical mounting .....   | 12 |
| Fig. 5  | C9900-U332_dimensions horizontal mounting ..... | 12 |
| Fig. 6  | C9900_U332_mounting without DIN rail.....       | 12 |
| Fig. 7  | C9900-U332_conversion mounting plate .....      | 14 |
| Fig. 8  | C9900-U332_conversion mounting plate .....      | 14 |
| Fig. 9  | C9900_U332_mounting on DIN rail .....           | 14 |
| Fig. 10 | C9900-U332_mounting plate .....                 | 15 |
| Fig. 11 | C9900-U332_position terminal strip.....         | 16 |
| Fig. 12 | C9900-U332_double wire end sleeve .....         | 17 |
| Fig. 13 | C9900-U332_wiring diagram .....                 | 17 |
| Fig. 14 | C9900-U332_disassembly from the DIN rail.....   | 18 |
| Fig. 15 | C9900-U332_mounting plate .....                 | 19 |
| Fig. 16 | C9900-U332_removal mounting plate .....         | 19 |
| Fig. 17 | C9900-U332_removal angle plate .....            | 19 |
| Fig. 18 | C9900-U332_removal of batteries .....           | 20 |

## List of tables

|         |                                     |    |
|---------|-------------------------------------|----|
| Table 1 | Key for C9900-U332 structure .....  | 9  |
| Table 2 | Key for C9900-U332 name plate.....  | 10 |
| Table 3 | Pin assignment terminal strip ..... | 16 |



More Information:  
[www.beckhoff.com/c9900-u332](http://www.beckhoff.com/c9900-u332)

Beckhoff Automation GmbH & Co. KG  
Hülshorstweg 20  
33415 Verl  
Germany  
Phone: +49 5246 9630  
[info@beckhoff.com](mailto:info@beckhoff.com)  
[www.beckhoff.com](http://www.beckhoff.com)

