

Documentation | EN

KL2751/KS2751, KL2761/KS2761

Single channel universal dimmer terminals

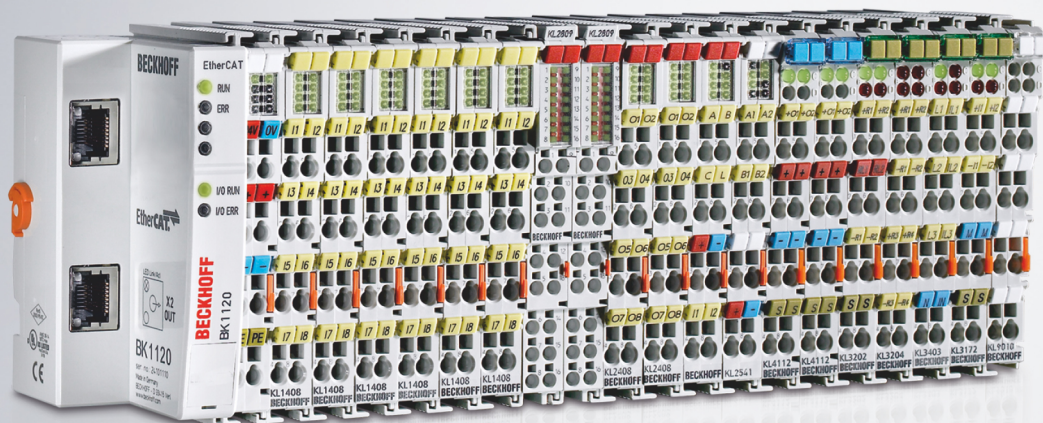


Table of contents

1 Foreword	5
1.1 Notes on the documentation	5
1.2 Safety instructions	6
1.3 Documentation issue status	7
1.4 Suggestions or proposals for documentation	8
2 Product overview	9
2.1 KL2751 - Introduction	9
2.2 KL2761 - Introduction	10
2.3 Basic function principles	11
2.4 Technical data	12
2.5 LED displays	13
3 Mounting and wiring	14
3.1 Instructions for ESD protection	14
3.2 Installation on mounting rails	15
3.3 Disposal	17
3.4 Installation positions	18
3.5 Connection	20
3.5.1 Connection system	20
3.5.2 Wiring	22
3.5.3 Shielding	23
3.6 KL2751, KL2761 - Contact assignment	24
3.7 Notes on operation - intended use	26
3.7.1 Supply	26
3.7.2 Load	27
3.7.3 Automatic load detection	28
3.7.4 Gentle operation of low-voltage lamps	28
4 Application examples - overview	29
4.1 KL2751- Application example	29
4.2 KL2751-0011 - Application example	31
5 Configuration software KS2000	32
5.1 KS2000 - Introduction	32
5.2 Parameterization with KS2000	34
5.3 Register	36
5.4 Settings	37
5.5 Process data	39
6 Access from the user program	41
6.1 Process image	41
6.2 Control and status bytes with diagnosis	42
6.2.1 Process data mode	42
6.2.2 Register communication	43
6.3 Control and status bytes without diagnosis	44
6.3.1 Process data mode	44
6.3.2 Register communication	44

6.4	Register overview	45
6.5	Register description	46
6.6	Examples of Register Communication	49
6.6.1	Example 1: Reading the firmware version from register 9	49
6.6.2	Example 2: Writing to an user register	49
7	TwinCAT	53
7.1	TwinCAT libraries	55
7.2	FB_KL27x1Config function block	55
7.3	FB_Dimmer1SwitchEco function block	55
7.4	Importing a function block	57
8	Appendix	59
8.1	Support and Service	59

1 Foreword

1.1 Notes on the documentation

Intended audience

This description is only intended for the use of trained specialists in control and automation engineering who are familiar with the applicable national standards.

It is essential that the documentation and the following notes and explanations are followed when installing and commissioning these components.

The qualified personnel is obliged to always use the currently valid documentation.

The responsible staff must ensure that the application or use of the products described satisfy all the requirements for safety, including all the relevant laws, regulations, guidelines and standards.

Disclaimer

The documentation has been prepared with care. The products described are, however, constantly under development.

We reserve the right to revise and change the documentation at any time and without prior announcement.

No claims for the modification of products that have already been supplied may be made on the basis of the data, diagrams and descriptions in this documentation.

Trademarks

Beckhoff®, ATRO®, EtherCAT®, EtherCAT G®, EtherCAT G10®, EtherCAT P®, MX-System®, Safety over EtherCAT®, TC/BSD®, TwinCAT®, TwinCAT/BSD®, TwinSAFE®, XFC®, XPlanar® and XTS® are registered trademarks of and licensed by Beckhoff Automation GmbH.

Other designations used in this publication may be trademarks whose use by third parties for their own purposes could violate the rights of the owners.



EtherCAT® is registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany.

Copyright

© Beckhoff Automation GmbH & Co. KG, Germany.

The reproduction, distribution and utilization of this document as well as the communication of its contents to others without express authorization are prohibited.

Offenders will be held liable for the payment of damages. All rights reserved in the event of the grant of a patent, utility model or design.

Third-party brands

Trademarks of third parties may be used in this documentation. You can find the trademark notices here:

<https://www.beckhoff.com/trademarks>

1.2 Safety instructions

Safety regulations

Please note the following safety instructions and explanations!

Product-specific safety instructions can be found on following pages or in the areas mounting, wiring, commissioning etc.

Exclusion of liability

All the components are supplied in particular hardware and software configurations appropriate for the application. Modifications to hardware or software configurations other than those described in the documentation are not permitted, and nullify the liability of Beckhoff Automation GmbH & Co. KG.

Personnel qualification

This description is only intended for trained specialists in control, automation and drive engineering who are familiar with the applicable national standards.

Signal words

The signal words used in the documentation are classified below. In order to prevent injury and damage to persons and property, read and follow the safety and warning notices.

Personal injury warnings

DANGER

Hazard with high risk of death or serious injury.

WARNING

Hazard with medium risk of death or serious injury.

CAUTION

There is a low-risk hazard that could result in medium or minor injury.

Warning of damage to property or environment

NOTICE

The environment, equipment, or data may be damaged.

Information on handling the product



This information includes, for example:
recommendations for action, assistance or further information on the product.

1.3 Documentation issue status

Version	Comment
3.4.0	- Chapter <i>Technical data</i> updated - Dimmer Mode <i>Zero Switch</i> added - Document structure updated - Chapter <i>Installation on mounting rails</i> updated - Chapter <i>KL2751 - Application example</i> updated
3.3.0	- Chapter <i>Technical data</i> updated - Document structure updated - Chapter <i>Instructions for ESD protection</i> added - Chapter <i>Disposal</i> added - New title page
3.2.0	- Chapter <i>Fuses</i> updated - Design of the safety instructions adapted to IEC 82079-1
3.1.0	- Process data description corrected - Download link <i>FB_Dimmer1SwitchEco</i> corrected
3.0.0	- Migration - Product overview updated - Chapter <i>TwinCAT</i> including Link to <i>FB_KL27x1Config</i> added
2.6.0	- Technical data updated - Preface updated
2.5.0	- The permissible installation position and ambient temperature range in operation are load-dependent (refer to the chapter <i>Mounting of terminals with increased thermal power dissipation!</i>) - Output of diagnostic data in the status byte and terminal internal temperature in the data input word <i>DataIN</i> also for <i>KL2751</i> from firmware 3B
2.4.0	<i>KS2751</i> and <i>KS2761</i> added - Notes on operation expanded - Basic function principles updated
2.3.0	- Register description and description of the <i>KS2000</i> configuration software updated - Technical data updated - Notes on operation expanded
2.2.0	- Description of the <i>KL2751-0011</i> and <i>KL2761-0011</i> added - Product overview updated - Application example for <i>KL2751-0011</i> and <i>KL2761-0011</i> added - Notes on operation expanded
2.1.0	Notes on operation added
2.0.0	- Description of the <i>KL2761</i> added - Description of the <i>TwinCAT</i> function block <i>FB_Dimmer1SwitchEco</i> added
1.2.0	- Register description updated - Description of the <i>KS2000</i> configuration software updated - Installation instructions revised
1.1.0	- Register description updated - Description of the <i>KS2000</i> configuration software updated - Process data description updated
1.0.0	- Description of the <i>KS2000</i> configuration software expanded - Basic function principles corrected - English translation available
0.1	First preliminary version

Firmware and hardware versions

Version of the documentation	KL2751 KS2751		KL2751-0011 KS2751-0011		KL2761 KS2761		KL2761-0011 KS2761-0011	
	Firmware	Hardware	Firmware	Hardware	Firmware	Hardware	Firmware	Hardware
3.4.0	05	13	05	13	05	11	05	11
3.3.0	05	13	05	13	05	11	05	11
3.2.0	4H	10	4H	10	4H	07	4H	07
3.1.0	4H	09	4H	09	4H	06	4H	06
3.0.0	4H	09	4H	09	4H	06	4H	06
2.6.0	4H	09	4H	09	4H	06	4H	06
2.5.0	3B	05	3B	05	3B	02	3B	02
2.4.0	2F	03	2F	03	1F	02	1F	02
2.3.0	2E	01	2E	01	1E	00	1E	00
2.2.0	2B	01	2B	01	1B	00	1B	00
2.1.0	2A	01	-	-	1A	00	-	-
2.0.0	2A	01			1A	00		
1.2.0	2A	01			-	-		
1.1.0	1C	00						
1.0.0	1A	00						
0.1	1A	00						

The firmware and hardware versions (delivery state) can be taken from the serial number printed on the side of the terminal.

Syntax of the serial number

Structure of the serial number: WW YY FF HH

WW - week of production (calendar week)

YY - year of production

FF - firmware version

HH - hardware version

Example with serial number 38 06 01 00:

38 - week of production 38

06 - year of production 2006

1C - firmware version 1C

00 - hardware version 00

1.4 Suggestions or proposals for documentation

If you have any suggestions or proposals for our documentation, please send us an e-mail stating the documentation title and version number to: documentation@beckhoff.com

2 Product overview

2.1 KL2751 - Introduction

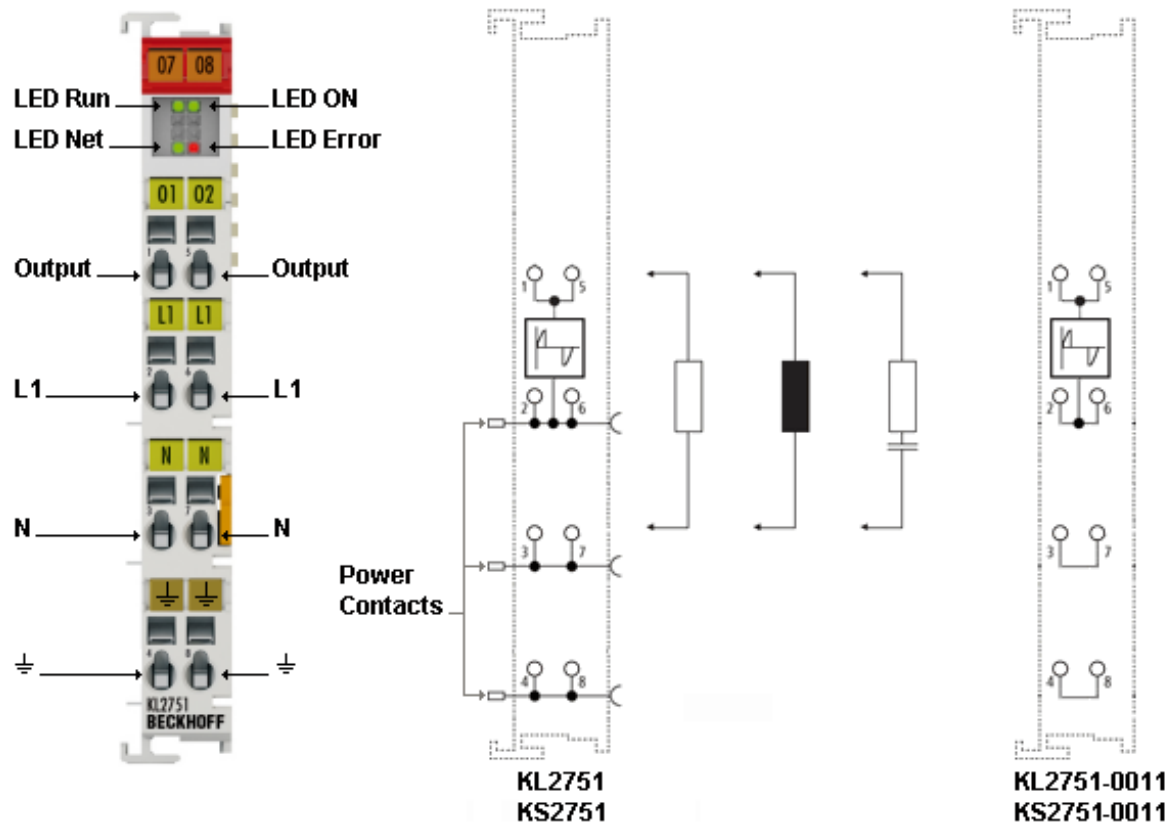


Fig. 1: KL2751 - Universal dimmer terminals, 230 V_{AC}, 300 VA

The KL2751 / KS2751 dimmer terminal is intended for the direct connection of resistive, inductive or capacitive AC lamp loads with a power rating of up to 300 VA (W). Typical lighting devices such as incandescent lamps, inductive and electronic ballasts are detected and controlled in the right operation mode. The dimmer terminal calculates the appropriate phase control angle in leading edge or trailing edge phase control from the brightness values specified via the process data. The output is short-circuit-proof and overload-proof.

The status of the load can be read in (from firmware version 3B).

A variant without power contacts (see contact Diagram, right) is also available in the KL2751-0011 / KS2751-0011. This can be used for 230 V even without a special power feed terminal.

2.2 KL2761 - Introduction

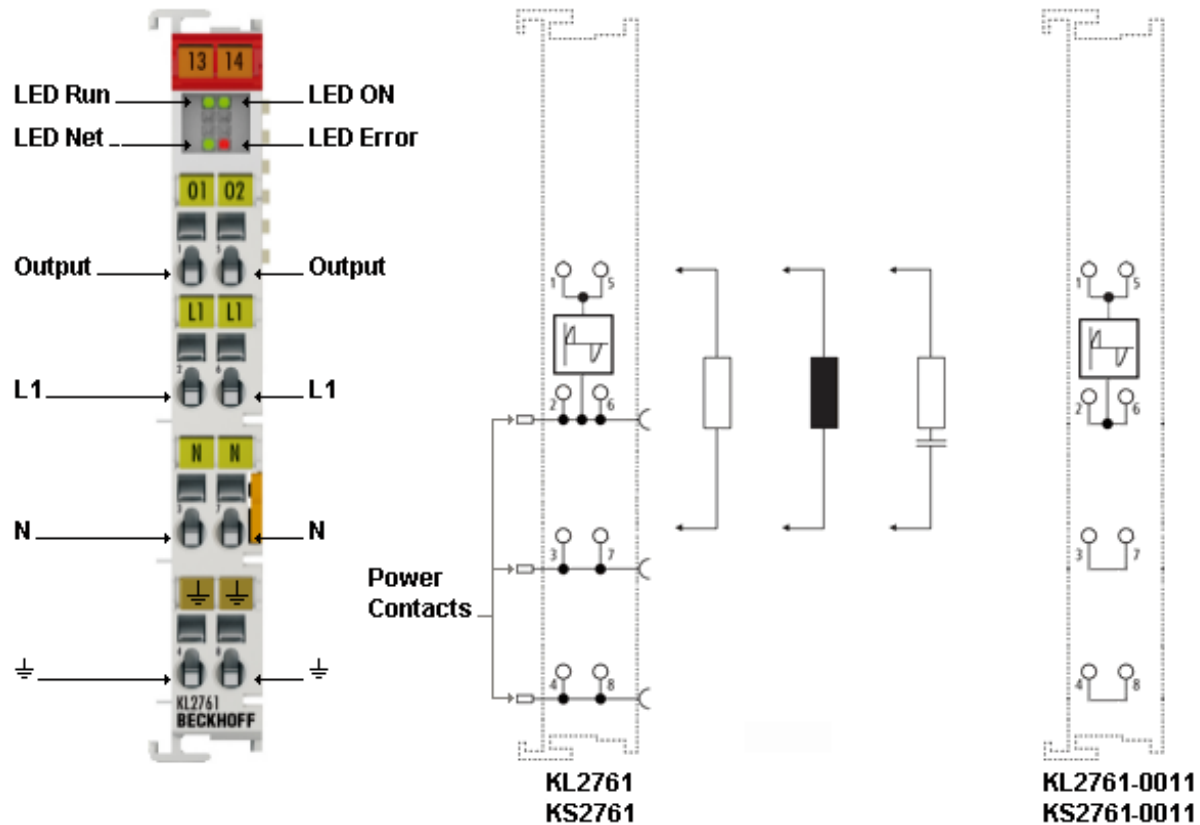


Fig. 2: KL2761 - Universal dimmer terminals, 230 V_{AC}, 600 VA

The KL2761 / KS2761 dimmer terminal is intended for the direct connection of resistive, inductive or capacitive AC lamp loads with a power rating of up to 600 VA (W). Typical lighting devices such as incandescent lamps, inductive and electronic ballasts are detected and controlled in the right operation mode. The dimmer terminal calculates the appropriate phase control angle in leading edge or trailing edge phase control from the brightness values specified via the process data. The output is short-circuit-proof and overload-proof.

The load status can be read.

A variant without power contacts (see contact diagram, right) is also available in the KL2761-0011 / KS2761-0011. This can be used for 230 V even without a special power feed terminal.

2.3 Basic function principles

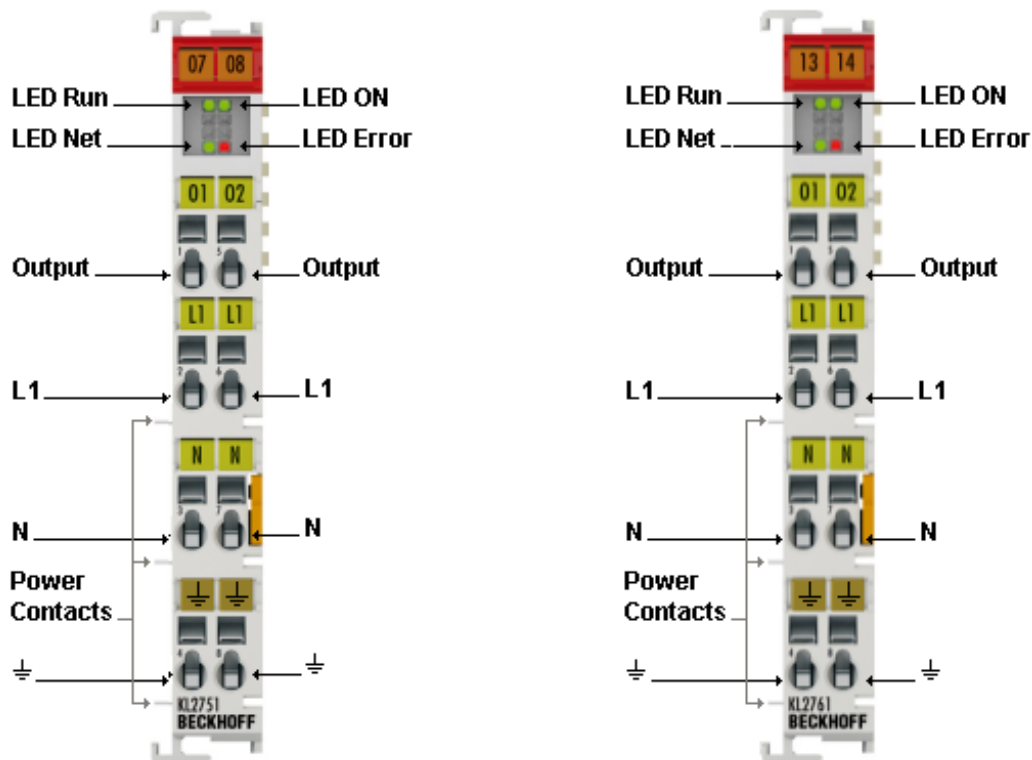


Fig. 3: KL2751, KL2761

The KL2751 (300 VA) and KL2761 (600 VA) dimmer terminals are intended for the direct connection of different AC lamp loads. Typical lighting devices such as incandescent lamps, inductive and electronic ballasts are detected and controlled in the right operation mode. In addition to automatic load detection, the Bus Terminal offers a short-circuit-proof and overload-proof output.

The KL2751 and KL2761 are extremely compact universal dimmers in Bus Terminal format and are aimed primarily at use in building services. The brightness values of the lighting system can be modified via the controller process data, based on any bus system supported by the Beckhoff I/O system. However, the universal dimmers can also be used as power switches for AC voltages. With a switchable power of 300 VA (W) or 600 VA (W), wear-free switching of numerous consumers is possible.

In the *Automatic Recognition* dimmer mode, the dimmer terminals can detect the load type and save the result. To do this the dimmer terminal switches the load on at low power for about 5 seconds after mains voltage is applied. The dimmer terminal cannot be controlled during this period.

The *Zero Switch* dimmer mode enables the gentle switching on and off of almost all loads. If the process data output value changes from zero to non-zero here, the output is switched on in the next voltage zero crossing. When the dimming value falls back to zero, the output is switched off in the next current zero crossing.

The dimmer terminal is short-circuit-proof. It limits the current in the event of a short circuit, thereby protecting the load and preventing triggering of the main fuse.

NOTICE



Notes on operation

Also read the [notes on operation](#) [▶ 26] in the chapter Mounting and wiring.

2.4 Technical data

Technical data	KL2751, KL2751-0011, KS2751, KS2751-0011	KL2761, KL2761-0011, KS2761, KS2761-0011
Mains voltage	230 V _{AC}	230 V _{AC}
Rated power**	300 VA (W), max. 1.35 A	600 VA (W), max. 2.7 A
Permissible load types	Inductive (transformers only, no ballasts for fluorescent tubes), capacitive or resistive lamp loads No motors! Inductive and capacitive loads must not be mixed! Automatic load detection	
Cable length	max. 100 m between dimmer terminal and lamp	
Types of control	Leading edge phase control, trailing edge phase control, rectifier mode (positive or negative half-wave in leading edge phase control)	
Resolution	max. 7 bit	
Leakage current (OFF state)	< 2 mA	
Electrical isolation	500 V (K-bus / field voltage), 3750 V _{AC} (1 min.)	
Power supply for the electronics	via the K-bus	
Current consumption from K-bus	typically 95 mA	
Bit width in the input process image	1 x 16 bit data, 1 x 8 bit status	
Bit width in the output process image	1 x 16 bit data, 1 x 8 bit control	
Configuration	via the Bus Coupler or the controller	
Weight	approx. 60 g	
Permissible ambient temperature range during operation	0 °C to + 55 °C (refer to the chapter Installation positions! [► 18])	
Permissible ambient temperature range during storage	-25 °C ... + 85 °C	
Permissible relative air humidity	95 %, no condensation	
Dimensions (W x H x D)	approx. 15 mm x 100 mm x 70 mm (width aligned: 12 mm)	
Mounting [► 15]	on 35 mm mounting rail conforming to EN 60715	
Vibration / shock resistance	conforms to EN 60068-2-6 / EN 60068-2-27	
EMC immunity / emission	conforms to EN 61000-6-2 / EN 61000-6-4	
Protection class	IP20	
Installation position	load-dependent (refer to the chapter Installation positions! [► 18])	
Pluggable wiring	for all KSxxxx terminals	
Approvals / markings*	CE, UKCA, EAC	

*) Real applicable approvals/markings see type plate on the side (product marking).

**) Rated power = lamp power + ballast losses

The ballast losses are typically equivalent to:

- 5 % of the rated output of the ballast in the case of electronic ballasts
- 20 % of the rated output of the transformer in the case of inductive ballasts

2.5 LED displays

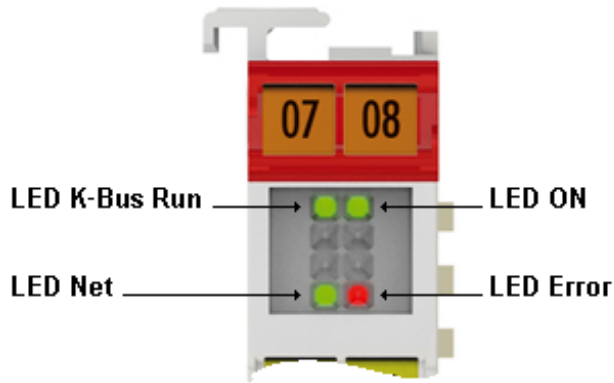


Fig. 4: KL2751, KL2761 - LED displays

LED	Display	
K-Bus run (green)	off	No data transfer on the K-Bus
	on	Data transmission on the K-bus is active
Mains (green)	off	- Terminal is not synchronized with the mains* - With automatic load detection the load type has not yet been tested
	on	- Terminal has synchronized itself with the mains* - Load type was detected
ON (green)	off	Process data are zero
	on	Process data are not zero
Error (red)	on	A load-side short circuit was detected

*) Synchronisation with the mains can only occur if a load is connected!

⚠ WARNING

Risk of electric shock!

With the Sync LED switched off mains voltage may still be present at the KL2751/ KL2761 output! At this time automatic load detection and synchronization have not yet been carried out!

Automatic load detection display

After the load detection (shortly after the mains voltage has been switched on) the terminal signals the load type and the selected operation mode via the LEDs.

- LED sequence green / red: Trailing edge phase control for resistive or capacitive load
- LED sequence green / red: Leading edge phase control for inductive load

3 Mounting and wiring

3.1 Instructions for ESD protection

NOTICE

Destruction of the devices by electrostatic discharge possible!

The devices contain components at risk from electrostatic discharge caused by improper handling.

- Please ensure you are electrostatically discharged and avoid touching the spring contacts (see fig.) of the device directly.
- Avoid contact with highly insulating materials (synthetic fibers, plastic film etc.).
- Surroundings (working place, packaging and personnel) should be grounded probably, when handling with the devices.
- Each assembly must be terminated at the right hand end with a KL9010 bus end terminal, to ensure the protection class and ESD protection.

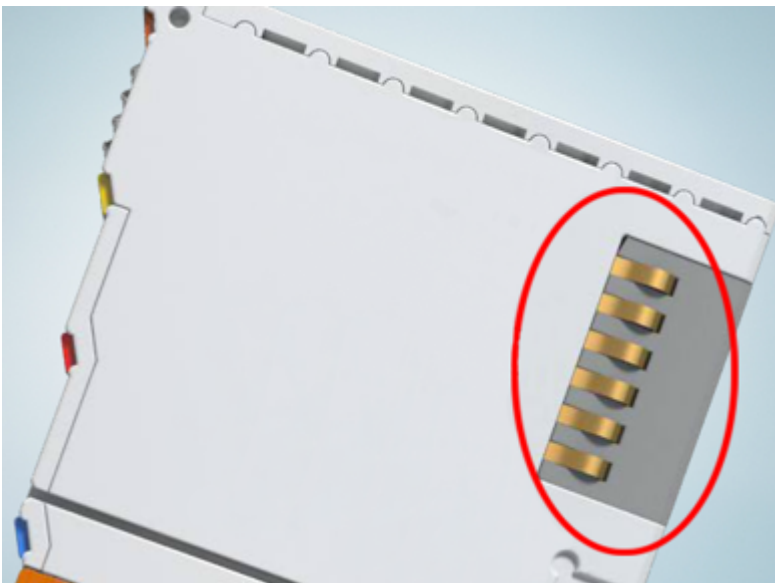


Fig. 5: Spring contacts of the Beckhoff I/O components

3.2 Installation on mounting rails

⚠ WARNING

Risk of electric shock and damage of device!

Bring the bus terminal system into a safe, powered down state before starting installation, disassembly or wiring of the bus terminals!

The Bus Terminal system and is designed for mounting in a control cabinet or terminal box.

Assembly

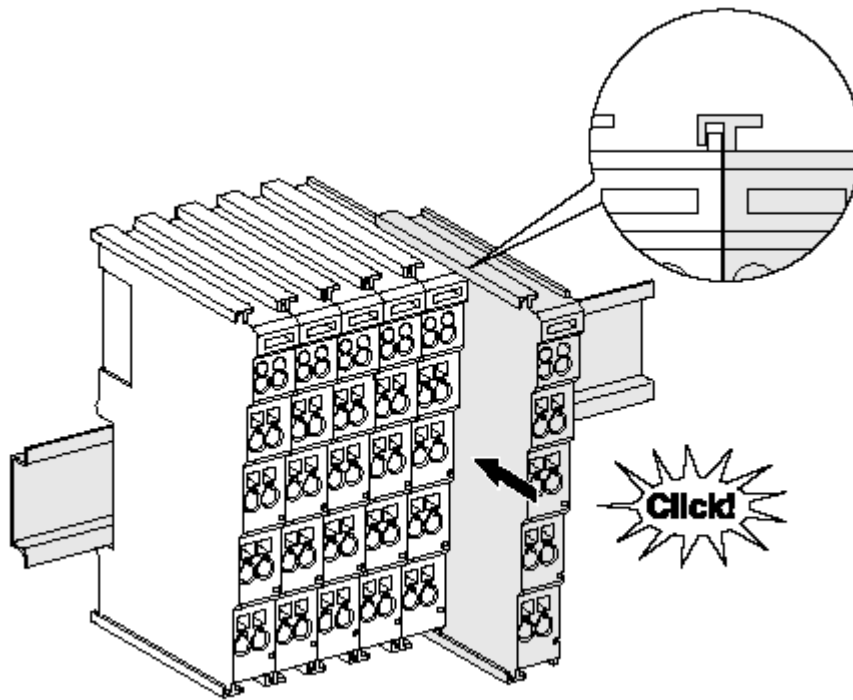


Fig. 6: Attaching on mounting rail

The bus coupler and bus terminals are attached to commercially available 35 mm mounting rails (DIN rails according to EN 60715) by applying slight pressure:

1. First attach the fieldbus coupler to the mounting rail.
2. The bus terminals are now attached on the right-hand side of the fieldbus coupler. Join the components with tongue and groove and push the terminals against the mounting rail, until the lock clicks onto the mounting rail.

If the terminals are clipped onto the mounting rail first and then pushed together without tongue and groove, the connection will not be operational! When correctly assembled, no significant gap should be visible between the housings.

● Fixing of mounting rails

i The locking mechanism of the terminals and couplers extends to the profile of the mounting rail. At the installation, the locking mechanism of the components must not come into conflict with the fixing bolts of the mounting rail. To mount the mounting rails with a height of 7.5 mm under the terminals and couplers, you should use flat mounting connections (e.g. countersunk screws or blind rivets).

NOTICE

Ground the mounting rail!

Ensure that the mounting rail is sufficiently grounded.

Connections within a bus terminal block

The electric connections between the Bus Coupler and the Bus Terminals are automatically realized by joining the components:

- The six spring contacts of the E-Bus/K-Bus deal with the transfer of the data and the supply of the Bus Terminal electronics.
- The power contacts deal with the supply for the field electronics and thus represent a supply rail within the bus terminal block. The power contacts are supplied via terminals points on the Bus Coupler (up to 24 V) or for higher voltages via power feed terminals.



Power Contacts

During the design of a bus terminal block, the pin assignment of the individual Bus Terminals must be taken account of, since some types (e.g. analog Bus Terminals or digital 4-channel Bus Terminals) do not or not fully loop through the power contacts. Power Feed Terminals (EL91xx, EL92xx or KL91xx, KL92xx) interrupt the power contacts and thus represent the start of a new supply rail.

Power contact $\perp$

The power contact labeled $\perp$ (earthing connection according to IEC 60417-5017, British English: earth, American English: ground) can be used as grounding. For safety reasons this contact mates first when plugging together, and can ground short-circuit currents of up to 125 A.

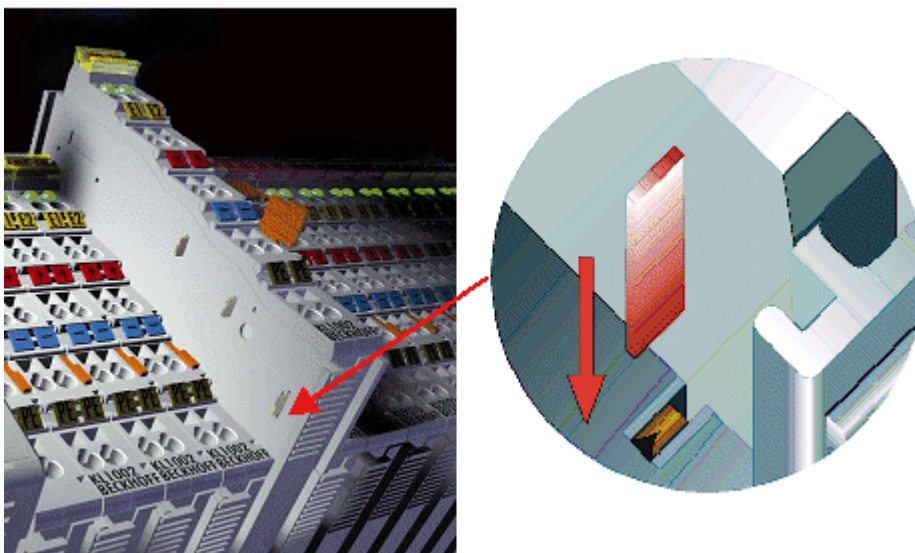


Fig. 7: Power contact on left side

WARNING

Risk of electric shock!

The power contact labeled $\perp$ must not be used for other potentials!

NOTICE

Possible damage of the device

Note that, for reasons of electromagnetic compatibility, the earthing contacts are capacitatively coupled to the mounting rail. This may lead to incorrect results during insulation testing or to damage on the terminal (e.g. disruptive discharge to the earthing line during insulation testing of a consumer with a nominal voltage of 230 V). For insulation testing, disconnect the earthing supply line at the Bus Coupler or the Power Feed Terminal! In order to decouple further feed points for testing, these Power Feed Terminals can be released and pulled at least 10 mm from the group of terminals.

Disassembly

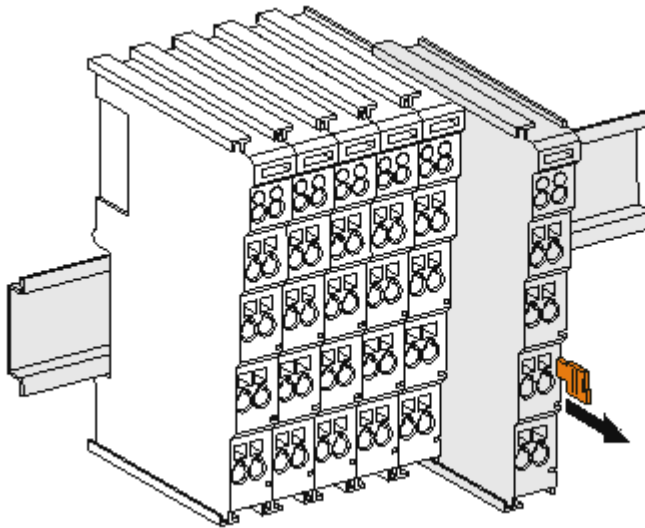


Fig. 8: Disassembling of terminal

Each terminal is secured by a lock on the mounting rail, which must be released for disassembly:

1. Pull the terminal by its orange-colored lugs approximately 1 cm away from the mounting rail. In doing so for this terminal the mounting rail lock is released automatically and you can pull the terminal out of the bus terminal block easily without excessive force.
2. Grasp the released terminal with thumb and index finger simultaneous at the upper and lower grooved housing surfaces and pull the terminal out of the bus terminal block.

3.3 Disposal



Products marked with a crossed-out wheeled bin shall not be discarded with the normal waste stream. The device is considered as waste electrical and electronic equipment. The national regulations for the disposal of waste electrical and electronic equipment must be observed.

3.4 Installation positions

NOTICE

Constraints regarding installation position and operating temperature range

Please refer to the technical data for a terminal to ascertain whether any restrictions regarding the installation position and/or the operating temperature range have been specified. When installing high power dissipation terminals ensure that an adequate spacing is maintained between other components above and below the terminal in order to guarantee adequate ventilation!

Optimum installation position (standard)

The optimum installation position requires the mounting rail to be installed horizontally and the connection surfaces of the EL- / KL terminals to face forward (see Fig. "Recommended distances for standard installation position"). The terminals are ventilated from below, which enables optimum cooling of the electronics through convection. "From below" is relative to the acceleration of gravity.

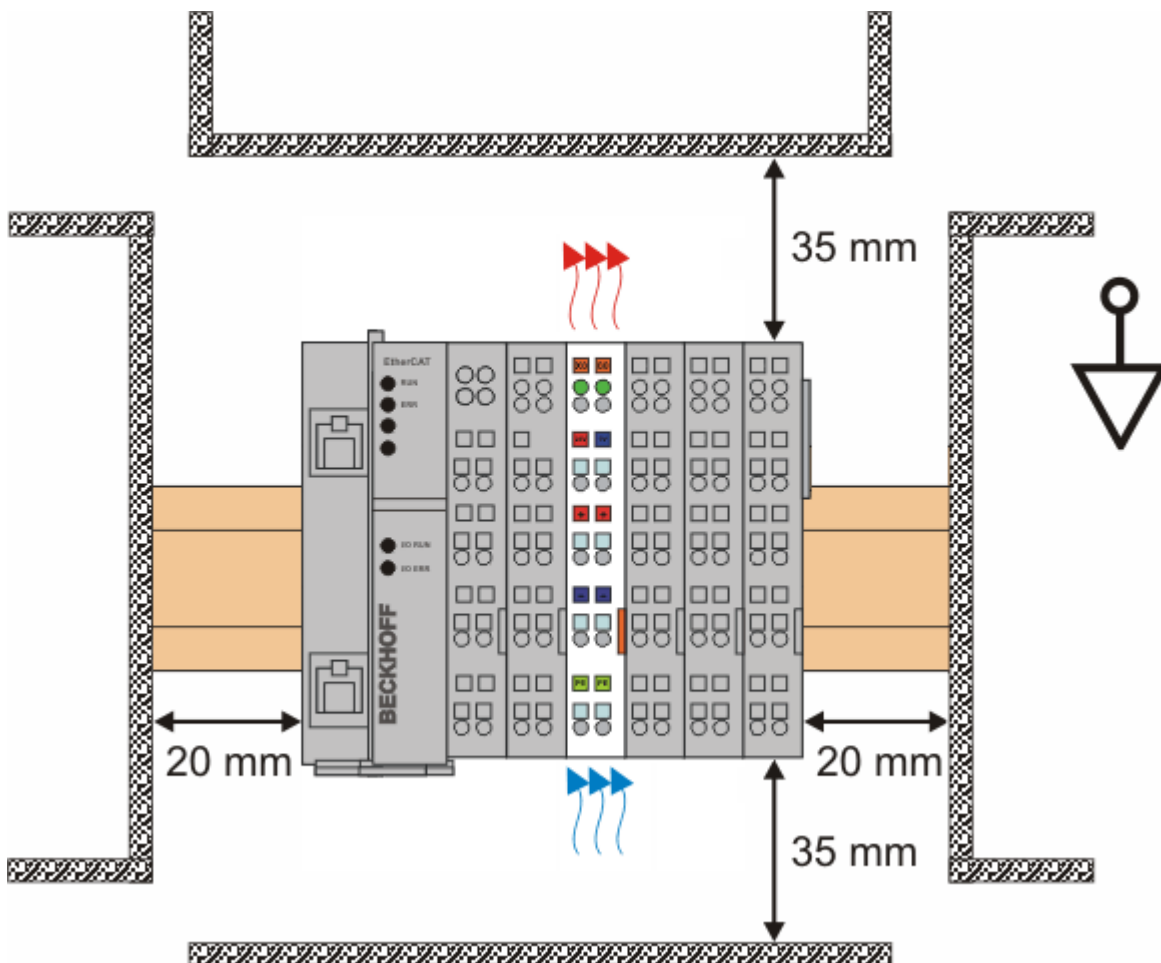


Fig. 9: Recommended distances for standard installation position

Compliance with the distances shown in Fig. "Recommended distances for standard installation position" is recommended.

Other installation positions

All other installation positions are characterized by different spatial arrangement of the mounting rail - see Fig "Other installation positions".

The minimum distances to ambient specified above also apply to these installation positions.

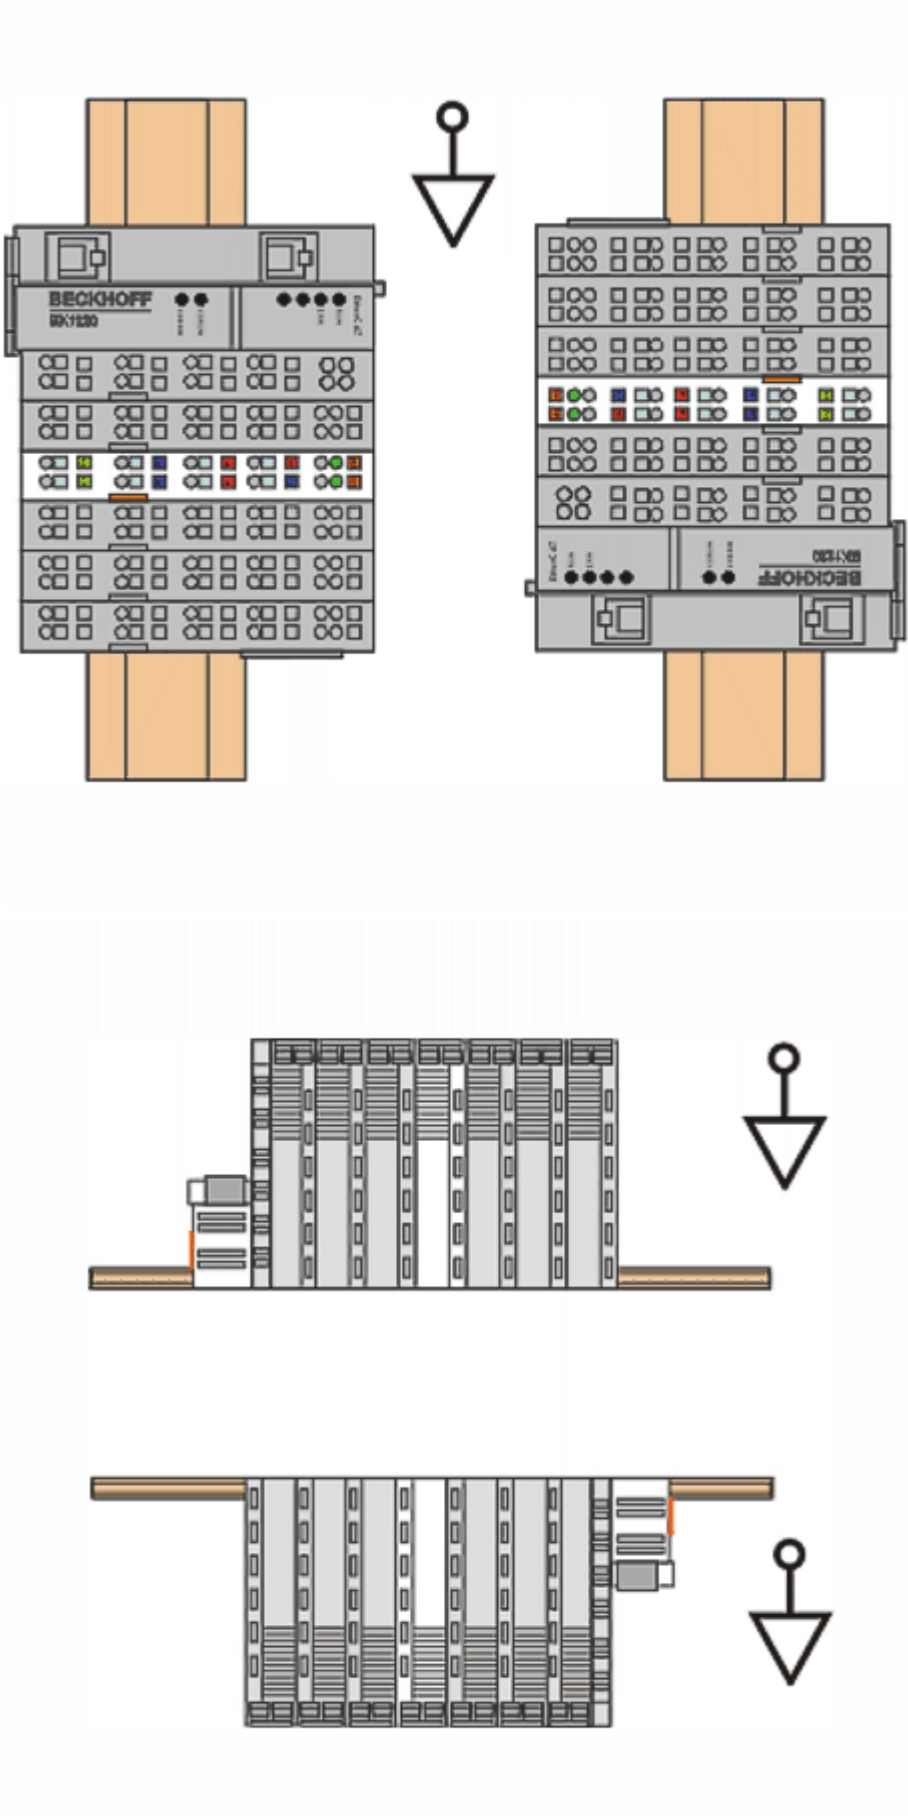


Fig. 10: Other installation positions

3.5 Connection

3.5.1 Connection system

⚠ WARNING

Risk of electric shock and damage of device!

Bring the bus terminal system into a safe, powered down state before starting installation, disassembly or wiring of the bus terminals!

Overview

The bus terminal system offers different connection options for optimum adaptation to the respective application:

- The terminals of ELxxxx and KLxxxx series with standard wiring include electronics and connection level in a single enclosure.
- The terminals of ESxxxx and KSxxxx series feature a pluggable connection level and enable steady wiring while replacing.
- The High Density Terminals (HD Terminals) include electronics and connection level in a single enclosure and have advanced packaging density.

Standard wiring (ELxxxx / KLxxxx)



Fig. 11: Standard wiring

The terminals of the ELxxxx and KLxxxx series integrate screwless spring-cage technology for quick and easy wiring.

Pluggable wiring (ESxxxx / KSxxxx)



Fig. 12: Pluggable wiring

The terminals of ESxxxx and KSxxxx series feature a pluggable connection level. The assembly and wiring procedure is the same as for the ELxxxx and KLxxxx series. The pluggable connection level enables the complete wiring to be removed as a plug connector from the top of the housing for servicing. The lower section can be removed from the terminal block by pulling the unlocking tab. Insert the new component and plug in the connector with the wiring. This reduces the installation time and eliminates the risk of wires being mixed up.

The familiar dimensions of the terminal only had to be changed slightly. The new connector adds about 3 mm. The maximum height of the terminal remains unchanged.

A tab for strain relief of the cable simplifies assembly in many applications and prevents tangling of individual connection wires when the connector is removed.

Conductor cross sections between 0.08 mm² and 2.5 mm² can continue to be used with the proven spring force technology.

The overview and nomenclature of the product names for ESxxxx and KSxxxx series has been retained as known from ELxxxx and KLxxxx series.

High Density Terminals (HD Terminals)



Fig. 13: High Density Terminals

The terminals from these series with 16/32 terminal points are distinguished by a particularly compact design, as the packaging density is twice as large as that of the standard 12 mm bus terminals. Massive conductors and conductors with a wire end sleeve can be inserted directly into the spring loaded terminal point without tools.



Wiring HD Terminals

The High Density Terminals of the ELx8xx and KLx8xx series doesn't support pluggable wiring.

Ultrasonically compacted (ultrasonically welded) strands



Ultrasonically compacted (ultrasonically welded) strands

Ultrasonically compacted (ultrasonically welded) strands can also be connected to the standard and high-density terminals. In this case, please note the tables concerning the wire-size width [► 23]!

3.5.2 Wiring

⚠ WARNING

Risk of electric shock and damage of device!

Bring the bus terminal system into a safe, powered down state before starting installation, disassembly or wiring of the bus terminals!

Terminals for standard wiring ELxxxx/KLxxxx and for pluggable wiring ESxxxx/KSxxxx

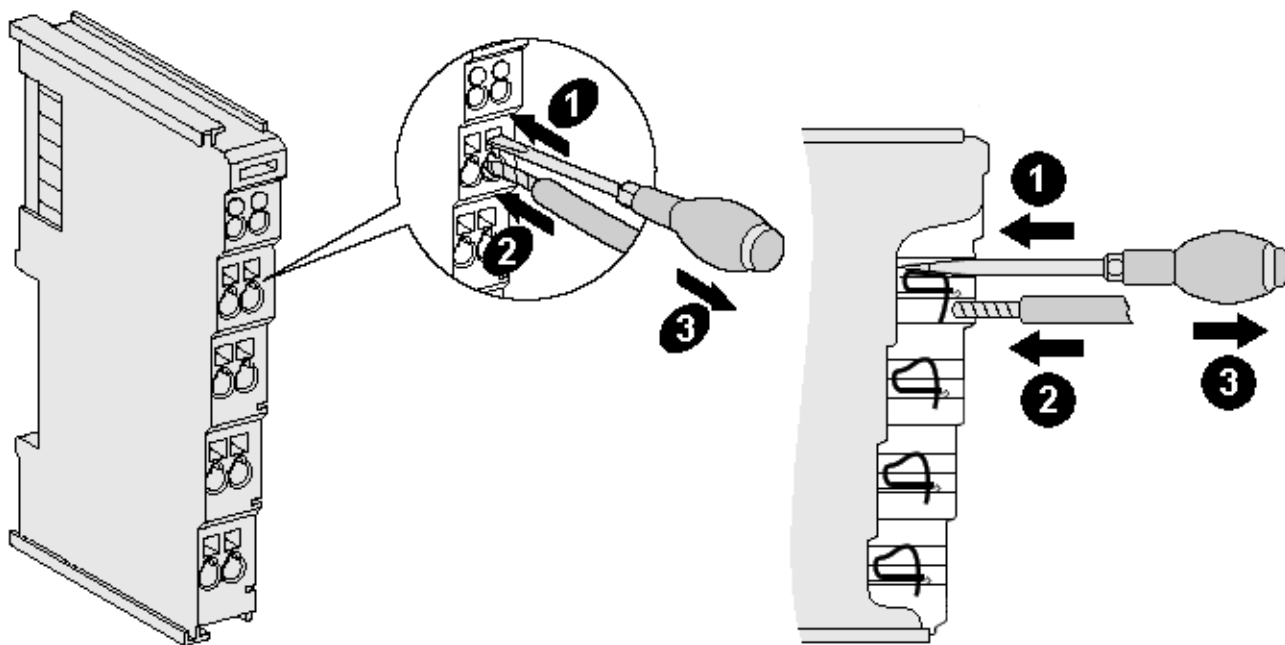


Fig. 14: Connecting a cable on a terminal point

Up to eight terminal points enable the connection of solid or finely stranded cables to the bus terminal. The terminal points are implemented in spring force technology. Connect the cables as follows (see fig. "Connecting a cable on a terminal point"):

1. Open a terminal point by pushing a screwdriver straight against the stop into the square opening above the terminal point. Do not turn the screwdriver or move it alternately (don't toggle).
2. The wire can now be inserted into the round terminal opening without any force.
3. When the screwdriver is removed, the terminal point closes automatically and holds the wire securely and permanently in place

See the following table for the suitable wire size width:

Terminal housing	ELxxxx, KLxxxx	ESxxxx, KSxxxx
Wire size width (single core wires)	0.08 ... 2.5 mm ²	0.08 ... 2.5 mm ²
Wire size width (fine-wire conductors)	0.08 ... 2.5 mm ²	0.08 ... 2.5 mm ²
Wire size width (conductors with a wire end sleeve)	0.14 ... 1.5 mm ²	0.14 ... 1.5 mm ²
Wire stripping length	8 ... 9 mm	9 ... 10 mm

High Density Terminals (HD Terminals [► 21]) with 16/32 terminal points

The conductors of the HD Terminals are connected without tools for single-wire conductors using the direct plug-in technique, i.e. after stripping the wire is simply plugged into the terminal point. The cables are released, as usual, using the contact release with the aid of a screwdriver. See the following table for the suitable wire size width.

Terminal housing	High Density Housing
Wire size width (single core wires)	0.08 ... 1.5 mm ²
Wire size width (fine-wire conductors)	0.25 ... 1.5 mm ²
Wire size width (conductors with a wire end sleeve)	0.14 ... 0.75 mm ²
Wire size width (ultrasonically compacted [ultrasonically welded] strands)	only 1.5 mm ² (see <u>notice</u> [► 21])
Wire stripping length	8 ... 9 mm

3.5.3 Shielding**Shielding**

Encoder, analog sensors and actuators should always be connected with shielded, twisted paired wires.

3.6 KL2751, KL2761 - Contact assignment

⚠ WARNING

Risk of injury through electric shock and damage to the device!

Bring the Bus Terminals system into a safe, de-energized state before starting mounting, disassembly or wiring of the Bus Terminals!

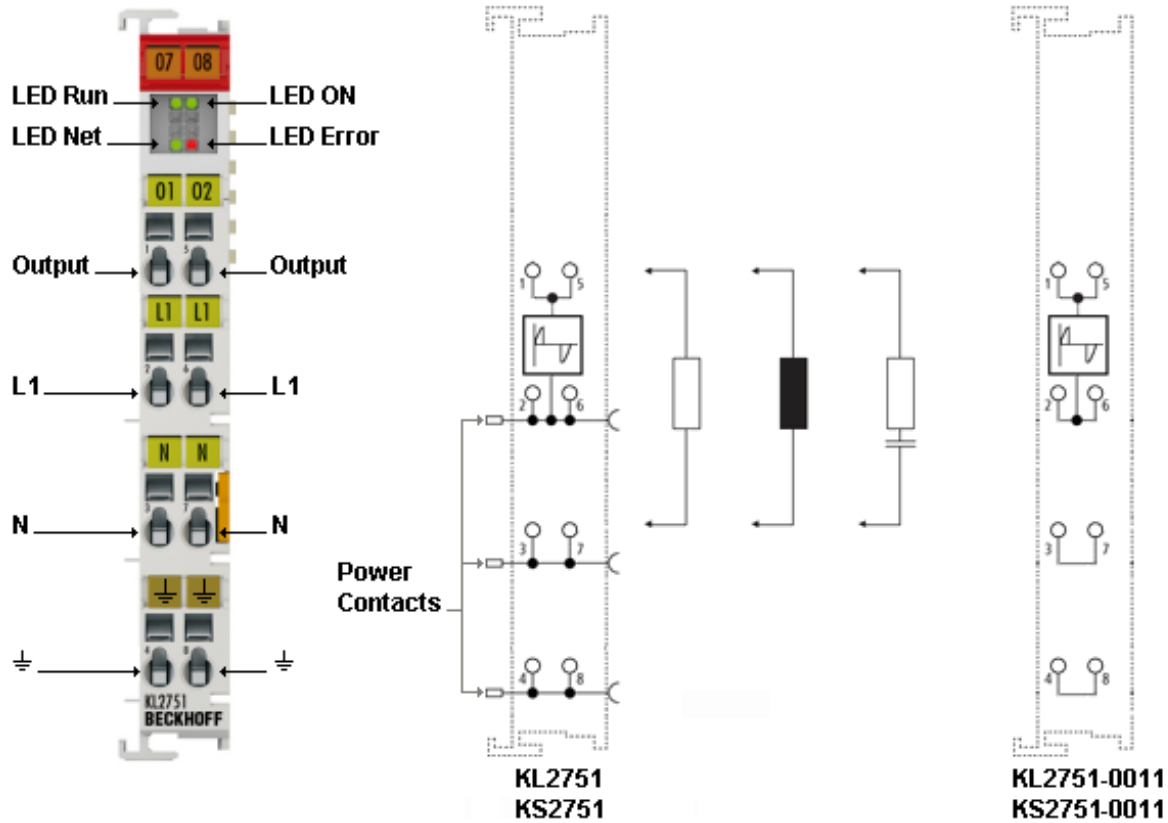


Fig. 15: Contact assignment taking KL2751 as an example

Terminal point	No.	KL2751, KL2761, connection for	KL2751-0011, KL2761-0011, connection for
Output	1	Load (internally connected with terminal point 5)	Load (internally connected with terminal point 5)
L1	2	Phase (internally connected with terminal point 6 and L1 power contact)	Phase (internally connected with terminal point 6)
N	3	Neutral conductor (internally connected with terminal point 7 and N power contact)	Neutral conductor (internally connected with terminal point 7)
⏚	4	Earthing conductor (internally connected with terminal point 8 and ⏚ power contact)	Protective conductor (internally connected with terminal point 8)
Output	5	Load (internally connected with terminal point 1)	Load (internally connected with terminal point 1)
L1	6	Phase (internally connected with terminal point 2 and L1 power contact)	Phase (internally connected with terminal point 2)
N	7	Neutral conductor (internally connected with terminal point 3 and N power contact)	Neutral conductor (internally connected with terminal point 3)
⏚	8	Earthing contact (internally connected with terminal point 4 and ⏚ power contact)	Earthing contact (internally connected with terminal point 4)

Power feed terminal

NOTICE

Risk of damage to the device!

Bus Couplers, Bus Terminal controllers and power supply terminals for 24 V are not suitable for the supply of mains voltage (230 V_{AC}) into the power contacts! They are designed only for voltages up to 24 V and would be destroyed if higher voltage was applied at their power contacts!

It is imperative that you use a power feed terminal (e.g.: KL9150, KL9160, KL9250, KL9260) designed for 230 V_{AC} to supply mains voltage (230 V_{AC}) into the power contacts!

Several dimmer terminals can be operated on one power feed terminal.



Separation terminal

If 24 V and 230 V_{AC} are to be used on the power contacts in a Bus Terminal block, the KL9080 separation terminal can be used in order to clearly separate the potential blocks visually from each other.

Short-circuit limitation

The dimmer terminals are equipped with short-circuit current limitation. The current is limited to approx. 10 A to 15 A. Normally triggering of the fuse is therefore prevented.

The short circuit current flows for less than 0.5 ms and is switched on automatically. After a short circuit was detected the KL2751 tries to switch the system on again and tests the line with a low voltage. If the short circuit has been eliminated, the dimmer terminal returns to the previous dimmer value.

A short circuit on the line should always be avoided and never deliberately caused! The components in the dimmer terminal are stressed by short circuits. A large number of short circuits will shorten the service life of the dimmer terminal!

Fuses

The dimmer terminal may be protected with fuses up to 10 A.

The dimmer terminal protects itself against destruction due to short circuit and overload. This built-in protection acts on the connection line between dimmer terminal and load in the event of a short circuit.

NOTICE

Risk of damage to the device!

However, overload protection must still be provided. The fine-wire fuse often used in devices with transformers must not be bridged or changed in its value. This could lead to overheating of the transformer.

3.7 Notes on operation - intended use

3.7.1 Supply

Mains supply

NOTICE

No upstream transformers!

The KL2751 and KL2761 dimmer terminals are intended for direct operation on mains supplies (230 V_{AC}) **without** upstream transformer.

Overly large inductances in the supply line to the dimmer terminal will lead to its destruction in the event of a short circuit!

Automatic load detection does not operate reliably with an upstream transformer.

Power feed terminals

It is imperative that you use a power feed terminal (e.g.: KL9150, KL9160, KL9250, KL9260) designed for 230 V_{AC} to input mains voltage into the power contacts of the dimmer terminals

KL2751, KL2761, KS2751, KS2761!

See application example for [KL2751](#) [► 29].

The supply in of mains voltage without a power feed terminal is permissible only for dimmer terminals without power contacts:

KL2751-0011, KL2761-0011, KS2751-0011, KS2761-0011!

See application example for [KL2751-0011](#) [► 31].

Minimum interruption of the mains voltage supply

Any interruption in the mains voltage supply to the dimmer terminal may not be shorter than 3 seconds (e.g. an automatic circuit-breaker switching off and on again)!

In the case of shorter interruptions the dimmer does not lose its mains synchronization and can (depending on the starting edge) operate the load for a short while with the wrong type of control. In the case of operation of wound transformers this can lead to the destruction of the dimmer terminal!

Ripple control pulses

● **i** Malfunction due to ripple control pulses

External ripple control pulses on the mains supply can cause brightness fluctuations. Ripple control pulses with higher amplitudes can trigger the dimmer terminal's short circuit detection. The dimmer terminal then switches the load off and ramps up again. The light is switched off for several seconds.

Use audio frequency filters in the supply line to the dimmer terminal in order to avoid these effects.

3.7.2 Load

Permissible loads

NOTICE

No motors!

Use the dimmer terminals for lamp loads only. Motor loads can fully destroy the terminal.

Please consider that the wiring of the dimmer terminal output to a power socket could lead to the use of any type of load.

For motor loads, please use the [KL2791](#) (single-channel speed controller for AC motors).

Do not mix capacitive and inductive loads!

Capacitive and inductive loads must not be mixed on one dimmer terminal!

For example, an electronic ballast and a transformer must not be operated together on one dimmer terminal!

You may operate an ohmic load (e.g. an incandescent lamp) together with either a capacitive or an inductive load.

No additional switches!

Do not connect any additional switches between

- the dimmer terminal and the load
- the dimmer terminal and the ballast
- the ballast and the lamp

Operation modes

NOTICE

Use the right operation mode!

Use only the intended operation mode for each type of load

- capacitive loads may only be controlled with trailing edge phase control.
- inductive loads may only be controlled with leading edge phase control.

⇒ Even if the manufacturer, for example, of an electronic ballast allows this capacitive load to be controlled with leading edge phase control, we urgently recommend that you use trailing edge phase control for this!

⇒ If a load is controlled with the wrong operation mode, this can lead to the destruction of the dimmer terminal or the load!

A typical result is the overheating of the input capacitor of an electronic ballast that is controlled with leading edge phase control.

In addition, the operation modes *Rectifier-positive* and *Rectifier-negative* (both with leading edge phase control) are available for special applications (e.g. vibrator, vibrating conveyor).

3.7.3 Automatic load detection

Long cable lengths

● Long cable lengths



The manual preselection of the operation mode ([dimmer mode](#) [► 38]) is recommended if there are long cables between the dimmer terminal and load. Automatic load detection may fail, since inductive and capacitive line influences may lead to misinterpretation of the load.

In addition, please note the maximum permissible [cable length](#)! [► 12]

User program

● Parameterization of the dimmer terminal on starting the PLC



If you do not operate the dimmer terminal with the default values (e.g. for dimmer mode, ramp time, etc.) it is recommended to initialize the respective registers with the deviating values from the user program when starting the PLC. This saves the service personnel having to perform the complicated manual initialization when exchanging terminals and also helps to avoid undesirable error states.

Wound transformer with no load on the secondary side

NOTICE

No open-circuit transformers!

The automatic load detection, which the dimmer terminal performs on the connected load when the mains voltage is switched on, fails if a wound transformer is connected that has no load connected to its secondary side.

Make sure when switching the mains voltage on that the terminal is not operated on an open-circuit transformer! Also pay attention to this when replacing lamps connected on the secondary side!

3.7.4 Gentle operation of low-voltage lamps

● Low-voltage, high-power lamps



For the operation of low-voltage, high-power lamps (e.g. halogen lamps, 12 V, 100 W, GY6.35 via ballast*), enter a higher [ramp time](#) [► 38] for the dimming ramp than the default value of 500 ms! Since the filament in these lamps is considerably thicker than in lamps with a lower power, it behaves quite sluggishly and must therefore bear the high starting current for a longer period. This effect leads to premature ageing of the lamp. You can counteract this premature ageing by setting a flatter dimming ramp.

*) The ballast must be connected between the dimmer terminal and the halogen lamp (see [mains supply](#) [► 26])!

4 Application examples - overview

- [KL2751, KL2761 \[► 29\]](#): Dimmer terminals with power contacts
- [KL2751-0011, KL2761-0011 \[► 31\]](#): Dimmer terminals without power contacts
- [FB_Dimmer1SwitchEco \[► 55\]](#) function block

4.1 KL2751- Application example

WARNING

Risk of injury through electric shock and damage to the device!

Bring the Bus Terminals system into a safe, de-energized state before starting mounting, disassembly or wiring of the Bus Terminals!

Power feed terminal

NOTICE

Risk of damage to the device!

Bus Couplers, Bus Terminal controllers and power supply terminals for 24 V are not suitable for the supply of mains voltage (230 V_{AC}) into the power contacts! They are designed only for voltages up to 24 V and would be destroyed if higher voltage was applied at their power contacts!

It is imperative that you use a power feed terminal (e.g.: KL9150, KL9160, KL9250, KL9260) designed for 230 V_{AC} to supply mains voltage (230 V_{AC}) into the power contacts!

The example shows the control of an incandescent lamp by a KL2751. The mains voltage (230 V_{AC}) is fed to the power contacts via the KL9160 power feed terminal.

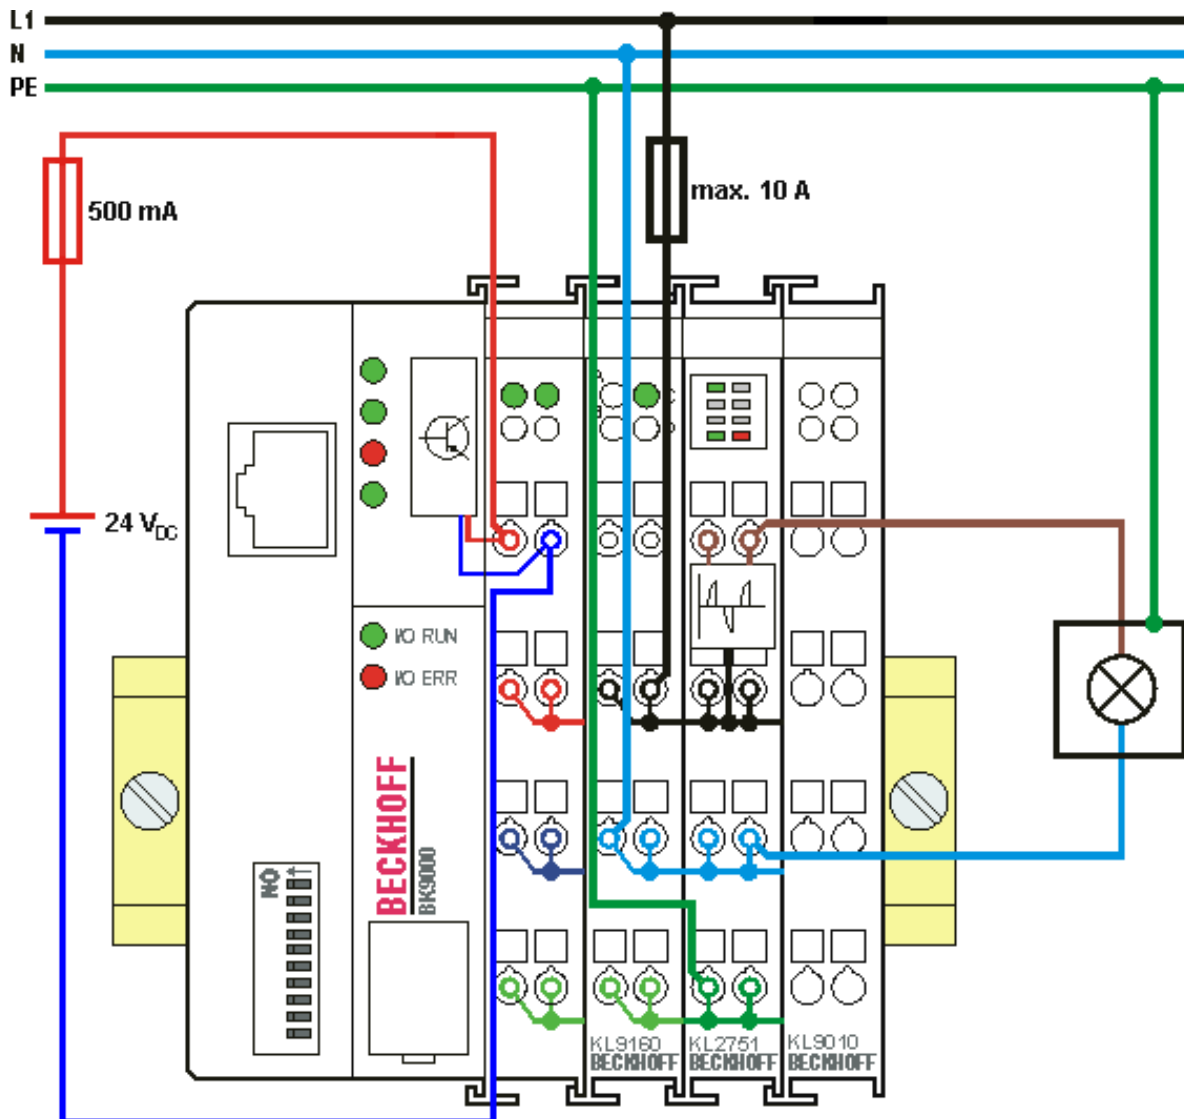


Fig. 16: KL2751 - Application example

⚠ WARNING

Protective earth (PE)

If your luminaire needs to be earthed, connect its earthing contact directly to PE (protective earth) of your switch cabinet or sub-distribution board and not to the KL2751 dimmer terminal!

Several dimmer terminals can be operated on one power feed terminal.

4.2 KL2751-0011 - Application example

WARNING

Risk of injury through electric shock and damage to the device!

Bring the Bus Terminals system into a safe, de-energized state before starting mounting, disassembly or wiring of the Bus Terminals!

Supply in of the mains voltage without a power feed terminal

NOTICE

Risk of damage to the device!

The supply in of mains voltage without a power feed terminal is permissible only for dimmer terminals without power contacts:

KL2751-0011, KL2761-0011,
KS2751-0011, KS2761-0011

The example shows the control of an incandescent lamp by a KL2751-0011. The mains voltage (230 V_{AC}) is fed directly to the KL2751-0011.

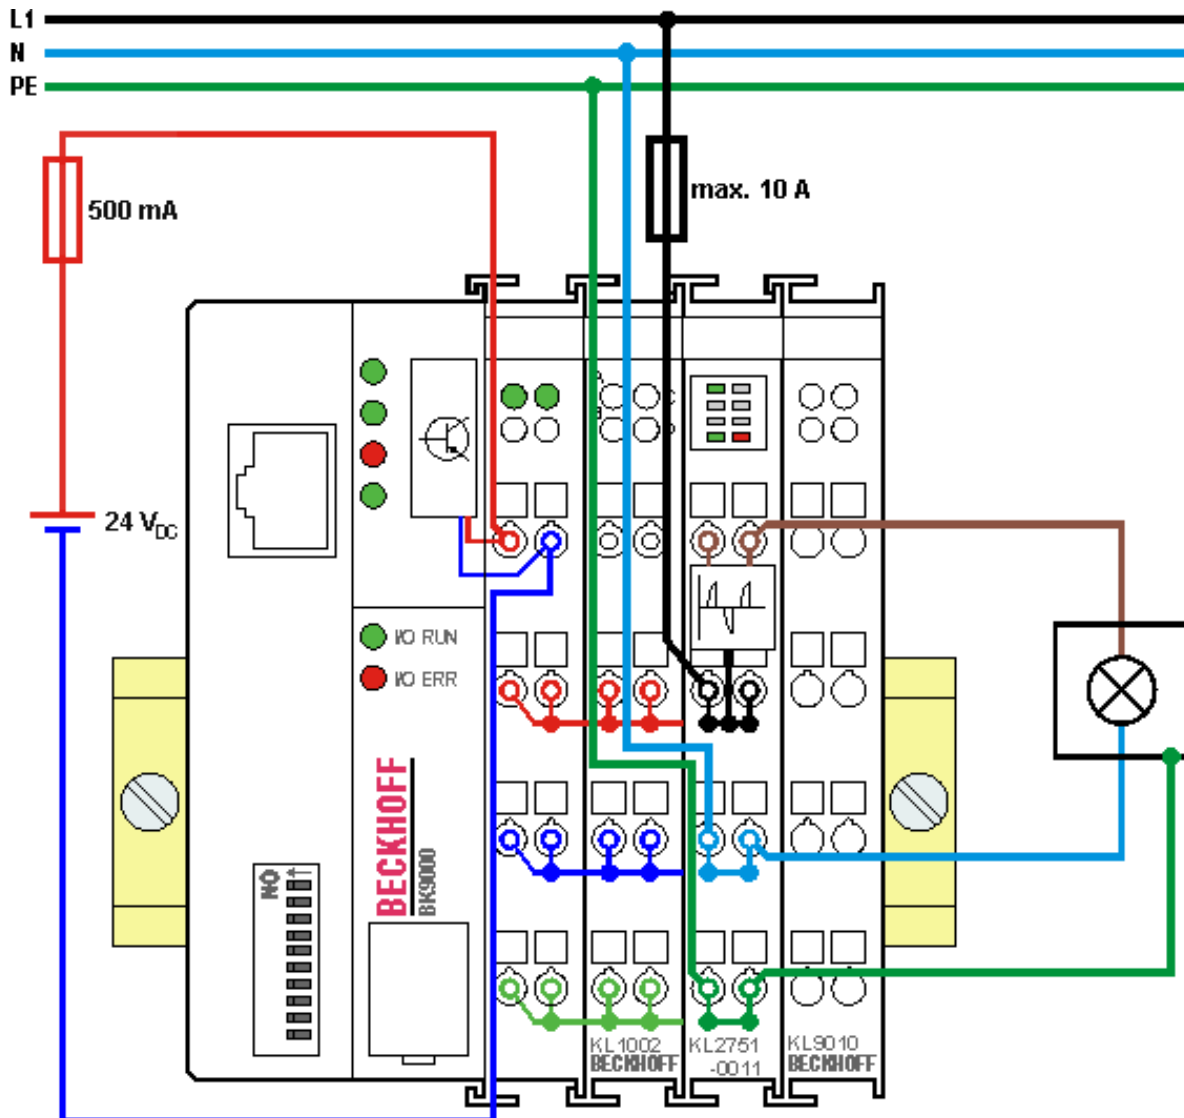


Fig. 17: KL2751-0011 - Application example

5 Configuration software KS2000

5.1 KS2000 - Introduction

The KS2000 configuration software permits configuration, commissioning and parameterization of bus couplers, of the affiliated bus terminals and of Fieldbus Box Modules. The connection between bus coupler / Fieldbus Box Module and the PC is established by means of the serial configuration cable or the fieldbus.



Fig. 18: KS2000 configuration software

Configuration

You can configure the Fieldbus stations with the Configuration Software KS2000 offline. That means, setting up a terminal station with all settings on the couplers and terminals resp. the Fieldbus Box Modules can be prepared before the commissioning phase. Later on, this configuration can be transferred to the terminal station in the commissioning phase by means of a download. For documentation purposes, you are provided with the breakdown of the terminal station, a parts list of modules used and a list of the parameters you have modified. After an upload, existing fieldbus stations are at your disposal for further editing.

Parameterization

KS2000 offers simple access to the parameters of a fieldbus station: specific high-level dialogs are available for all bus couplers, all intelligent bus terminals and Fieldbus Box modules with the aid of which settings can be modified easily. Alternatively, you have full access to all internal registers of the bus couplers and intelligent terminals. Refer to the register description for the meanings of the registers.

Commissioning

The KS2000 software facilitates commissioning of machine components or their fieldbus stations: Configured settings can be transferred to the fieldbus modules by means of a download. After a *login* to the terminal station, it is possible to define settings in couplers, terminals and Fieldbus Box modules directly *online*. The same high-level dialogs and register access are available for this purpose as in the configuration phase.

The KS2000 offers access to the process images of the bus couplers and Fieldbus Box modules.

- Thus, the coupler's input and output images can be observed by monitoring.
- Process values can be specified in the output image for commissioning of the output modules.

All possibilities in the *online mode* can be used in parallel with the actual fieldbus mode of the terminal station. The fieldbus protocol always has the higher priority in this case.

5.2 Parameterization with KS2000

Connect the configuration interface of your fieldbus coupler with the serial interface of your PC via the configuration cable and start the *KS2000* configuration software.



Click on the *Login* button. The configuration software will now load the information for the connected fieldbus station.

In the sample shown, this is

- a BK9000 Bus Coupler for Ethernet
- a KL9160 power feed terminal for 230 V with diagnostics
- a KL2751 dimmer terminal
- a KL9010 bus end terminal

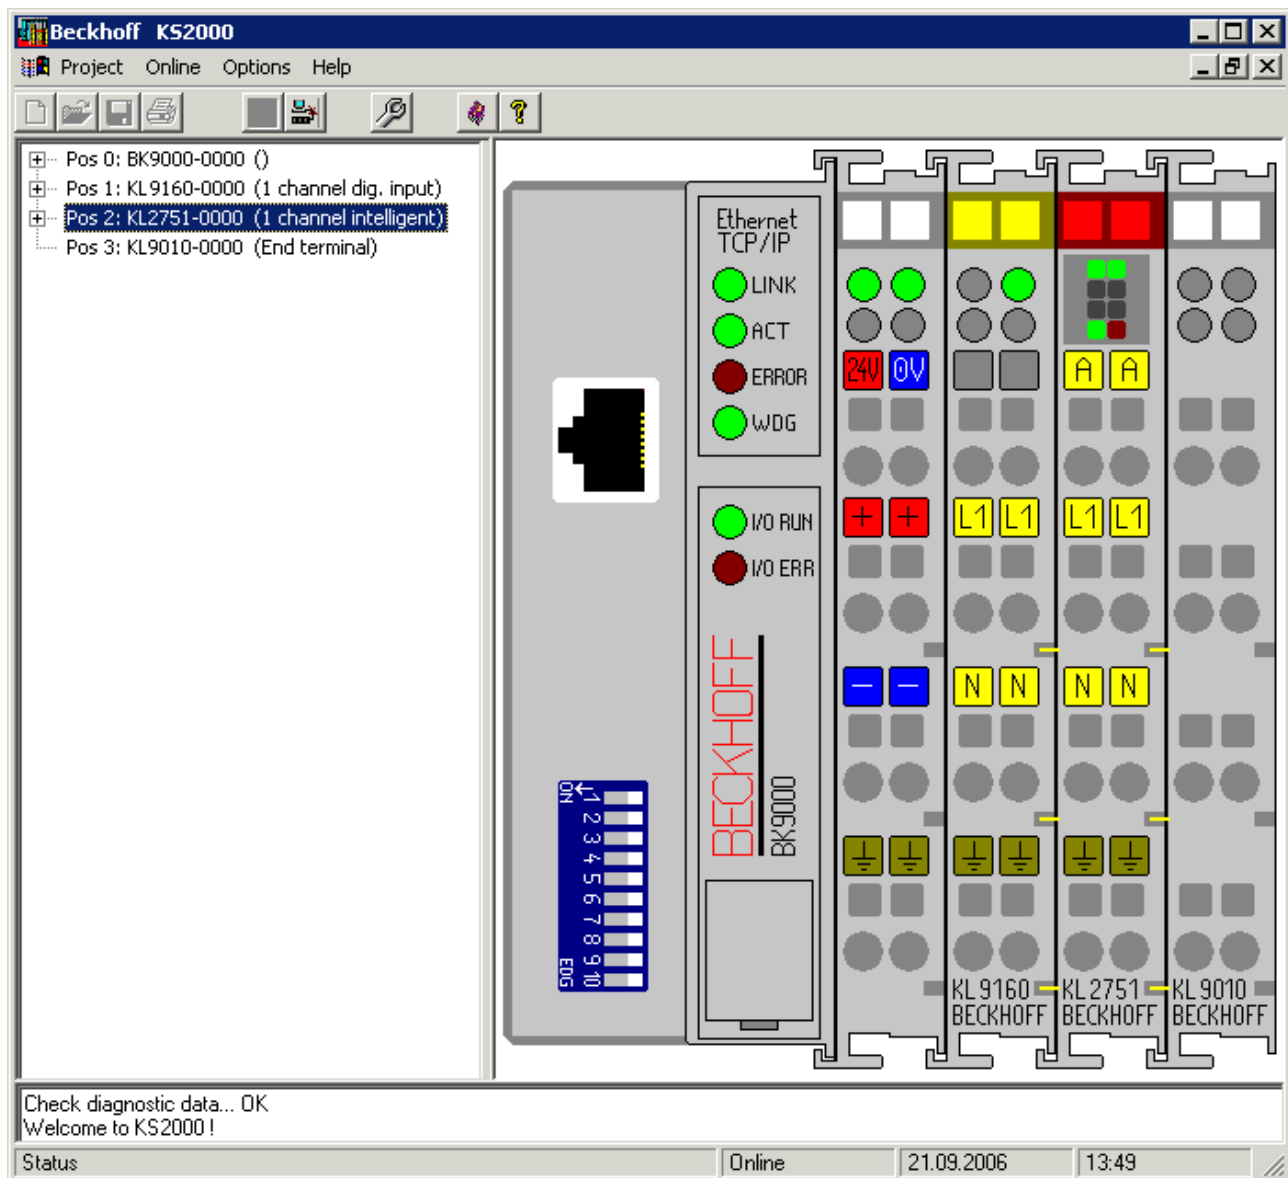


Fig. 19: Display of the fieldbus station in KS2000

The left-hand KS2000 window displays the terminals of the fieldbus station in a tree structure. The right-hand KS2000 window contains a graphic display of the fieldbus station terminals.

In the tree structure of the left-hand window, click on the plus-sign next to the terminal whose parameters you wish to change (item 2 in the example).

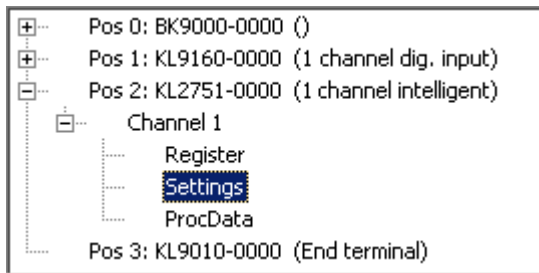


Fig. 20: KS2000 tree branches for channel 1 of the KL2535

For the KL2751, the branches *Register*, *Settings* and *ProcData* are displayed:

- Register [► 36] permits direct access to the registers of the KL2751.
- Under Settings [► 37] you find dialog boxes for parameterization the KL2751.
- ProcData [► 39] displays the KL2751 process data.

5.3 Register

Under *Register* you can directly access the registers of the dimmer terminal. The meaning of the register is explained in the [register overview](#) [► 45].

The following picture shows the registers of the KL2751.

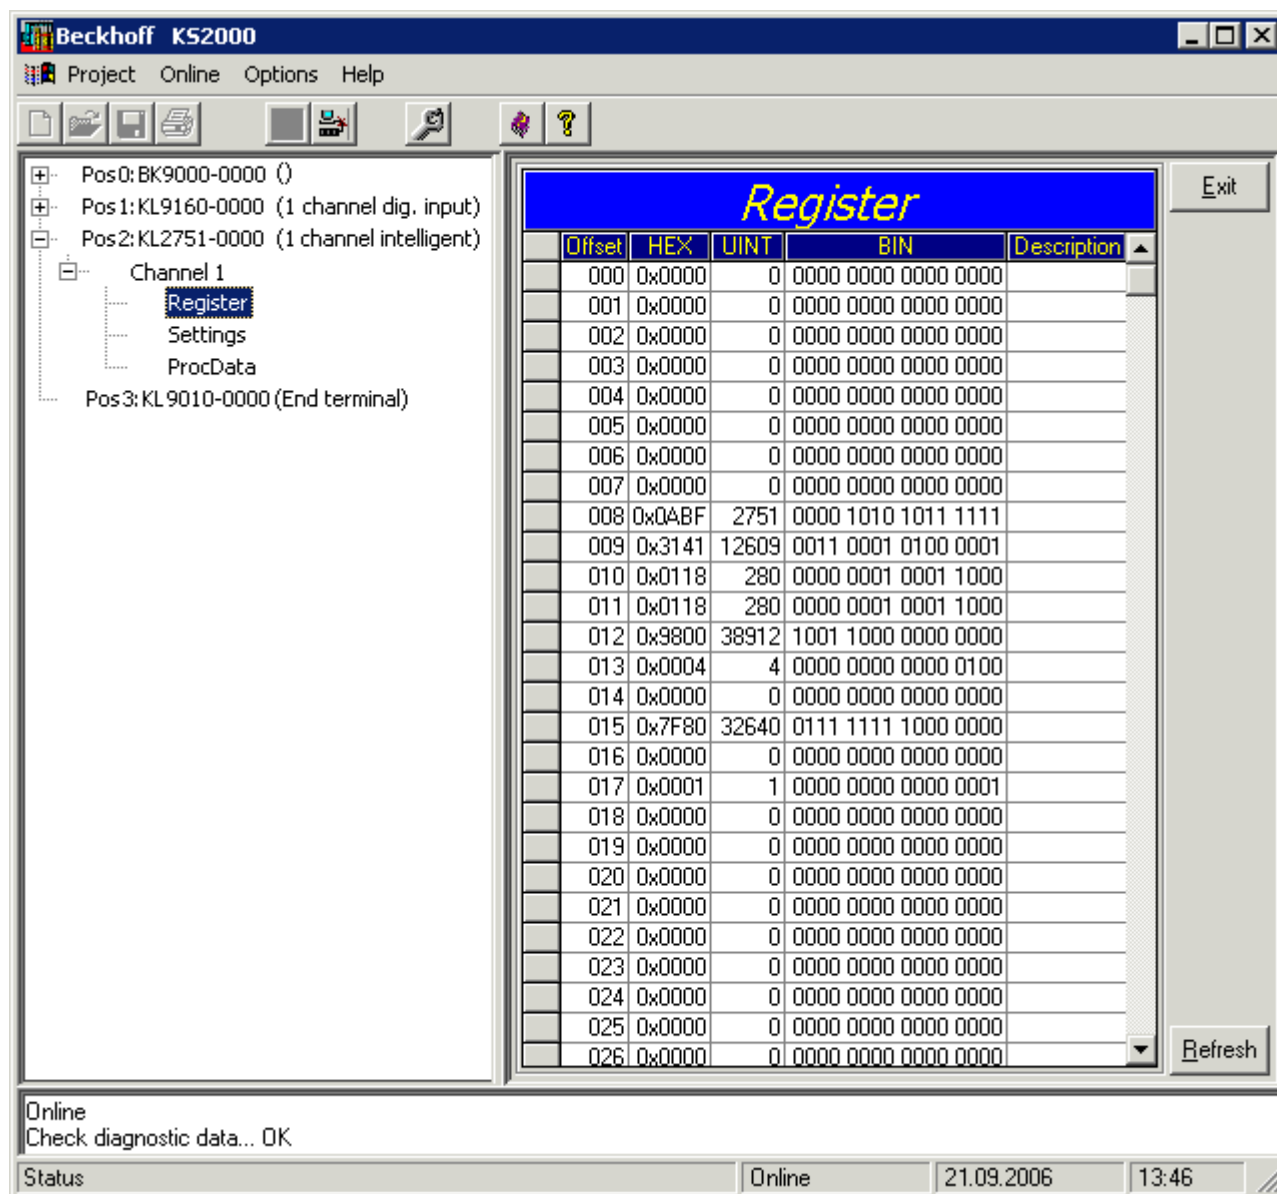


Fig. 21: Register view in KS2000

5.4 Settings

The dialog mask for the parameterization of the KL2751/KL2761 can be found under *Settings*.

Pos.: 2 Channel: 1 Firmware: Version 2 A
Type: KL2751-0000

Operation mode

- ☒ Watchdog timer active
- ☐ User scaling active
- ☐ Dim ramp absolute

Register values

- User offset: 0
- User gain: 1,0000
- Ramp time: 500 ms
- Time-out: 100 ms
- Light value at timeout (on): 50 %
- Light value at timeout (off): 0 %
- Dimmer mode: Automatic load detection
- Bypass behavior: Restart
- Line frequency: 50 Hz

Transfer Cancel

Fig. 22: Settings via KS2000

Operating mode

- **Watchdog timer active** (R32.2 [► 47])
Here you can deactivate the watchdog (default: active).
- **Watchdog timer active** (R32.2 [► 47])
Here you can activate user scaling (default: inactive).
- **Dimming ramp absolute** (R32.3 [► 47])
Here you can switch the dimming ramp from relative (default) to absolute.
 - With the relative dimming ramp, the dimmer terminal requires the preset ramp time [► 38] to ramp up the brightness from 0 to full scale control.
 - With the absolute dimming ramp the dimmer terminal requires the preset ramp time [► 38] to perform the current specified brightness change.



Absolute dimming ramp

The use of the absolute dimming ramp is useful, for example, when you want to control two lamps with two dimmer terminals synchronously.

Sample:

Lamp 1 is lit with 10 % brightness, lamp 2 with 30 % brightness.

Dimmer terminal 1 should now control lamp 1 and dimmer terminal 2 lamp 2 up to 50 % brightness.

With an absolute dimming ramp, both lamps reach 50 % brightness at the same time.

Register values

- **User offset** (R33 [► 47])
You can specify the offset for the user-scaling here (default: 0).
- **User gain** (R34 [► 47])
Here you can specify the user scaling gain (default: 1).

- **Ramp time (R35 [► 47])**

You can select the ramp time here (default 500 ms).

Permissible values: 50 ms, 100 ms, 200 ms, 500 ms, 1 s, 2 s, 5 s and 10 s

- **Timeout (R36 [► 47])**

Here you can specify the timeout time for detecting a fieldbus error (default: 100 ms).

- **Light value for timeout (on) (R37 [► 48])**

Here you can specify the light value for a timeout at which the load was switched on when it occurred (default: 50 %).

- **Light value for timeout (off) (R38 [► 48])**

Here you can specify the light value for a timeout at which the load was switched off when it occurred (default: 0 %).

- **Dimmer mode (R39 [► 48])**

Here you can specify the dimmer mode:

- Automatic recognition*: The dimmer terminal automatically detects the type of load (capacitive/resistive or inductive) and switches to trailing edge phase control or leading edge phase control (default).
- Trailing edge control: typically used for capacitive loads (e.g. electronic ballasts) or ohmic loads (e.g. bulbs)
- Leading edge control: typically used for inductive loads (e.g. transformers, conventional ballasts)
- Rectifier, positive: only the positive half-wave is switched through to the load with leading edge phase control
Do not use this operation mode
- with firmware version [► 7] 2E of the KL2751 or
- with firmware version [► 7] 1E of the KL2761!
Instead, use the operation mode *Rectifier mode, negative* with these firmware versions!
- Rectifier, negative: only the negative half-wave is switched through to the load with leading edge phase control
- Zero switch (only KL2751/KL2761 from firmware version [► 7] 4E)

i *) Automatic recognition and long cable lengths

Manual preselection of the operation mode is recommended in the case of long cables between the dimmer terminal and the load.

Automatic load detection may fail, since inductive and capacitive line influences may lead to misinterpretation of the load.

- **Behavior after short circuit (R40 [► 48])**

Here you can define the behavior of the dimmer terminal following a short circuit on the load output. The dimmer terminal is equipped with short-circuit current limitation. The current is limited to approx. 10 A to 15 A. Normally triggering of the fuse is therefore prevented. The short circuit current flows for less than 0.5 ms and is switched on automatically.

- Remains switched off:
The user has to switch the system on again after a short circuit.
- Switch on again (default):
Following the detection of a short circuit, the dimmer terminal attempts to resume operation and tests the line with a low voltage. If the short circuit has been eliminated, the dimmer terminal returns to the previous dimmer value.

- **Mains frequency (R41 [► 48])**

Here you can set the dimmer terminal to your mains frequency, default: 50 Hz

5.5 Process data

The Status byte (Status), the Control byte (Ctrl) and the process data (Data) are displayed in a tree structure under *ProcData*.

Pos	Type	I-Address	Value	Bitsize	O-Address	Value	Bitsize
2	KL2751-0000						
	Channel 1						
	State	0.0	0x00	8			
	Data In	2.0	0x0000	16			
	Ctrl				0.0	0x00	8
	Data Out				2.0	0x0000	16

Fig. 23: *Process Data* field

The reading glasses mark the data that are currently graphically displayed in the *History* field.

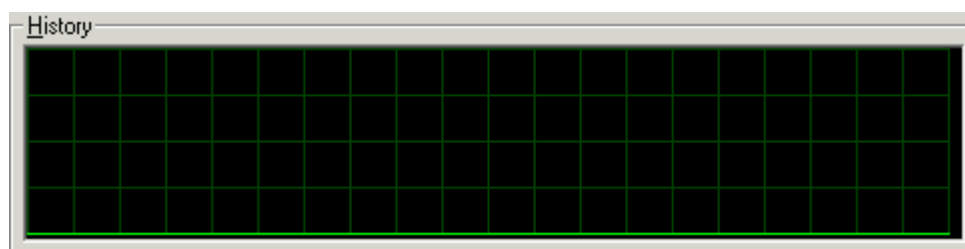


Fig. 24: *History* field

The current input values are displayed numerically in the *Value* field.

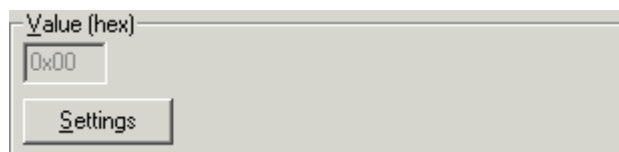


Fig. 25: *Value* field - display of the input value

Output values can be modified through direct input or by means of the fader control.

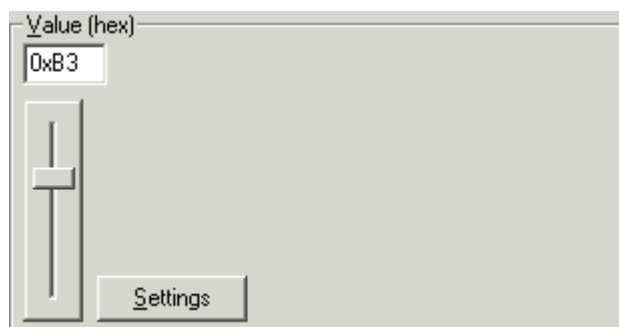


Fig. 26: *Value* field - modification of the output values

⚠ CAUTION

Danger for persons, the environment or devices!

Note that changing initial values (forcing them) can have a direct effect on your automation application. Only modify these initial values if you are certain that the state of your equipment permits it, and that there will be no risk to people or to the machine!

After pressing the *Settings* button you can set the format of the numerical display to hexadecimal, decimal or binary.

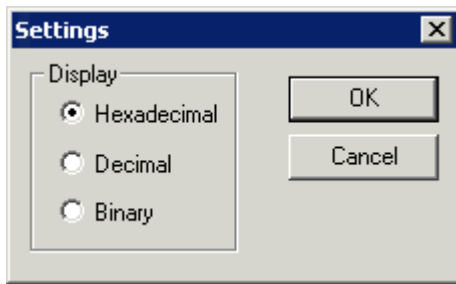


Fig. 27: Setting the display

6 Access from the user program

6.1 Process image

The KL2751 and KL2761 appear in the complex process image with 3 bytes of input data and 3 bytes of output data. These are organized as follows:

Byte offset (without word alignment)	Byte offset (with word alignment*)	Format	Input data	Output data
0	0	Byte	SB	CB
1	2	Word	DataIN	DataOUT

The KL2751 and KL2761 appear in the compact process image with no input data and 2 bytes of output data. These are organized as follows:

Byte offset (without word alignment)	Byte offset (with word alignment*)	Format	Input data	Output data
0	0	Word	-	DataOUT

*) Word alignment: The Bus Coupler places values on even byte addresses

Legend

SB: Status byte

CB: Control byte

DataIN: Input data word

DataOUT: Output data word

Process data

- **DataOUT**

In process data mode the output word DataOUT controls the output power of the dimmer terminal.

Valid values are 0_{dec} to 32767_{dec}.

- **DataIN**

In process data mode the input word DataIN contains the internal temperature of the dimmer terminal in degrees Celsius (KL2751/KS2751: only with firmware version 3B or higher)

6.2 Control and status bytes with diagnosis

This description applies to

- KL2751-0000 / KS2751-0000 with firmware versions 3B or higher
- KL2751-0011 / KS2751-0011 with firmware versions 3B or higher
- KL2761-0000 / KS2761-0000
- KL2761-0011 / KS2761-0011

6.2.1 Process data mode

Control byte (for process data mode)

The control byte (CB) is located in the [output image \[► 41\]](#), and is transmitted from the controller to the terminal.

Bit	CB1.7	CB1.6	CB1.5	CB1.4	CB1.3	CB1.2	CB1.1	CB1.0
Name	RegAccess	-	-	-	-	-	-	ManualAutoDetect

Key

Bit	Name	Description
CB17	RegAccess	0 _{bin} Register communication off (process data mode)
CB1.6 to CB1.1	-	0 _{bin} reserved
CB1.0	ManualAutoDetect	1 _{bin} manually start automatic load type detection (rising edge)

Status byte (for process data mode)

The status byte (SB) is located in the [input image \[► 41\]](#), and is transmitted from terminal to the controller.

Bit	SB1.7	SB1.6	SB1.5	SB1.4	SB1.3	SB1.2	SB1.1	SB1.0
Name	RegAccess	Error	Temperature warning	Overload	Operation mode			Synchronous

Key

Bit	Name	Description
SB1.7	RegAccess	0 _{bin} Acknowledgement for process data mode
SB1.6	Error	1 _{bin} A load-side short circuit was detected
SB1.5	Temperature warning	1 _{bin} Overtemperature detected (> 80 °C): the process data are limited to 20 % (the limit is reset automatically when the temperature falls below 60 °C)
SB1.4	Overload	1 _{bin} Overload detected (e.g. when switching higher loads on)
SB1.3 to SB1.1	Operation mode	manually set or automatically detected operation mode
		0 _{dec} automatic load type detection active
		1 _{dec} Trailing edge phase control
		2 _{dec} Leading edge phase control
		3 _{dec} Rectifier mode (positive half-wave with leading edge phase control)
		4 _{dec} Rectifier mode (negative half-wave with leading edge phase control)
		6 _{dec} Zero switch
SB1.0	Synchronous	0 _{bin} Terminal is not synchronized with the mains or a short circuit was detected on the load side
		1 _{bin} Terminal has synchronized itself with the mains*

6.2.2 Register communication

Control byte (for register communication)

The control byte (CB) is located in the output image [► 41], and is transmitted from the controller to the terminal.

Bit	CB1.7	CB1.6	CB1.5	CB1.4	CB1.3	CB1.2	CB1.1	CB1.0
Name	RegAccess	R/W	Reg. no.					

Key

Bit	Name	Description	
CB1.7	RegAccess	1 _{bin}	Register communication switched on
CB1.6	R/W	0 _{bin}	Read access
		1 _{bin}	Write access
CB1.5 to CB1.0	Reg. no.	Register number: Enter the number of the <u>register</u> [► 45] that you - want to read with input data word <u>DataIn</u> [► 41] or - want to write with output data word <u>DataOut</u> [► 41].	

Status byte (for register communication)

The status byte (SB) is located in the input image [► 41], and is transmitted from terminal to the controller.

Bit	SB1.7	SB1.6	SB1.5	SB1.4	SB1.3	SB1.2	SB1.1	SB1.0
Name	RegAccess	R/W	Reg. no.					

Key

Bit	Name	Description	
SB1.7	RegAccess	1 _{bin}	Acknowledgement for register access
SB1.6	R	0 _{bin}	Read access
SB1.5 to SB1.0	Reg. no.	Number of the register that was read or written.	

6.3 Control and status bytes without diagnosis

This description applies to

- KL2751-0000 / KS2751-0000 with firmware versions lower than 3B
- KL2751-0011 / KS2751-0011 with firmware versions lower than 3B

6.3.1 Process data mode

Control and status byte have no functionality in process data mode.

6.3.2 Register communication

Control byte (for register communication)

The control byte (CB) is located in the [output image \[► 41\]](#), and is transmitted from the controller to the terminal.

Bit	CB1.7	CB1.6	CB1.5	CB1.4	CB1.3	CB1.2	CB1.1	CB1.0
Name	RegAccess	R/W	Reg. no.					

Key

Bit	Name	Description	
CB1.7	RegAccess	1 _{bin}	Register communication switched on
CB1.6	R/W	0 _{bin}	Read access
		1 _{bin}	Write access
CB1.5 to CB1.0	Reg. no.	Register number: Enter the number of the register [► 45] that you • want to read with input data word DataIn [► 41] or • want to write with output data word DataOut [► 41].	

Status byte (for register communication)

The status byte (SB) is located in the [input image \[► 41\]](#), and is transmitted from terminal to the controller.

Bit	SB1.7	SB1.6	SB1.5	SB1.4	SB1.3	SB1.2	SB1.1	SB1.0
Name	RegAccess	R/W	Reg. no.					

Key

Bit	Name	Description	
SB1.7	RegAccess	1 _{bin}	Acknowledgement for register access
SB1.6	R	0 _{bin}	Read access
SB1.5 to SB1.0	Reg. no.	Number of the register that was read or written.	

6.4 Register overview

The registers are used for the parameterization of the dimmer terminal. They can be read or written by means of register communication.

Register no.	Comment		Default value		R/W	Memory
R0	reserved		-	-	-	-
...	...		...	...	...	...
R6	reserved		-	-	-	-
R7 [► 46]	Command register		0x0000	0 _{dec}	R/W	RAM
R8 [► 46]	Terminal type	KL2751-0000	0x0ABF	2751 _{dec}	R	ROM
		KL2751-0011				
		KL2761-0000	0x0AC9	2761 _{dec}		
		KL2761-0011				
R9 [► 46]	Firmware version		e.g. 0x3141	e.g. 1A _{ASCII}	R	ROM
R10	Multiplex shift register		0x0118	280 _{dec}	R	ROM
R11	Signal channels		0x0118	280 _{dec}	R	ROM
R12	Minimum data length		0x9800	38912 _{dec}	R	ROM
R13	Data structure		0x0004	4 _{dec}	R	ROM
R14	reserved		-	-	-	-
R15	Alignment register		0x7F80	32640 _{dec}	R/W	RAM
R16 [► 46]	Hardware version number		e.g. 0x0000	e.g. 0 _{dec}	R/W	EEPROM
R17	reserved		-	-	-	-
...	...		...	...	...	...
R28	reserved		-	-	-	-
R29	Terminal type, special version	KL2751-0000	0x0000	0 _{dec}	R	ROM
		KL2751-0011	0x000B	11 _{dec}		
		KL2761-0000	0x0000	0 _{dec}		
		KL2761-0011	0x000B	11 _{dec}		
R30	reserved		-	-	-	-
R31 [► 46]	Code word register		0x0000	0 _{dec}	R/W	RAM
R32 [► 47]	Feature register		0x0000	0 _{dec}	R/W	EEPROM
R33 [► 47]	User scaling - offset		0x0000	0 _{dec}	R/W	EEPROM
R34 [► 47]	User scaling - gain		0x0100	256 _{dec}	R/W	EEPROM
R35 [► 47]	Ramp time		0x0003	3 _{dec}	R/W	EEPROM
R36 [► 47]	Watchdog Timeout		0x000A	10 _{dec}	R/W	EEPROM
R37 [► 48]	Light value for timeout (on)		0x3FFF	16383 _{dec}	R/W	EEPROM
R38 [► 48]	Light value for timeout (off)		0x0000	0 _{dec}	R/W	EEPROM
R39 [► 48]	Dimmer mode		0x0000	0 _{dec}	R/W	EEPROM
R40 [► 48]	Behaviour after short circuit		0x0001	1 _{dec}	R/W	EEPROM
R41 [► 48]	Mains frequency	KL2751-0000	0x0000	0 _{dec} (50 Hz)	R/W	EEPROM
		KL2751-0011	0x0000	0 _{dec} (50 Hz)		
		KL2761-0000	0x0000	0 _{dec} (50 Hz)		
		KL2761-0011	0x0000	0 _{dec} (50 Hz)		
R42	reserved		-	-	-	-
...	...		...	...	...	...
R63	reserved		-	-	-	-

6.5 Register description

All registers can be read or written via register communication. They are used for the parameterization of the terminal.

Basic configuration is also possible via the PLC using the FB_KL27x1Config function block.

R7: Command register



User code word

For the following commands to be executed, it is first necessary for the user code word, 0x1235, to be entered into register R31 [► 46].

- **Command 0x7000: Restore Factory Default Settings**

Entering 0x7000 in register R7 restores the factory settings for the following registers:

R33: 0_{dec}

R34: 256_{dec}

R35: 3_{dec}

R36: 10_{dec}

R37: 16383_{dec}

R38: 0_{dec}

R39: 0_{dec}

R40: 1_{dec}

R41: 0_{dec} (KL2751-0000, KL2751-0011, KL2761-0000, KL2761-0011)

R8: Terminal type

The terminal identifier is contained in register R8: KL2751 or KL2761.

R9: Firmware version

Register R9 contains the ASCII coding of the terminal's firmware version, e.g. **0x3141** = **'1A'**. The **'0x31'** corresponds here to the ASCII character **'1'**, while the **'0x41'** represents the ASCII character **'A'**. This value cannot be changed.

R16: Hardware version number

Register R16 contains the hardware version of the terminal.

R29: Terminal type, special version

Register R29 contains the special version of the terminal.

R31: Code word register

If you write values into the user registers without first entering the user code word (0x1235) into the code word register, the terminal will not accept the supplied data. The code word is reset if the terminal is restarted.

R32: Feature register

The feature register specifies the terminal's configuration.

Bit	R32.15	R32.14	R32.13	R32.12	R32.11	R32.10	R32.9	R32.8
Name	-	-	-	-	-	-	-	-

Bit	R32.7	R32.6	R32.5	R32.4	R32.3	R32.2	R32.1	R32.0
Name	-	-	-	-	DimRamp	disWatchdog	-	enUserScale

Key

Bit	Name	Description	Default
R32.1 5 - R32.4	-	reserved	0 _{bin}
R32.3	DimRamp	0_{bin} Dimming ramp relative: The time in register R35 relates to the entire process data range (0_{dec} - 32767_{dec}). This means that the dimmer terminal requires this time to control from "off" (0_{dec}) to full scale control (32767_{dec}). 1_{bin} Dimming ramp absolute [► 37]: The time in register R35 relates to the current process data change. This means that the dimmer terminal requires this time in order to execute the current brightness change.	0 _{bin}
R32.2	disWatchdog	1 _{bin} Internal watchdog (time adjustable) deactivated	0 _{bin}
R32.1	-	reserved	0 _{bin}
R32.0	enUserScale	1 _{bin} User scaling active (see R33 [► 47]+ R34 [► 47])	0 _{bin}

R33: User scaling - offset

The offset of the user scaling when the user scaling (R32.0 [► 47]=1_{bin}) is enabled is entered in this register (default: 0).

R34: User scaling - gain

The gain of the user scaling when the user scaling (R32.0 [► 47]=1_{bin}) is enabled is entered in this register.

Example values:

128_{dec} = 0x80 = factor 0.5

256_{dec} = 0x100 = factor 1.0 (default)

512_{dec} = 0x200 = factor 2.0

R35: Ramp time

This register specifies the time required

- to ramp up from 0 to 32767 (full scale control of the angle) (when R32.3 = 0_{bin}) or
- to execute the current brightness change (when R32.3 = 1_{bin}).

0_{dec}: 50 ms

1_{dec}: 100 ms

2_{dec}: 200 ms

3_{dec}: 500 ms (default)

4_{dec}: 1 s

5_{dec}: 2 s

6_{dec}: 5 s

7_{dec}: 10 s

R36: Watchdog Timeout

This register specifies the timeout in the event of a fieldbus error. The unit is 10 ms (default: 10_{dec} = 100 ms).

R37: Light value for timeout (on)

This register specifies the light value that is output in the case of a fieldbus error and current process data > 0 (default: 16383_{dec}).

The unit is 1. (R32.2 [► 47] = 1_{bin}).

R38: Light value for timeout (off)

This register specifies the light value that is output in the case of a fieldbus error and current process data = 0 (default: 0_{dec}).

The unit is 1. (R32.2 [► 47] = 1_{bin}).

R39: Dimmer mode

This register specifies the dimmer mode:

0_{dec}: automatic detection (default)

1_{dec}: Trailing edge phase control

2_{dec}: Leading edge phase control

3_{dec}: Rectifier mode, positive (positive half-wave with leading edge phase control)

Do not use this operation mode

- with firmware version [► 7] 2E of the KL2751 or

- with firmware version [► 7] 1E of the KL2761!

Instead, use the operation mode *Rectifier mode, negative* with these firmware versions!

4_{dec}: Rectifier mode, negative (negative half-wave with leading edge phase control)

5_{dec}: reserved

6_{dec}: Zero switch (only KL2751/KL2761 from firmware version [► 7] 4E)

7_{dec}: reserved

R40: Behavior after short circuit

This register specifies the behavior after a short circuit:

0_{dec}: Remains switched off:

1_{dec}: switch on again (default):

R41: Mains frequency

This register specifies the mains frequency:

0_{dec}: 50 Hz

1_{dec}: 60 Hz

Default value: 50 Hz

6.6 Examples of Register Communication

The numbering of the bytes in the examples corresponds to the display without word alignment.

6.6.1 Example 1: Reading the firmware version from register 9

Output Data

Byte 0: Control byte	Byte 1: DataOUT1, high byte	Byte 2: DataOUT1, low byte
0x89 (1000 1001 _{bin})	0xXX	0xXX

Explanation:

- Bit 0.7 set means: Register communication switched on.
- Bit 0.6 not set means: reading the register.
- Bits 0.5 to 0.0 specify the register number 9 with 00 1001_{bin}.
- The output data word (byte 1 and byte 2) has no meaning during read access. To change a register, write the required value into the output word.

Input Data (answer of the Bus Terminal)

Byte 0: Status byte	Byte 1: DataIN1, high byte	Byte 2: DataIN1, low byte
0x89	0x33	0x41

Explanation:

- The terminal returns the value of the control byte as a receipt in the status byte.
- The terminal returns the firmware version 0x3341 in the input data word (byte 1 and byte 2). This is to be interpreted as an ASCII code:
 - ASCII code 0x33 represents the digit 3
 - ASCII code 0x41 represents the letter A
 The firmware version is thus 3A.

6.6.2 Example 2: Writing to an user register



Code word

In normal mode all user registers are read-only with the exception of Register 31. In order to deactivate this write protection you must write the code word (0x1235) into Register 31. If a value other than 0x1235 is written into Register 31, write protection is reactivated. Please note that changes to a register only become effective after restarting the terminal (power-off/power-on).

I. Write the code word (0x1235) into register 31.

Output Data

Byte 0: Control byte	Byte 1: DataOUT1, high byte	Byte 2: DataOUT1, low byte
0xDF (1101 1111 _{bin})	0x12	0x35

Explanation:

- Bit 0.7 set means: Register communication switched on.
- Bit 0.6 set means: writing to the register.
- Bits 0.5 to 0.0 specify the register number 31 with 01 1111_{bin}.
- The output data word (byte 1 and byte 2) contains the code word (0x1235) for deactivating write protection.

Input Data (answer of the Bus Terminal)

Byte 0: Status byte	Byte 1: DataIN1, high byte	Byte 2: DataIN1, low byte
0x9F (1001 1111 _{bin})	0xXX	0xXX

Explanation:

- The terminal returns a value as a receipt in the status byte that differs only in bit 0.6 from the value of the control byte.
- The input data word (byte 1 and byte 2) is of no importance after the write access. Any values still displayed are invalid!

II. Read Register 31 (check the set code word)**Output Data**

Byte 0: Control byte	Byte 1: DataOUT1, high byte	Byte 2: DataOUT1, low byte
0x9F (1001 1111 _{bin})	0xXX	0xXX

Explanation:

- Bit 0.7 set means: Register communication switched on.
- Bit 0.6 not set means: reading the register.
- Bits 0.5 to 0.0 specify the register number 31 with 01 1111_{bin}.
- The output data word (byte 1 and byte 2) has no meaning during read access.

Input Data (answer of the Bus Terminal)

Byte 0: Status byte	Byte 1: DataIN1, high byte	Byte 2: DataIN1, low byte
0x9F (1001 1111 _{bin})	0x12	0x35

Explanation:

- The terminal returns the value of the control byte as a receipt in the status byte.
- The terminal returns the current value of the code word register in the input data word (byte 1 and byte 2).

III. Write to Register 32 (change contents of the feature register)**Output data**

Byte 0: Control byte	Byte 1: DataIN1, high byte	Byte 2: DataIN1, low byte
0xE0 (1110 0000 _{bin})	0x00	0x02

Explanation:

- Bit 0.7 set means: Register communication switched on.
- Bit 0.6 set means: writing to the register.
- Bits 0.5 to 0.0 indicate register number 32 with 10 0000_{bin}.
- The output data word (byte 1 and byte 2) contains the new value for the feature register.

⚠ CAUTION**Observe the register description!**

The value of 0x0002 given here is just an example!

The bits of the feature register change the properties of the terminal and have a different meaning, depending on the type of terminal. Refer to the description of the feature register of your terminal (chapter *Register description*) regarding the meaning of the individual bits before changing the values.

Input data (response from the Bus Terminal)

Byte 0: Status byte	Byte 1: DataIN1, high byte	Byte 2: DataIN1, low byte
0xA0 (1010 0000 _{bin})	0xXX	0xXX

Explanation:

- The terminal returns a value as a receipt in the status byte that differs only in bit 0.6 from the value of the control byte.
- The input data word (byte 1 and byte 2) is of no importance after the write access. Any values still displayed are invalid!

IV. Read register 32 (check changed feature register)**Output Data**

Byte 0: Control byte	Byte 1: DataOUT1, high byte	Byte 2: DataOUT1, low byte
0xA0 (1010 0000 _{bin})	0xXX	0xXX

Explanation:

- Bit 0.7 set means: Register communication switched on.
- Bit 0.6 not set means: reading the register.
- Bits 0.5 to 0.0 indicate register number 32 with 10 0000_{bin}.
- The output data word (byte 1 and byte 2) has no meaning during read access.

Input Data (answer of the Bus Terminal)

Byte 0: Status byte	Byte 1: DataIN1, high byte	Byte 2: DataIN1, low byte
0xA0 (1010 0000 _{bin})	0x00	0x02

Explanation:

- The terminal returns the value of the control byte as a receipt in the status byte.
- The terminal returns the current value of the feature register in the input data word (byte 1 and byte 2).

V. Write register 31 (reset code word)**Output Data**

Byte 0: Control byte	Byte 1: DataOUT1, high byte	Byte 2: DataOUT1, low byte
0xDF (1101 1111 _{bin})	0x00	0x00

Explanation:

- Bit 0.7 set means: Register communication switched on.
- Bit 0.6 set means: writing to the register.
- Bits 0.5 to 0.0 specify the register number 31 with 01 1111_{bin}.
- The output data word (byte 1 and byte 2) contains 0x0000 for reactivating write protection.

Input Data (answer of the Bus Terminal)


Byte 0: Status byte	Byte 1: DataIN1, high byte	Byte 2: DataIN1, low byte
0x9F (1001 1111 _{bin})	0xXX	0xXX

Explanation:

- The terminal returns a value as a receipt in the status byte that differs only in bit 0.6 from the value of the control byte.

- The input data word (byte 1 and byte 2) is of no importance after the write access. Any values still displayed are invalid!

7 TwinCAT

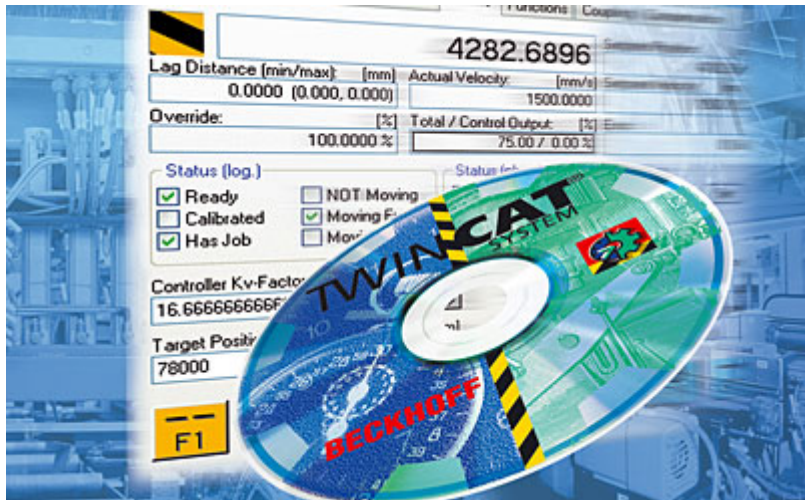

PLC and Motion Control on the PC

TwinCAT - The Windows Control and Automation Technology

The TwinCAT automation software converts any compatible PC into a real-time controller with multi-PLC, NC axis control, programming environment and operating station. TwinCAT replaces conventional PLC and NC controllers as well as operating devices:

- open, compatible PC hardware
- Embedding of IEC 61131-3 software PLC, software NC and software CNC in Windows
- Programming and runtime systems optionally together on one PC or separated
- Connection to all common fieldbus systems
- PC interfaces are supported
- Data communication with user interfaces and other programs by means of open Microsoft standards (OPC, OCX, DLL, etc.)

TwinCAT architecture

TwinCAT consists of runtime systems for real-time execution of control programs and development environments for programming, diagnosis and configuration. Any Windows programs, for instance visualization programs or Office programs, can access TwinCAT data via Microsoft interfaces, or can execute commands.

A practically oriented software solution

TwinCAT offers a precise time-base in which programs are executed with the highest deterministic features, independently of other processor tasks. The real-time load on a PC is set with TwinCAT: This achieves a defined operating behavior. TwinCAT displays the system load for running programs. A loading threshold can be set, in order to assure a defined computing capacity for the operating programs and for Windows. If this threshold is exceeded, a system message is generated.

TwinCAT supports system diagnosis

The general use of hardware and software from the open PC world requires some checking: Unsuitable components can upset the PC system. Beckhoff integrates a handy display of the real-time jitter in order to provide administrators with a simple means of evaluating hardware and software. A system message during operation can draw attention to error states.

Start/stop behavior

Depending on the setting, TwinCAT is started and stopped manually or automatically. Since TwinCAT is integrated into Windows as a service, an operator is not needed to start the system: switching on is enough.

Restarting and data backup

When a program is started or restarted, TwinCAT loads programs and remanent data. To backup data, and to shut down Windows correctly, a UPS (uninterruptible power supply) is of great value.

TwinCAT and "Blue Screen"

The TwinCAT system can be configured such that real-time capability is maintained in the event of a BSOD (Blue-Screen-of-Death) operating system crash. Real-time tasks such as PLC and NC can thus continue to run and place the controlled process in a safe state. Ultimately, it is the decision of the programmer whether or not to utilize this feature, bearing in mind that data or programs may already have been destroyed by the BSOD.

World-wide connection through message routing - "remote" connection is inherent to the system

According to the requirement for operating resources, the TwinCAT software devices can be distributed: TwinCAT PLC programs can be executed on PCs and on Beckhoff Bus Terminal controllers. A "message router" manages and distributes all the messages, both in the system and via TCP/IP connections. PC systems can be connected to one another by TCP/IP; Bus Terminal controllers are connected via serial interfaces and fieldbus systems (EtherCAT, Lightbus, PROFIBUS DP, PROFINET, Interbus, CANopen, DeviceNet, RS232, RS485, Ethernet TCP/IP, Ethernet/IP).

World-wide access

Since standard TCP/IP services from Windows are used, this data exchange can take place worldwide. The system offers scalable communication capacity and timeout periods for the monitoring of communications. OPC provides a standardized means for accessing many different SCADA packets. The SOAP (Simple Object Access Protocol) enables a connection between two computers to be established by means of an internet connection via standard HTTP. A TwinCAT component is available for this purpose.

Beckhoff Information System

Further information on the TwinCAT automation software can be found in the Beckhoff Information System.

The setup for installing the Beckhoff Information System is available to you on the Beckhoff *Products & Solutions* DVD and on our website for [download](#).

In addition, the online version of the Beckhoff Information System can be found at <https://infosys.beckhoff.com>.

7.1 TwinCAT libraries

TwinCAT libraries

See software documentation in the Beckhoff Information System.

TwinCAT 2: TwinCAT PLC Lib: [TcIoFunctions](#)

TwinCAT 3: TwinCAT 3 PLC Lib: [Tc2_IoFunctions](#)

7.2 FB_KL27x1Config function block

The KL2751 and KL2761 terminals can be configured using the FB-KL27x1Config function block. A detailed description can be found in the Beckhoff Information System:

TwinCAT2: [TwinCAT PLC Lib: IO functions/Bus Terminal configuration](#)

TwinCAT3: [TwinCAT 3 PLC Lib:Tc2_IoFunctions/Function blocks/Bus Terminal configuration](#)

7.3 FB_Dimmer1SwitchEco function block

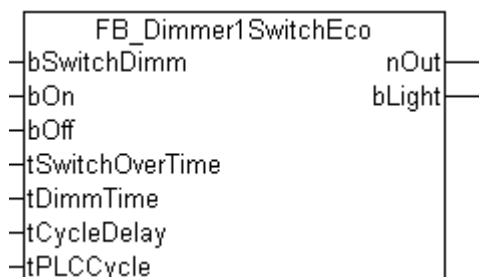


Fig. 28: FB_Dimmer1SwitchEco

Description

The *FB_Dimmer1SwitchEco* block is a variant of *FB_Dimmer1Switch* that saves memory space. It lacks the special functions *Set brightness value* and *Disable memory function*, which may not be required for many applications. Moreover, the values *nOutMin* and *nOutMax* of the *FB_Dimmer1Switch* are set internally here to 0 and 32767 respectively. This output span corresponds to the display range of an analog output terminal. The *tPLCCycle* input is important. This time is used to calculate internally the amount by which the *nOut* output must be increased per cycle - that saves additional time calculations.

Operating by means of the *bSwitchDimm* input

The light is switched on or off by a short signal at the *bSwitchDimm* input. Dimmer mode will be activated if the signal remains for longer than *tSwitchOverTime* (typical recommended value: 200 ms). The output signal moves cyclically between 0 and 32767. In order to be able to better adjust the maximum or minimum value, the output signal dwells at the minimum or maximum value for the time *tCycleDelay*. When the signal is once more removed, the output signal being generated at that time is retained. Another pulse at the input will set the output to 0.

Operation by means of the *bOn* and *bOff* inputs

The light is immediately switched on or off if a rising edge is applied to the *bOn* or *bOff* inputs. For example, for global on/off functions. The output value is set to 0 when switching off.

Memory function

Unlike *FB_Dimmer1Switch*, in which the memory function can be activated or deactivated via the *bMemoryModeOn* input, the memory function is always active in this version for saving memory space. This means that the last-set value is adopted as the brightness value when switching on. It is irrelevant, in this case, whether the light has been switched on by means of the *bOn* input or the *bSwitchDimm* input.

Comment on the *tSwitchOverTime* parameter

If a duration of 0 is specified for the parameter *tSwitchOverTime*, the *bSwitchDimm* input can only be used to dim the light. Switching on and off is only possible with the *bOn* and *bOff* inputs.

VAR_INPUT

```
bSwitchDimm      : BOOL;
bOn               : BOOL;
bOff              : BOOL;
tSwitchOverTime   : TIME;
tDimmTime         : TIME;
tCycleDelay       : TIME;
tPLCCycle         : TIME;
```

bSwitchDimm: Switches or dims the output.

bOn: Switches the output to the last output value, or to the value specified by *nOnValueWithoutMemoryMode*.

bOff: Switches the output to 0.

tSwitchOverTime: Time for switching between the light on/off and dimming functions for the *bSwitchDimm* input.

tDimmTime Time required for dimming to go from its minimum value to its maximum value.

tCycleDelay: Delay time, if either the minimum or maximum value is reached.

tPLCCycle: the set PLC cycle time.

VAR_OUTPUT

```
nOut             : UINT;
bLight           : BOOL;
```

nOut: analog output value.

bLight: digital output value. This is set if *nOut* is greater than 0.

Download

Click on the following symbol to download the file with the FB_Dimmer1SwitchEco function block from this documentation.



https://infosys.beckhoff.com/content/1033/kl2751_kl2761/Resources/3472922123.zip
FB_Dimmer1SwitchEco.exp.zip

Save the FB_Dimmer1SwitchEco.exp file contained in this zip file on your PC.



Importing a function block

The import of a function block into your TwinCAT system is described in the chapter [Importing a function block](#) [► 57].

7.4 Importing a function block

To import a function block into your TwinCAT, click on the menu item *Project/Import* in the TwinCAT PLC Control.

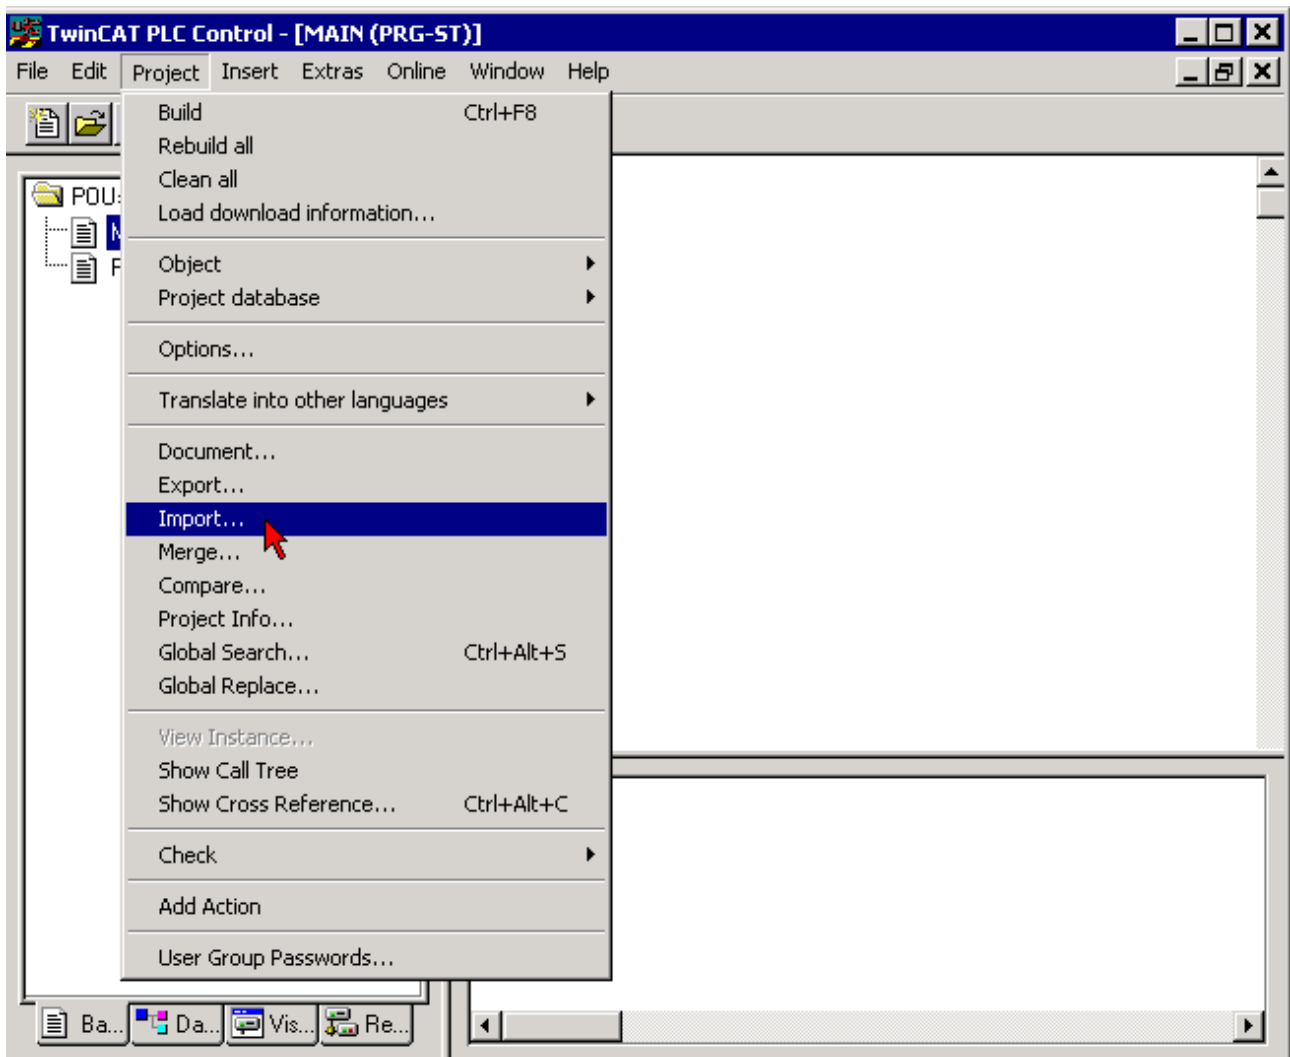


Fig. 29: Importing a function block into TwinCAT PLC

Select the folder in which you have saved the exp file (DB_Dimmer1SwitchEco.exp in the example), select the file and click on the Open button.

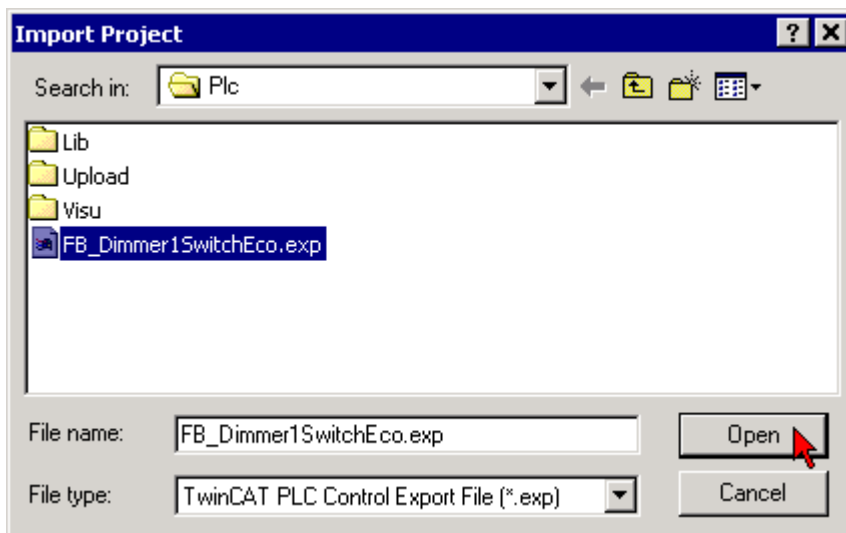


Fig. 30: *Import Project* dialog

Following successful import the PC Control reports *Import complete*.

8 Appendix

8.1 Support and Service

Beckhoff and their partners around the world offer comprehensive support and service, making available fast and competent assistance with all questions related to Beckhoff products and system solutions.

Beckhoff's branch offices and representatives

Please contact your Beckhoff branch office or representative for local support and service on Beckhoff products!

The addresses of Beckhoff's branch offices and representatives round the world can be found on her internet pages: www.beckhoff.com

You will also find further documentation for Beckhoff components there.

Support

The Beckhoff Support offers you comprehensive technical assistance, helping you not only with the application of individual Beckhoff products, but also with other, wide-ranging services:

- support
- design, programming and commissioning of complex automation systems
- and extensive training program for Beckhoff system components

Hotline: +49 5246 963 157
e-mail: support@beckhoff.com
web: www.beckhoff.com/support

Service

The Beckhoff Service Center supports you in all matters of after-sales service:

- on-site service
- repair service
- spare parts service
- hotline service

Hotline: +49 5246 963 460
e-mail: service@beckhoff.com
web: www.beckhoff.com/service

Headquarters Germany

Beckhoff Automation GmbH & Co. KG

Hülshorstweg 20
33415 Verl
Germany

Phone: +49 5246 963 0
e-mail: info@beckhoff.com
web: www.beckhoff.com

Table of figures

Fig. 1	KL2751 - Universal dimmer terminals, 230 VAC, 300 VA.....	9
Fig. 2	KL2761 - Universal dimmer terminals, 230 VAC, 600 VA.....	10
Fig. 3	KL2751, KL2761	11
Fig. 4	KL2751, KL2761 - LED displays	13
Fig. 5	Spring contacts of the Beckhoff I/O components	14
Fig. 6	Attaching on mounting rail.....	15
Fig. 7	Power contact on left side	16
Fig. 8	Disassembling of terminal	17
Fig. 9	Recommended distances for standard installation position	18
Fig. 10	Other installation positions	19
Fig. 11	Standard wiring	20
Fig. 12	Pluggable wiring.....	20
Fig. 13	High Density Terminals	21
Fig. 14	Connecting a cable on a terminal point.....	22
Fig. 15	Contact assignment taking KL2751 as an example	24
Fig. 16	KL2751 - Application example	30
Fig. 17	KL2751-0011 - Application example	31
Fig. 18	KS2000 configuration software	32
Fig. 19	Display of the fieldbus station in KS2000.....	34
Fig. 20	KS2000 tree branches for channel 1 of the KL2535	35
Fig. 21	Register view in KS2000	36
Fig. 22	Settings via KS2000.....	37
Fig. 23	Process Data field	39
Fig. 24	History field	39
Fig. 25	Value field - display of the input value.....	39
Fig. 26	Value field - modification of the output values.....	39
Fig. 27	Setting the display.....	40
Fig. 28	FB_Dimmer1SwitchEco	55
Fig. 29	Importing a function block into TwinCAT PLC.....	57
Fig. 30	Import Project dialog	58

Trademark statements

Beckhoff®, ATRO®, EtherCAT®, EtherCAT G®, EtherCAT G10®, EtherCAT P®, MX-System®, Safety over EtherCAT®, TC/BSD®, TwinCAT®, TwinCAT/BSD®, TwinSAFE®, XFC®, XPlanar® and XTS® are registered and licensed trademarks of Beckhoff Automation GmbH.

Third-party trademark statements

DeviceNet and EtherNet/IP are trademarks of ODVA, Inc.

Microsoft, Microsoft Azure, Microsoft Edge, PowerShell, Visual Studio, Windows and Xbox are trademarks of the Microsoft group of companies.

More Information:
www.beckhoff.com/KL2xxx

Beckhoff Automation GmbH & Co. KG
Hülshorstweg 20
33415 Verl
Germany
Phone: +49 5246 9630
info@beckhoff.com
www.beckhoff.com

