BECKHOFF New Automation Technology

Documentation | EN

EL3204-0162

4 Channel Analog Input Terminal, 2 x RTD (Pt100) and 2 x -10 V...+10 V, 12 bit, single-ended



Table of contents

1	Over	view Analog Input Terminals Multifunction	5
2	Fore	word	6
	2.1	Notes on the documentation	6
	2.2	Guide through documentation	7
	2.3	Safety instructions	8
	2.4	Documentation issue status	9
	2.5	Version identification of EtherCAT devices	10
		2.5.1 General notes on marking	10
		2.5.2 Version identification of EL terminals	11
		2.5.3 Beckhoff Identification Code (BIC)	12
		2.5.4 Electronic access to the BIC (eBIC)	14
3	Prod	uct description	16
	3.1	EL3204-0162 - Introduction	16
	3.2	EL3204-0162 - Technical data	17
	3.3	EL3204-0162 - LEDs and connection	18
	3.4	Technology	20
		3.4.1 Measuring principle of a resistance sensor	21
		3.4.2 2-wire connection technology	22
		3.4.3 Overview of suitable resistance sensors	23
	3.5	Start	24
4	Basio	cs communication	25
	4.1	EtherCAT basics	25
	4.2	EtherCAT cabling – wire-bound	25
	4.3	General notes for setting the watchdog	27
	4.4	EtherCAT State Machine	28
	4.5	CoE Interface	30
	4.6	Distributed Clock	35
5	Mour	nting and wiring	36
	5.1	Instructions for ESD protection	
	5.2	Installation on mounting rails	37
	5.3	Connection	40
		5.3.1 Connection system	40
		5.3.2 Wiring	42
		5.3.3 Shielding	43
	5.4	Note - power supply	44
	5.5	Positioning of passive Terminals	45
	5.6	Installation positions	46
	5.7	Disposal	48
6	Com	missioning	49
	6.1	TwinCAT Quick Start	49
		6.1.1 TwinCAT 2	52
		6.1.2 TwinCAT 3	62
	6.2	TwinCAT Development Environment	76

		6.2.1	Installation of the TwinCAT real-time driver	76
		6.2.2	Notes regarding ESI device description	82
		6.2.3	TwinCAT ESI Updater	86
		6.2.4	Distinction between Online and Offline	86
		6.2.5	OFFLINE configuration creation	87
		6.2.6	ONLINE configuration creation	92
		6.2.7	EtherCAT subscriber configuration	100
		6.2.8	Import/Export of EtherCAT devices with SCI and XTI	. 110
	6.3	General	Commissioning Instructions for an EtherCAT Slave	. 117
	6.4	Settings	and application notes	125
		6.4.1	Default setting	125
		6.4.2	Changing the slave parameters in the CoE directory	126
		6.4.3	Further application notes	. 127
	6.5	Process	data and operation modes	128
		6.5.1	Sync Manager	128
		6.5.2	Operation modes and settings (RTD channels)	129
		6.5.3	Operation modes and settings (AI channels)	134
		6.5.4	Producer Codeword	138
		6.5.5	Interference from equipment	138
	6.6	Status w	vord	139
	6.7	Object d	lescription and parameterization	143
		6.7.1	Restore object	143
		6.7.2	Configuration data	144
		6.7.3	Input data	150
		6.7.4	Output data	152
		6.7.5	Information and diagnostic data	153
		6.7.6	Manufacturer configuration data	154
		6.7.7	Standard objects	155
7	Appe	ndix		162
	7.1		e compatibility	
	7.2		e Update EL/ES/EM/ELM/EP/EPP/ERPxxxx	
		7.2.1	Device description ESI file/XML	. 164
		7.2.2	Firmware explanation	
		7.2.3	Updating controller firmware *.efw	168
		7.2.4	FPGA firmware *.rbf	170
		7.2.5	Simultaneous updating of several EtherCAT devices	. 174
	7.3	Restorin	g the delivery state	
	7.4	Support	and Service	. 177

1 Overview Analog Input Terminals Multifunction

EL3204-0162 [▶_16]

EL3204-0162 - 4 Channel Analog Input Terminal, 2 x RTD (Pt100) and 2 x -10 V...+10 V, 12-bit, single-ended

2 Foreword

2.1 Notes on the documentation

Intended audience

This description is only intended for the use of trained specialists in control and automation engineering who are familiar with the applicable national standards.

It is essential that the documentation and the following notes and explanations are followed when installing and commissioning these components.

The qualified personnel is obliged to always use the currently valid documentation.

The responsible staff must ensure that the application or use of the products described satisfy all the requirements for safety, including all the relevant laws, regulations, guidelines and standards.

Disclaimer

The documentation has been prepared with care. The products described are, however, constantly under development.

We reserve the right to revise and change the documentation at any time and without prior announcement.

No claims for the modification of products that have already been supplied may be made on the basis of the data, diagrams and descriptions in this documentation.

Trademarks

Beckhoff[®], TwinCAT[®], TwinCAT/BSD[®], TC/BSD[®], EtherCAT[®], EtherCAT G[®], EtherCAT G10[®], EtherCAT P[®], Safety over EtherCAT[®], TwinSAFE[®], XFC[®], XTS[®] and XPlanar[®] are registered trademarks of and licensed by Beckhoff Automation GmbH. Other designations used in this publication may be trademarks whose use by third parties for their own purposes could violate the rights of the owners.

Patent Pending

The EtherCAT Technology is covered, including but not limited to the following patent applications and patents: EP1590927, EP1789857, EP1456722, EP2137893, DE102015105702 with corresponding applications or registrations in various other countries.



EtherCAT[®] is registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany.

Copyright

© Beckhoff Automation GmbH & Co. KG, Germany.

The reproduction, distribution and utilization of this document as well as the communication of its contents to others without express authorization are prohibited.

Offenders will be held liable for the payment of damages. All rights reserved in the event of the grant of a patent, utility model or design.

2.2 Guide through documentation



Further components of documentation

This documentation describes device-specific content. It is part of the modular documentation concept for Beckhoff I/O components. For the use and safe operation of the device / devices described in this documentation, additional cross-product descriptions are required, which can be found in the following table.

Title	Description
EtherCAT System Documentation (PDF)	System overview
	EtherCAT basics
	Cable redundancy
	Hot Connect
	EtherCAT devices configuration
I/O Analog Manual (PDF)	Notes on I/O components with analog in and outputs
Infrastructure for EtherCAT/Ethernet (PDF)	Technical recommendations and notes for design, implementation and testing
Software Declarations I/O (PDF)	Open source software declarations for Beckhoff I/O components

NOTICE

The documentations can be viewed at and downloaded from the Beckhoff website (www.beckhoff.com) via:

- the "Documentation and Download" area of the respective product page,
- the Download finder,
- the <u>Beckhoff Information System</u>.

2.3 Safety instructions

Safety regulations

Please note the following safety instructions and explanations! Product-specific safety instructions can be found on following pages or in the areas mounting, wiring, commissioning etc.

Exclusion of liability

All the components are supplied in particular hardware and software configurations appropriate for the application. Modifications to hardware or software configurations other than those described in the documentation are not permitted, and nullify the liability of Beckhoff Automation GmbH & Co. KG.

Personnel qualification

This description is only intended for trained specialists in control, automation and drive engineering who are familiar with the applicable national standards.

Signal words

The signal words used in the documentation are classified below. In order to prevent injury and damage to persons and property, read and follow the safety and warning notices.

Personal injury warnings

Hazard with high risk of death or serious injury.						
Hazard with medium risk of death or serious injury.						
There is a low-risk hazard that could result in medium or minor injury.						

Warning of damage to property or environment

NOTICE

The environment, equipment, or data may be damaged.

Information on handling the product



This information includes, for example:

recommendations for action, assistance or further information on the product.

2.4 Documentation issue status

Version	Comment
1.1.0	 Update chapter "LED and connection"
	Update structure
1.0	Amendments
	First release
0.6	Amendments
0.5	Amendments
0.4	Migration
0.3	Amendments
0.2	Amendments
0.1	Provisional documentation for EL3204-0162

2.5 Version identification of EtherCAT devices

2.5.1 General notes on marking

Designation

A Beckhoff EtherCAT device has a 14-digit designation, made up of

- · family key
- type
- version
- revision

Example	Family	Туре	Version	Revision
EL3314-0000-0016	EL terminal 12 mm, non-pluggable connection level	3314 4-channel thermocouple terminal	0000 basic type	0016
ES3602-0010-0017	ES terminal 12 mm, pluggable connection level	3602 2-channel voltage measurement	0010 high-precision version	0017
CU2008-0000-0000	CU device	2008 8-port fast ethernet switch	0000 basic type	0000

Notes

- The elements mentioned above result in the **technical designation**. EL3314-0000-0016 is used in the example below.
- EL3314-0000 is the order identifier, in the case of "-0000" usually abbreviated to EL3314. "-0016" is the EtherCAT revision.
- The order identifier is made up of
 - family key (EL, EP, CU, ES, KL, CX, etc.)
 - type (3314)
 - version (-0000)
- The **revision** -0016 shows the technical progress, such as the extension of features with regard to the EtherCAT communication, and is managed by Beckhoff.

In principle, a device with a higher revision can replace a device with a lower revision, unless specified otherwise, e.g. in the documentation.

Associated and synonymous with each revision there is usually a description (ESI, EtherCAT Slave Information) in the form of an XML file, which is available for download from the Beckhoff web site. From 2014/01 the revision is shown on the outside of the IP20 terminals, see Fig. *"EL2872 with revision 0022 and serial number 01200815"*.

• The type, version and revision are read as decimal numbers, even if they are technically saved in hexadecimal.

2.5.2 Version identification of EL terminals

The serial number/ data code for Beckhoff IO devices is usually the 8-digit number printed on the device or on a sticker. The serial number indicates the configuration in delivery state and therefore refers to a whole production batch, without distinguishing the individual modules of a batch.

Structure of the serial number: KK YY FF HH

- KK week of production (CW, calendar week)
- YY year of production
- FF firmware version

BECKHOFF

HH - hardware version



Fig. 1: EL2872 with revision 0022 and serial number 01200815

Example with serial number 12 06 3A 02:

- 12 production week 12
- 06 production year 2006
- 3A firmware version 3A
- 02 hardware version 02

2.5.3 Beckhoff Identification Code (BIC)

The Beckhoff Identification Code (BIC) is increasingly being applied to Beckhoff products to uniquely identify the product. The BIC is represented as a Data Matrix Code (DMC, code scheme ECC200), the content is based on the ANSI standard MH10.8.2-2016.



Fig. 2: BIC as data matrix code (DMC, code scheme ECC200)

The BIC will be introduced step by step across all product groups.

Depending on the product, it can be found in the following places:

- · on the packaging unit
- directly on the product (if space suffices)
- on the packaging unit and the product

The BIC is machine-readable and contains information that can also be used by the customer for handling and product management.

Each piece of information can be uniquely identified using the so-called data identifier (ANSI MH10.8.2-2016). The data identifier is followed by a character string. Both together have a maximum length according to the table below. If the information is shorter, spaces are added to it.

Following information is possible, positions 1 to 4 are always present, the other according to need of production:

Posi- tion	Type of information	Explanation	Data identifier	Number of digits incl. data identifier	Example
1	Beckhoff order number	Beckhoff order number	1P	8	1P072222
2	Beckhoff Traceability Number (BTN)	Unique serial number, see note below	SBTN	12	SBTNk4p562d7
3	Article description	Beckhoff article description, e.g. EL1008	1K	32	1KEL1809
4	Quantity	Quantity in packaging unit, e.g. 1, 10, etc.	Q	6	Q1
5	Batch number	Optional: Year and week of production	2P	14	2P401503180016
6	ID/serial number	Optional: Present-day serial number system, e.g. with safety products	51S	12	<mark>51S</mark> 678294
7	Variant number	Optional: Product variant number on the basis of standard products	30P	32	<mark>30P</mark> F971, 2*K183

Further types of information and data identifiers are used by Beckhoff and serve internal processes.

Structure of the BIC

Example of composite information from positions 1 to 4 and with the above given example value on position 6. The data identifiers are highlighted in bold font:

1P072222SBTNk4p562d71KEL1809 Q1 51S678294

Accordingly as DMC:



Fig. 3: Example DMC 1P072222SBTNk4p562d71KEL1809 Q1 51S678294

BTN

An important component of the BIC is the Beckhoff Traceability Number (BTN, position 2). The BTN is a unique serial number consisting of eight characters that will replace all other serial number systems at Beckhoff in the long term (e.g. batch designations on IO components, previous serial number range for safety products, etc.). The BTN will also be introduced step by step, so it may happen that the BTN is not yet coded in the BIC.

NOTICE

This information has been carefully prepared. However, the procedure described is constantly being further developed. We reserve the right to revise and change procedures and documentation at any time and without prior notice. No claims for changes can be made from the information, illustrations and descriptions in this documentation.

2.5.4 Electronic access to the BIC (eBIC)

Electronic BIC (eBIC)

The Beckhoff Identification Code (BIC) is applied to the outside of Beckhoff products in a visible place. If possible, it should also be electronically readable.

The interface that the product can be electronically addressed by is crucial for the electronic readout.

K-bus devices (IP20, IP67)

Currently, no electronic storage or readout is planned for these devices.

EtherCAT devices (IP20, IP67)

All Beckhoff EtherCAT devices have an ESI-EEPROM which contains the EtherCAT identity with the revision number. The EtherCAT slave information, also colloquially known as the ESI/XML configuration file for the EtherCAT master, is stored in it. See the corresponding chapter in the EtherCAT system manual (Link) for the relationships.

Beckhoff also stores the eBIC in the ESI-EEPROM. The eBIC was introduced into Beckhoff IO production (terminals, box modules) in 2020; as of 2023, implementation is largely complete.

The user can electronically access the eBIC (if present) as follows:

- With all EtherCAT devices, the EtherCAT master (TwinCAT) can read the eBIC from the ESI-EEPROM
 - From TwinCAT 3.1 build 4024.11, the eBIC can be displayed in the online view.
 - $\circ~$ To do this, check the "Show Beckhoff Identification Code (BIC)" checkbox under EtherCAT \rightarrow Advanced Settings \rightarrow Diagnostics:

TwinCAT F	TwinCAT Project30 🤏 🗙												
General	Adapter	EtherCAT Online	CoE - C	nline									
NetId:					Advanced S Export Configu Sync Unit As Topolo	ration File		Advanced Settings State Machine Cyclic Frames Distributed Clocks EoE Support Redundancy	Online View 0000 'ESC Rev/Type' 0002 'ESC Build' 0004 'SM/FMNU Cnt' 0005 Ponts/OPRAM'	^	0000 Add		
Fram 0 0	e Cmd LWR BRD	Addr 0x01000000 0x0000 0x0130	Len 1 2	WC 1 2	Sync Unit <default></default>	Cycle (ms) 4.000 4.000	Utilizatio 0.17 0.17	Emergency Diagnosis Online View	0000 Features' 0010 Phys Add' 0012 Configured Station Alias' 0020 Register Protect' 0030 'Access Protect' 0040 'ESC reset' 0100 'ESC Crif 0102 'ESC Crif 0102 'ESC Crif 0102 'ESC Crif 0102 'ESC Crif 0103 'Phys. RW Offset' 0110 'ESC Status'		(State Changes / Not Present) ✓ Show Production Info ✓ Show Beckhoff Identification Code(BIC)		

• The BTN and its contents are then displayed:

General	Adapte	er	EtherCAT Online	CoE - Onli	ne									
No	Ad	dr	Name	State	CRC	Fw	Hw	Production Data	ItemNo	BTN	Description	Quantity	BatchNo	SerialNo
1 📓	10	01	Term 1 (EK1100)	OP	0,0	0	0	-						
2	2 10	02	Term 2 (EL1018)	OP	0,0	0	0	2020 KW36 Fr	072222	k4p562d7	EL1809	1		678294
- 3	3 10	03	Term 3 (EL3204)	OP	0,0	7	6	2012 KW24 Sa						
- 4	10	04	Term 4 (EL2004)	OP	0,0	0	0		072223	k4p562d7	EL2004	1		678295
- 5	5 10	05	Term 5 (EL1008)	OP	0,0	0	0							
- 6		06	Term 6 (EL2008)	OP	0, 0	0	12	2014 KW14 Mo						
- 7	7 10	07	Term 7 (EK1110)	OP	0	1	8	2012 KW25 Mo						

- Note: As shown in the figure, the production data HW version, FW version, and production date, which have been programmed since 2012, can also be displayed with "Show production info".
- Access from the PLC: From TwinCAT 3.1. build 4024.24, the functions *FB_EcReadBIC* and *FB_EcReadBTN* for reading into the PLC are available in the Tc2_EtherCAT library from v3.3.19.0.
- EtherCAT devices with a CoE directory may also have the object 0x10E2:01 to display their own eBIC, which can also be easily accessed by the PLC:

• The device must be in PREOP/SAFEOP/OP for access:

Inc	dex	Name	Flags	Value		
	1000	Device type	RO	0x015E1389 (22942601)		
	1008	Device name	RO	ELM3704-0000		
	1009	Hardware version	RO	00		
	100A	Software version	RO	01		
	1008	Bootloader version	RO	J0.1.27.0		
۲	1011:0	Restore default parameters	RO	>1<		
•	1018:0	Identity	RO	>4<		
8	10E2:0	Manufacturer-specific Identification C	RO	>1<		
	10E2:01	SubIndex 001	RO	1P158442SBTN0008jekp1KELM3704	Q1	2P482001000016
٠	10F0:0	Backup parameter handling	RO	>1<		
+	10F3:0	Diagnosis History	RO	>21 <		
	10F8	Actual Time Stamp	RO	0x170bfb277e		

- The object 0x10E2 will be preferentially introduced into stock products in the course of necessary firmware revision.
- From TwinCAT 3.1. build 4024.24, the functions *FB_EcCoEReadBIC* and *FB_EcCoEReadBTN* for reading into the PLC are available in the Tc2_EtherCAT library from v3.3.19.0
- The following auxiliary functions are available for processing the BIC/BTN data in the PLC in *Tc2_Utilities* as of TwinCAT 3.1 build 4024.24
 - F_SplitBIC: The function splits the Beckhoff Identification Code (BIC) sBICValue into its components using known identifiers and returns the recognized substrings in the ST_SplittedBIC structure as a return value
 - BIC_TO_BTN: The function extracts the BTN from the BIC and returns it as a return value
- Note: If there is further electronic processing, the BTN is to be handled as a string(8); the identifier "SBTN" is not part of the BTN.
- · Technical background

The new BIC information is written as an additional category in the ESI-EEPROM during device production. The structure of the ESI content is largely dictated by the ETG specifications, therefore the additional vendor-specific content is stored using a category in accordance with the ETG.2010. ID 03 tells all EtherCAT masters that they may not overwrite these data in the event of an update or restore the data after an ESI update.

The structure follows the content of the BIC, see here. The EEPROM therefore requires approx. 50..200 bytes of memory.

- Special cases
 - If multiple hierarchically arranged ESCs are installed in a device, only the top-level ESC carries the eBIC information.
 - If multiple non-hierarchically arranged ESCs are installed in a device, all ESCs carry the eBIC information.
 - If the device consists of several sub-devices which each have their own identity, but only the toplevel device is accessible via EtherCAT, the eBIC of the top-level device is located in the CoE object directory 0x10E2:01 and the eBICs of the sub-devices follow in 0x10E2:nn.

PROFIBUS; PROFINET, and DeviceNet devices

Currently, no electronic storage or readout is planned for these devices.

3 Product description

3.1 EL3204-0162 - Introduction

4-channel analog input terminals 2x Pt100 (RTD) and 2x -10 V...+10 V, 12-bit, single ended

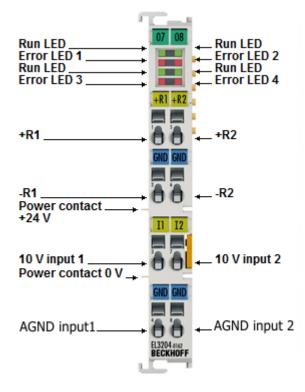


Fig. 4: EL3204-0162

The EL3204-0162 analog input terminal permits the direct connection of resistance sensors for temperature measurement on two channels and at the same time the connection of two 10 V signals on two further channels.

The EtherCAT Terminal circuitry can operate 2-wire sensors. A microprocessor handles linearization across the whole temperature range, which is freely selectable. Sensor faults (e.g. wire break) are indicated by error LEDs.

Quick links

- EtherCAT basics
- <u>Technology</u> [▶ 20]
- Creation of the configuration TwinCAT [) 49]
- CoE object description and parameterization [▶ 143]
- <u>Status word [▶ 139]</u>
- Process data and operation modes [▶ 128]
- <u>Settings and application notes [▶ 125]</u>

3.2 EL3204-0162 - Technical data

Technical data	EL3204-0162
Number of inputs	2 x PT100, 2 x -10 V+10 V
Signal voltage	-10/0 V+10 V
Internal resistance	Voltage measurement: 240 kohm typ.
Input filter cut-off frequency	typ. 1 kHz
Sensor types	Pt100, Pt200, Pt500, Pt1000, Ni100, Ni120, Ni1000 KT/KTY, resistance measurement 10 Ω 1 k Ω or 10 Ω 4 k Ω (e.g. for potentiometer connection)
Connection technology	2-wire
Temperature range	Range-dependent: -200+850 °C (Pt sensors); -60+250 °C (Ni sensors)
Resolution	RTD measurement: 0.1 °C or 0.01 °C per digit,
	Voltage measurement: 12-bit (16-bit representation incl. sign)
Sampling type	Multiplex
Ground reference	Single-Ended
Conversion time	RTD measurement: 85 ms preset, 2 ms800 ms configurable,
	Voltage measurement: 0.625 ms preset, configurable, multiplex
Measuring current	< 0.5 mA (load-dependent)
Measuring error	RTD measurement: < ± 0.5 °C for PT sensors,
	Voltage measurement: < ±0.3 % (relative to full scale value)
Width in the process image	max. 16 bytes input
Power supply for the electronics	via the E-bus
Current consumption via E-bus	typ. 130 mA
Dielectric strength	max. 30 V
Electrical isolation	500 V (E-bus/field voltage)
Configuration	via TwinCAT System Manager
Weight	approx. 60 g
Permissible ambient temperature range during operation	0 °C +55 °C
Permissible ambient temperature range during storage	-25 °C +85 °C
Permissible relative air humidity	95 %, no condensation
Dimensions (W x H x D)	approx. 15 mm x 100 mm x 70 mm (width aligned: 12 mm)
Assembly [▶_37]	on 35 mm mounting rail conforms to EN 60715
Vibration / shock resistance	conforms to EN 60068-2-6 / EN 60068-2-27
EMC immunity / emission	conforms to EN 61000-6-2 / EN 61000-6-4
Protection rating	IP20
Installation position	variable
Approvals/markings*)	CE, EAC, UKCA

*) Real applicable approvals/markings see type plate on the side (product marking).

3.3 EL3204-0162 - LEDs and connection

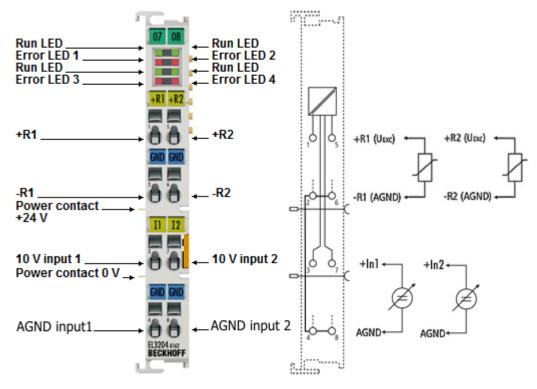


Fig. 5: EL3204-0162 connection

Connection

Terminal point			Internally connected to	Max. Current carrying capac- ity *)
+R1	1	Input +R1	-	
-R1	2	Input -R1	-R2, AGND **)	40 mA
Input 3	3	10 V input 1	-	
GND	4	Analog ground	-R1, -R2, AGND **)	40 mA
+R2	5	Input +R2	-	
-R2	6	Input -R2	-R1, AGND **)	40 mA
Input 4	7	10 V input 2	-	
GND	8	Analog ground	-R1, -R2, AGND **)	40 mA

*) Continuous and peak value

**) Cross resistances of a few ohms can be measured, but are not functionally relevant

LEDs

LED	Color	Meaning				
RUN	green	This LED indicates the terminal's operating state:				
		off	State of the EtherCAT State Machine: INIT = initialization of the terminal or BOOTSTRAP = function for terminal firmware updates			
		flashing State of the EtherCAT State Machine: PREOP = function for mails communication and different default settings set				
	Single flash State of the EtherCAT State Machine: SAFEOP = verifica Manager channels and the distributed clocks. Outputs remain in safe state					
			State of the EtherCAT State Machine: OP = normal operating state; mailbox and process data communication is possible			
ERROR1 - 4	red		nort circuit or wire break. The resistance value is in the invalid range of the naracteristic curve.			

3.4 Technology

General

Two channels of the EL3204-0162 analog input terminal enable direct connection of resistance sensors in 2wire technology. A micro-controller within the terminal is used for converting and linearizing the resistance to a temperature value.

The temperatures are displayed as follows:

- Measuring range 10 to 1047 Ω : 1/64 ohm
- Measuring range 10 to 4095 Ω : 1/16 ohm (The use of the terminal in the range 0 to 10 ohm is not recommended)
- All other measuring ranges: 1/10 °C (1 digit = 0.1 °C)

Besides that, a wire break is reported to the controller and indicated by the ERROR LED. Pt100, NI100, Pt200, Pt500, NI120, NI1000 and Pt1000 elements are implemented over their full measuring ranges as resistance sensors. The terminal can be fully configured over the fieldbus. A self-defined scaling of the output can, for instance, be performed, or the temperature conversion can be switched off.

Characteristic curves for KT/KTY sensors are implemented and selectable via the CoE directory.

In the delivery state, the measured value is displayed in increments of 1/10 °C in two's complement format (integer). The complete measuring range is output for each resistance sensor. Other presentation types are selectable via index 0x8000:02 [\blacktriangleright 144] / 0x8010:02 [\blacktriangleright 146] (e.g. signed amount representation or high resolution with 1/100 °C).

Two further input channels of the EL3204-0162 can process analog signals in the range from 0 to 10 V or -10 to +10 V. The inputs are designed in 2-wire technology. See process data [▶ 128].

3.4.1 Measuring principle of a resistance sensor

The resistance sensor (RTD element) is normally evaluated by measuring the voltage drop across the sensor through which a measuring current flows. The voltage change ΔU_t measured in the EL3204-0162 is proportional to the resistance change ΔR_t .

In the ratiometric measurement, a constant voltage is applied to the resistor R_{ref} and R_t (Fig. *Ratiometric measurement*). More important, however, is the temperature stability of the reference resistor R_{ref} . In general, therefore, a ratiometric measurement as the quotient of two quantities with the same disturbance overlapping does not affect the measurement. The ratiometric value is therefore independent of the supply voltage. The measured value R_t is determined here via the ratio of the voltage drop at U_{ref} and U_t and the reference resistance R_{ref} .

$\mathbf{R}_{t} = \mathbf{R}_{ref} \mathbf{x} \mathbf{U}_{t} / \mathbf{U}_{ref}$

In general, a ratiometric measurement as the quotient of two values with the same disturbance overlapping does not affect the measurement. A ratiometric value is therefore independent of the supply voltage.




Fig. 6: Ratiometric measurement

The voltage change is proportional to the resistance change and hence also to the temperature change.




Wiring of the RTD input channels

Due to this measuring principle (resistive temperature sensor), a sensor may not be connected in parallel to two or more input channels!

3.4.2 2-wire connection technology

If the two-wire technique is used to connect the EL3204-0162, the terminal is connected via a two-core cable, whose internal resistance R_L is connected in series with the resistance sensor R_t (fig. *Two-wire connection technique with internal compensation in the terminal*). The addition of these resistances causes a systematically increased temperature display, making compensation necessary. The compensation is performed internally in the terminal by the object 0x8000:1B [\blacktriangleright 144] / 0x8010:1B [\blacktriangleright 146]. Here the line resistance can be set with a resolution of 1/32 ohm.

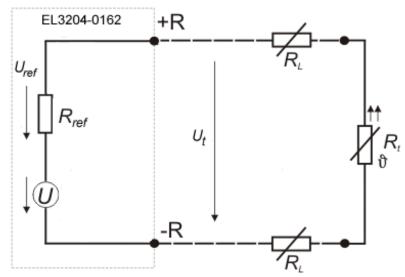



Example:

The cross-section of the 50 meter long connecting cable made of stranded copper wire is 0.5 mm². The specific resistance of copper corresponds to 0.0175 Ω mm² per meter

Determination of the total resistance of the supply line:

R_{Ltot} = 0.0175 Ω mm² / m x (2 x 50 m / 0,5 mm²) = 3.5 Ω

For a resistance change of the Pt100 of \thickapprox 0.39 Ω/K , the resulting temperature deviation is:

3.5 Ω / (0.39 Ω/°C) = 8.97 °C

Compensation

In order to compensate this error, the EL3204-0162 internal circuit generally assumes a cable resistance of 10 Ω , which is set via the object <u>0x8000:1B [\blacktriangleright 144] / <u>0x8010:1B [\blacktriangleright 146]</u>.</u>

For the adjustment the resistance value R_{Ltot} (in the example 3.5 ohm) is entered into the index <u>0x8000:1B</u> [\blacktriangleright <u>144</u>] / <u>0x8010:1B</u> [\blacktriangleright <u>146</u>]. With a resolution of 1/32 ohm this results in a value to be entered of:

3.5 Ω / (1/32) Ω = 112_{dec}

Further calculations for the compensation take place internally in the terminal.

3.4.3 Overview of suitable resistance sensors

The following resistance sensors are suitable for temperature measurement with the EL3204-0162 and can be selected via the object $\underline{0x80n00:19}$ [\blacktriangleright 144].

Suitable resistance sensors for the EL3204-0162

Туре	Implemented temperature range			
Pt100	-200 °C to 850 °C			
Ni100	-60 °C to 250 °C			
Pt1000	-200 °C to 850 °C			
Pt500	-200 °C to 850 °C			
Pt200	-200 °C to 1370 °C			
Ni1000	-60 °C to 250 °C			
Ni1000 100 °C: 1500 ohm	-30 to 160 °C			
Ni120	-60 °C to 320 °C			
KT100/110/130/210/230 KTY10/11/13/16/19	-50150 °C			
KTY81/82-110,120,150				
KTY81-121				
KTY81-122				
KTY81-151				
KTY81-152				
KTY81/82-210,220,250				
KTY81-221				
KTY81-222				
KTY81-251				
KTY81-252				
KTY83-110,120,150	-50175 °C			
KTY83-121				
KTY83-122				
KTY83-151				
KTY83-152				
KTY84-130.150	-40300 °C			
KTY84-151				
KTY21/23-6	-50150 °C			
KTY1x-5				
KTY1x-7				
KTY21/23-5				
KTY21/23-7				

The specific characteristic curves of the different sensors are implemented in the EL3204-0162 and are taken into account when calculating the analog output value.

3.5 Start

For commissioning:

- mount the EL3204-0162 as described in the chapter Mounting and wiring [▶ 36]
- configure the EL3204-0162 in TwinCAT as described in the chapter Commissioning [▶ 49].

4 Basics communication

4.1 EtherCAT basics

Please refer to the EtherCAT System Documentation for the EtherCAT fieldbus basics.

4.2 EtherCAT cabling – wire-bound

The cable length between two EtherCAT devices must not exceed 100 m. This results from the FastEthernet technology, which, above all for reasons of signal attenuation over the length of the cable, allows a maximum link length of 5 + 90 + 5 m if cables with appropriate properties are used. See also the <u>Design</u> recommendations for the infrastructure for EtherCAT/Ethernet.

Cables and connectors

For connecting EtherCAT devices only Ethernet connections (cables + plugs) that meet the requirements of at least category 5 (CAt5) according to EN 50173 or ISO/IEC 11801 should be used. EtherCAT uses 4 wires for signal transfer.

EtherCAT uses RJ45 plug connectors, for example. The pin assignment is compatible with the Ethernet standard (ISO/IEC 8802-3).

Pin	Color of conductor	Signal	Description
1	yellow	TD +	Transmission Data +
2	orange	TD -	Transmission Data -
3	white	RD +	Receiver Data +
6	blue	RD -	Receiver Data -

Due to automatic cable detection (auto-crossing) symmetric (1:1) or cross-over cables can be used between EtherCAT devices from Beckhoff.

Recommended cables

- It is recommended to use the appropriate Beckhoff components e.g.
- cable sets ZK1090-9191-xxxx respectively
- RJ45 connector, field assembly ZS1090-0005
- EtherCAT cable, field assembly ZB9010, ZB9020

Suitable cables for the connection of EtherCAT devices can be found on the Beckhoff website!

E-Bus supply

A bus coupler can supply the EL terminals added to it with the E-bus system voltage of 5 V; a coupler is thereby loadable up to 2 A as a rule (see details in respective device documentation). Information on how much current each EL terminal requires from the E-bus supply is available online and in the catalogue. If the added terminals require more current than the coupler can supply, then power feed terminals (e.g. EL9410) must be inserted at appropriate places in the terminal strand.

The pre-calculated theoretical maximum E-Bus current is displayed in the TwinCAT System Manager. A shortfall is marked by a negative total amount and an exclamation mark; a power feed terminal is to be placed before such a position.

B I/O Devices	Number	Box Name	Add	Туре	In Si	Out	E-Bus (mA)
🖻 🔤 Device 1 (EtherCAT)	器 1	Term 1 (EK1100)	1001	EK1100			
Device 1-Image Device 1 Image Infe	5 2	Term 2 (EL2008)	1002	EL2008		1.0	1890
Device 1-Image-Info Inputs	₹3	Term 3 (EL2008)	1003	EL2008		1.0	1780
	₹4	Term 4 (EL2008)	1004	EL2008		1.0	1670
B-8 InfoData	[™] 15	Term 5 (EL6740	1005	EL6740-0010	2.0	2.0	1220
B-B Term 1 (EK1100)	16	Term 6 (EL6740	1006	EL6740-0010	2.0	2.0	770
⊕ InfoData	11 7	Term 7 (EL6740	1007	EL6740-0010	2.0	2.0	320
Term 2 (EL2008)	*18	Term 8 (EL6740	1008	EL6740-0010	2.0	2.0	-130 !
• Term 3 (EL2008)	919	Term 9 (EL6740	1009	EL6740-0010	2.0	2.0	-580 !

Fig. 8: System manager current calculation

NOTICE

Malfunction possible!

The same ground potential must be used for the E-Bus supply of all EtherCAT terminals in a terminal block!

4.3 General notes for setting the watchdog

The EtherCAT terminals are equipped with a safety device (watchdog) which, e. g. in the event of interrupted process data traffic, switches the outputs (if present) to a presettable state after a presettable time, depending on the device and setting, e. g. to FALSE (off) or an output value.

The EtherCAT slave controller features two watchdogs:

- Sync Manager (SM) watchdog (default: 100 ms)
- Process Data (PDI) watchdog (default: 100 ms)

Their times are individually parameterized in TwinCAT as follows:

Advanced Settings		×		
 General Behavior Timeout Settings FMMU / SM Init Commands Distributed Clock ESC Access 	Behavior Startup Checking Check Vendor Id Check Product Code Check Revision Number Check Serial Number	State Machine Auto Restore States Relnit after Communication Error Log Communication Changes Final State OP OSAFEOP in Config Mode OSAFEOP OPREOP OINIT		
	Process Data □ Use LRD/LWR instead of LRW ☑ Include WC State Bit(s) General □ No AutoInc - Use 2. Address Watchdog □ Set Multiplier (Reg. 400h): □ Set PDI Watchdog (Reg. 410h): ☑ Set SM Watchdog (Reg. 420ht):	Info Data ✓ Include State ☐ Include Ads Address ☐ Include AoE NetId ☐ Include Drive Channels 2498 1000 ✓ ms: 100.000 0K Cancel		

Fig. 9: eEtherCAT tab -> Advanced Settings -> Behavior -> Watchdog

Notes:

- the Multiplier Register 400h (hexadecimal, i. e. 0x0400) is valid for both watchdogs.
- each watchdog has its own timer setting 410h or 420h, which together with the Multiplier results in a resulting time.
- important: the Multiplier/Timer setting is only loaded into the slave at EtherCAT startup if the checkbox in front of it is activated.
- if it is not checked, nothing is downloaded and the setting located in the ESC remains unchanged.
- the downloaded values can be seen in the ESC registers 400h, 410h and 420h: ESC Access -> Memory

SM watchdog (SyncManager Watchdog)

The SyncManager watchdog is reset with each successful EtherCAT process data communication with the terminal. If, for example, no EtherCAT process data communication with the terminal takes place for longer than the set and activated SM watchdog time due to a line interruption, the watchdog is triggered. The status of the terminal (usually OP) remains unaffected. The watchdog is only reset again by a successful EtherCAT process data access.

The SyncManager watchdog is therefore a monitoring for correct and timely process data communication with the ESC from the EtherCAT side.

The maximum possible watchdog time depends on the device. For example, for "simple" EtherCAT slaves (without firmware) with watchdog execution in the ESC it is usually up to 170 seconds. For complex EtherCAT slaves (with firmware) the SM watchdog function is usually parameterized via register 400h/420h but executed by the microcontroller (μ C) and can be significantly lower. In addition, the execution may then be subject to a certain time uncertainty. Since the TwinCAT dialog may allow inputs up to 65535, a test of the desired watchdog time is recommended.

PDI watchdog (Process Data Watchdog)

If there is no PDI communication with the ESC for longer than the set and activated Process Data Interface (PDI) watchdog time, this watchdog is triggered.

The PDI is the internal interface of the ESC, e.g. to local processors in the EtherCAT slave. With the PDI watchdog this communication can be monitored for failure.

The PDI watchdog is therefore a monitoring for correct and timely process data communication with the ESC, but viewed from the application side.

Calculation

Watchdog time = [1/25 MHz * (Watchdog multiplier + 2)] * SM/PDI watchdog

Example: default setting Multiplier = 2498, SM watchdog = 1000 => 100 ms

The value in "Watchdog multiplier + 2" in the formula above corresponds to the number of 40ns base ticks representing one watchdog tick.

Undefined state possible!

The function for switching off the SM watchdog via SM watchdog = 0 is only implemented in terminals from revision -0016. In previous versions this operating mode should not be used.

Damage of devices and undefined state possible!

If the SM watchdog is activated and a value of 0 is entered the watchdog switches off completely. This is the deactivation of the watchdog! Set outputs are NOT set in a safe state if the communication is interrupted.

4.4 EtherCAT State Machine

The state of the EtherCAT slave is controlled via the EtherCAT State Machine (ESM). Depending upon the state, different functions are accessible or executable in the EtherCAT slave. Specific commands must be sent by the EtherCAT master to the device in each state, particularly during the bootup of the slave.

A distinction is made between the following states:

- Init
- Pre-Operational
- Safe-Operational
- Operational

Bootstrap

The regular state of each EtherCAT slave after bootup is the OP state.

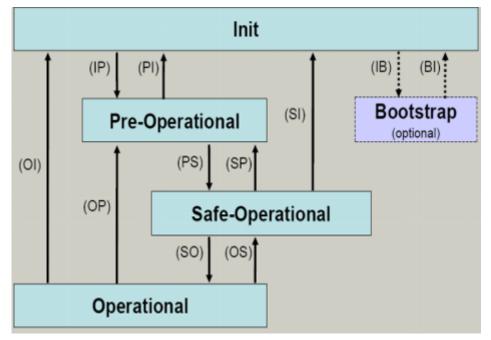


Fig. 10: States of the EtherCAT State Machine

Init

After switch-on the EtherCAT slave in the *Init* state. No mailbox or process data communication is possible. The EtherCAT master initializes sync manager channels 0 and 1 for mailbox communication.

Pre-Operational (Pre-Op)

During the transition between *Init* and *Pre-Op* the EtherCAT slave checks whether the mailbox was initialized correctly.

In *Pre-Op* state mailbox communication is possible, but not process data communication. The EtherCAT master initializes the sync manager channels for process data (from sync manager channel 2), the Fieldbus Memory Management Unit (FMMU) channels and, if the slave supports configurable mapping, PDO mapping or the sync manager PDO assignment. In this state the settings for the process data transfer and perhaps terminal-specific parameters that may differ from the default settings are also transferred.

Safe-Operational (Safe-Op)

During transition between *Pre-Op* and *Safe-Op* the EtherCAT slave checks whether the sync manager channels for process data communication and, if required, the Distributed Clocks settings are correct. Before it acknowledges the change of state, the EtherCAT slave copies current input data into the associated Dual Port (DP)-RAM areas of the ESC.

In *Safe-Op* state mailbox and process data communication is possible, although the slave keeps its outputs in a safe state, while the input data are updated cyclically.

Outputs in SAFEOP state

The default set watchdog monitoring sets the outputs of the ESC module in a safe state - depending on the settings in SAFEOP and OP - e.g. in OFF state. If this is prevented by deactivation of the monitoring in the module, the outputs can be switched or set also in the SAFEOP state.

Operational (Op)

Before the EtherCAT master switches the EtherCAT slave from *Safe-Op* to *Op* it must transfer valid output data.

In the *Op* state the slave copies the output data of the masters to its outputs. Process data and mailbox communication is possible.

Boot

In the Boot state the slave firmware can be updated. The Boot state can only be reached via the Init state.

In the *Boot* state mailbox communication via the file access over EtherCAT (FoE) protocol is possible, but no other mailbox communication and no process data communication.

4.5 CoE Interface

General description

The CoE interface (CAN application protocol over EtherCAT interface) is used for parameter management of EtherCAT devices. EtherCAT slaves or the EtherCAT master manage fixed (read only) or variable parameters which they require for operation, diagnostics or commissioning.

CoE parameters are arranged in a table hierarchy. In principle, the user has access via the fieldbus. The EtherCAT master (TwinCAT System Manager) can access the local CoE lists of the slaves via EtherCAT in read or write mode, depending on the attributes.

Different CoE data types are possible, including string (text), integer numbers, Boolean values or larger byte fields. They can be used to describe a wide range of features. Examples of such parameters include manufacturer ID, serial number, process data settings, device name, calibration values for analog measurement or passwords.

The order is specified in two levels via hexadecimal numbering: (main)index, followed by subindex.

The value ranges are

- Index: 0x0000 ...0xFFFF (0...65535_{dec})
- Subindex: 0x00...0xFF (0...255_{dec})

A parameter localized in this way is normally written as 0x8010:07, with preceding "0x" to identify the hexadecimal numerical range and a colon between index and subindex.

The relevant ranges for EtherCAT fieldbus users are:

- 0x1000: This is where fixed identity information for the device is stored, including name, manufacturer, serial number etc., plus information about the current and available process data configurations.
- 0x8000: This is where the operational and functional parameters for all channels are stored, such as filter settings or output frequency.

Other important ranges are:

- 0x4000: here are the channel parameters for some EtherCAT devices. Historically, this was the first parameter area before the 0x8000 area was introduced. EtherCAT devices that were previously equipped with parameters in 0x4000 and changed to 0x8000 support both ranges for compatibility reasons and mirror internally.
- 0x6000: Input PDOs ("inputs" from the perspective of the EtherCAT master)
- 0x7000: Output PDOs ("outputs" from the perspective of the EtherCAT master)

Availability

Not every EtherCAT device must have a CoE list. Simple I/O modules without dedicated processor usually have no variable parameters and therefore no CoE list.

If a device has a CoE list, it is shown in the TwinCAT System Manager as a separate tab with a listing of the elements:

eneral EtherCAT Process Data Startup CoE - Online Online						
Update Li	Update List 📃 Auto Update 🔽 Single Update 🔽 Show Offline Data					
Advanced						
Add to Start	up Offline Data	Mo	odule OD (AoE Port): 0			
Index	Name	Flags	Value			
1000	Device type	RO	0x00FA1389 (16389001)			
1008	Device name	RO	EL2502-0000			
1009	Hardware version	RO				
100A	Software version	RO				
	1011:0 Restore default parameters		>1<			
Ē <u></u> 1018:0	Identity	RO	> 4 <			
1018:01	Vendor ID	RO	0x00000002 (2)			
1018:02	Product code	RO	0x09C63052 (163983442)			
1018:03	Revision	RO	0x00130000 (1245184)			
1018:04	Serial number	RO	0x00000000 (0)			
🗄 🗠 10F0:0	Backup parameter handling	RO	>1<			
	1400:0 PWM RxPDO-Par Ch.1		> 6 <			
· 1401:0	😟 1401:0 PWM RxPDO-Par Ch.2		>6<			
· 1402:0	😟 1402:0 PWM RxPDO-Par h.1 Ch.1		> 6 <			
· 1403:0	PWM RxPDO-Par h.1 Ch.2	RO	>6<			
· 1600:0	PWM RxPDO-Map Ch.1	RO	>1<			

Fig. 11: "CoE Online" tab

The figure "'CoE Online' tab" shows the CoE objects available in device "EL2502", ranging from 0x1000 to 0x1600. The subindices for 0x1018 are expanded.

NOTICE

Changes in the CoE directory (CAN over EtherCAT directory), program access

When using/manipulating the CoE parameters observe the general CoE notes in chapter "CoE interface" of the EtherCAT system documentation:

- Keep a startup list if components have to be replaced,
- Distinction between online/offline dictionary,
- Existence of current XML description (download from the Beckhoff website),
- "CoE-Reload" for resetting the changes
- Program access during operation via PLC (see <u>TwinCAT3 | PLC Library: Tc2 EtherCAT</u> and <u>Example</u> program R/W CoE)

Data management and function "NoCoeStorage"

Some parameters, particularly the setting parameters of the slave, are configurable and writeable,

- via the System Manager (Fig. "CoE Online" tab) by clicking. This is useful for commissioning of the system or slaves. Click on the row of the index to be parameterized and enter a value in the "SetValue" dialog.
- from the control system or PLC via ADS, e.g. through blocks from the TcEtherCAT.lib library. This is recommended for modifications while the system is running or if no System Manager or operating staff are available.



Data management

If slave CoE parameters are modified online, Beckhoff devices store any changes in a fail-safe manner in the EEPROM, i.e. the modified CoE parameters are still available after a restart. The situation may be different with other manufacturers.

An EEPROM is subject to a limited lifetime with respect to write operations. From typically 100,000 write operations onwards it can no longer be guaranteed that new (changed) data are reliably saved or are still readable. This is irrelevant for normal commissioning. However, if CoE parameters are continuously changed via ADS at machine runtime, it is quite possible for the lifetime limit to be reached. Support for the NoCoeStorage function, which suppresses the saving of changed CoE values, depends on the firmware version.

Please refer to the technical data in this documentation as to whether this applies to the respective device.

- If the function is supported: the function is activated by entering the code word 0x12345678 once in CoE index 0xF008 and remains active as long as the code word is not changed. After switching the device on it is then inactive. Changed CoE values are not saved in the EEPROM and can thus be changed any number of times.
- If the function is not supported: continuous changing of CoE values is not permissible in view of the lifetime limit.



Startup list

Changes in the local CoE list of the terminal are lost if the terminal is replaced. If a terminal is replaced with a new Beckhoff terminal, it will have the default settings. It is therefore advisable to link all changes in the CoE list of an EtherCAT slave with the Startup list of the slave, which is processed whenever the EtherCAT fieldbus is started. In this way a replacement EtherCAT slave can automatically be parameterized with the specifications of the user.

If EtherCAT slaves are used which are unable to store local CoE values permanently, the Startup list must be used.

Recommended approach for manual modification of CoE parameters

- Make the required change in the System Manager (the values are stored locally in the EtherCAT slave).
- If the value is to be stored permanently, enter it in the Startup list. The order of the Startup entries is usually irrelevant.

Transition	Protocol	Index	Data	Comment
C <ps></ps>	CoE	0x1C12:00	0x00 (0)	clear sm pdos (0x1C12)
C <ps></ps>	CoE	0x1C13:00	0x00 (0)	clear sm pdos (0x1C13)
C <ps></ps>	CoE	0x1C12:01	0x1600 (5632)	download pdo 0x1C12:01 i.
C <ps></ps>	CoE	0x1C12:02	0x1601 (5633)	download pdo 0x1C12:02 i.
C <ps></ps>	CoE	0x1C12:00	0x02 (2)	download pdo 0x1C12 cou
		Tinsert Delete Edit		

Fig. 12: Startup list in the TwinCAT System Manager

The Startup list may already contain values that were configured by the System Manager based on the ESI specifications. Additional application-specific entries can also be created.

Online / offline list

When working with the TwinCAT System Manager, a distinction must be made as to whether the EtherCAT device is currently "available", i.e. switched on and connected via EtherCAT - i.e. **online** - or whether a configuration is created **offline** without slaves being connected.

In both cases a CoE list as shown in Fig. "CoE online tab" is displayed. The connectivity is shown as offline/ online.

- If the slave is offline:
 - The offline list from the ESI file is displayed. In this case modifications are not meaningful or possible.
 - The configured status is shown under Identity.
 - No firmware or hardware version is displayed since these are features of the physical device.
 - Offline Data is shown in red.

General EtherCAT Process Data Startup CoE - Online Online						
Update Li	st 📃 🗖 Auto Update	🔽 Single	Update 🔽 Show Offline Data			
Advanced						
Add to Start	.p Offline Data	Offline Data Module OD (AoE Po				
Index	Name 🔨	Flags	Value			
1000	Device type	RO	0x00FA1389 (16389001)			
1008	Device name 🛛 🗛 🔪	RO	EL2502-0000			
1009	Hardware version	RO				
100A	Software version	RO				
连 ··· 1011:0	Restore default parameters	RO	>1<			
i <u>−</u> 1018:0	Identity	RO	> 4 <			
1018:01	Vendor ID	RO	0x0000002 (2)			
1018:02	Product code	RO	0x09C63052 (163983442)			
1018:03	Revision	RO	0x00130000 (1245184)			
1018:04	Serial number	RO	0x00000000 (0)			
😟 🗠 10F0:0	Backup parameter handling	RO	>1<			
	PWM RxPDO-Par Ch.1	RO	>6<			
😟 ··· 1401:0	PWM RxPDO-Par Ch.2	RO	>6<			
	PWM RxPDO-Par h.1 Ch.1	RO	>6<			
· 1403:0	PWM RxPDO-Par h.1 Ch.2	RO	>6<			
	PWM RxPDO-Map Ch.1	RO	>1<			

Fig. 13: Offline list

- If the slave is online:
 - The actual current slave list is read. This may take several seconds, depending on the size and cycle time.
 - The actual identity is displayed.
 - The firmware and hardware status of the device is displayed in the CoE.
 - Online Data is shown in green.

G	General EtherCAT Process Data Startup CoE - Online Online						
	Update Lis	st 👘 🗖 Auto Update	🔽 Single Up	pdate 🔲 Show Offline Data			
	Advanced.						
	Add to Start	ip Online Data	- Modu	ile OD (AoE Port): 0			
[Index	Name	Flags	Value			
	1000	Device type	RO	0x00FA1389 (16389001)			
	1008	Device name	RO	EL2502-0000			
	1009	Hardware version	RO	02			
	100A	Software version	RO	07			
	€… 1011:0	Restore default parameters	RO	>1<			
	🖻 – 1018:0	Identity	RO	> 4 <			
	1018:01	Vendor ID	RO	0x00000002 (2)			
	1018:02	Product code	RO	0x09C63052 (163983442)			
	1018:03	Revision	RO	0x00130000 (1245184)			
	1018:04	Serial number	RO	0x00000000 (0)			
	± 10F0:0	Backup parameter handling	RO	> 1 <			
	主 ·· 1400:0	PWM RxPDO-Par Ch.1	RO	>6<			



Channel-based order

The CoE list is available in EtherCAT devices that usually feature several functionally equivalent channels, for example, a 4-channel analog input terminal also has four logical channels and therefore four identical sets of parameter data for the channels. In order to avoid having to list each channel in the documentation, the placeholder "n" tends to be used for the individual channel numbers.

In the CoE system 16 indices, each with 255 subindices, are generally sufficient for representing all channel parameters. The channel-based order is therefore arranged in 16_{dec} or 10_{hex} steps. The parameter range 0x8000 exemplifies this:

- Channel 0: parameter range 0x8000:00 ... 0x800F:255
- Channel 1: parameter range 0x8010:00 ... 0x801F:255
- Channel 2: parameter range 0x8020:00 ... 0x802F:255
- ...

This is generally written as 0x80n0.

Detailed information on the CoE interface can be found in the <u>EtherCAT system documentation</u> on the Beckhoff website.

4.6 Distributed Clock

The distributed clock represents a local clock in the EtherCAT slave controller (ESC) with the following characteristics:

- Unit 1 ns
- Zero point 1.1.2000 00:00
- Size *64 bit* (sufficient for the next 584 years; however, some EtherCAT slaves only offer 32-bit support, i.e. the variable overflows after approx. 4.2 seconds)
- The EtherCAT master automatically synchronizes the local clock with the master clock in the EtherCAT bus with a precision of < 100 ns.

For detailed information please refer to the EtherCAT system description.

5 Mounting and wiring

5.1 Instructions for ESD protection

NOTICE

Destruction of the devices by electrostatic discharge possible!

The devices contain components at risk from electrostatic discharge caused by improper handling.

- When handling the components, ensure that there is no electrostatic discharge; also avoid touching the spring contacts directly (see illustration).
- Contact with highly insulating materials (synthetic fibers, plastic films, etc.) should be avoided when handling components at the same time.
- When handling the components, ensure that the environment (workplace, packaging and persons) is properly earthed.
- Each bus station must be terminated on the right-hand side with the <u>EL9011</u> or <u>EL9012</u> end cap to ensure the degree of protection and ESD protection.

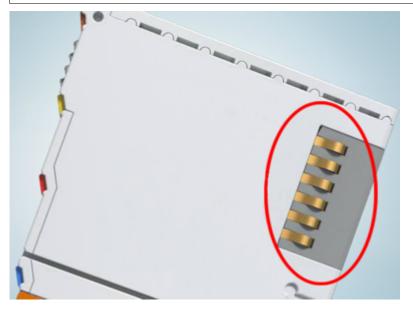


Fig. 15: Spring contacts of the Beckhoff I/O components

5.2 Installation on mounting rails

A WARNING

Risk of electric shock and damage of device!

Bring the bus terminal system into a safe, powered down state before starting installation, disassembly or wiring of the bus terminals!

The Bus Terminal system and is designed for mounting in a control cabinet or terminal box.

Assembly

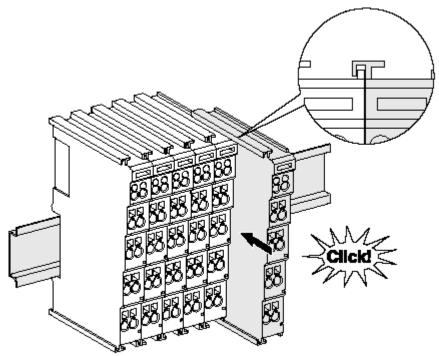


Fig. 16: Attaching on mounting rail

The bus coupler and bus terminals are attached to commercially available 35 mm mounting rails (DIN rails according to EN 60715) by applying slight pressure:

- 1. First attach the fieldbus coupler to the mounting rail.
- 2. The bus terminals are now attached on the right-hand side of the fieldbus coupler. Join the components with tongue and groove and push the terminals against the mounting rail, until the lock clicks onto the mounting rail.

If the terminals are clipped onto the mounting rail first and then pushed together without tongue and groove, the connection will not be operational! When correctly assembled, no significant gap should be visible between the housings.

Fixing of mounting rails

The locking mechanism of the terminals and couplers extends to the profile of the mounting rail. At the installation, the locking mechanism of the components must not come into conflict with the fixing bolts of the mounting rail. To mount the mounting rails with a height of 7.5 mm under the terminals and couplers, you should use flat mounting connections (e.g. countersunk screws or blind rivets).

Disassembly

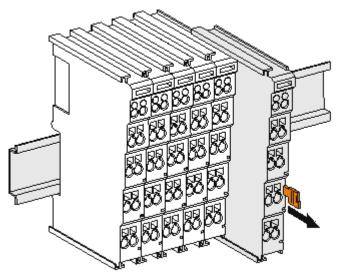


Fig. 17: Disassembling of terminal

Each terminal is secured by a lock on the mounting rail, which must be released for disassembly:

- 1. Pull the terminal by its orange-colored lugs approximately 1 cm away from the mounting rail. In doing so for this terminal the mounting rail lock is released automatically and you can pull the terminal out of the bus terminal block easily without excessive force.
- 2. Grasp the released terminal with thumb and index finger simultaneous at the upper and lower grooved housing surfaces and pull the terminal out of the bus terminal block.

Connections within a bus terminal block

The electric connections between the Bus Coupler and the Bus Terminals are automatically realized by joining the components:

- The six spring contacts of the K-Bus/E-Bus deal with the transfer of the data and the supply of the Bus Terminal electronics.
- The power contacts deal with the supply for the field electronics and thus represent a supply rail within the bus terminal block. The power contacts are supplied via terminals points on the Bus Coupler (up to 24 V) or for higher voltages via power feed terminals.




Power Contacts

During the design of a bus terminal block, the pin assignment of the individual Bus Terminals must be taken account of, since some types (e.g. analog Bus Terminals or digital 4-channel Bus Terminals) do not or not fully loop through the power contacts. Power Feed Terminals (KL91xx, KL92xx or EL91xx, EL92xx) interrupt the power contacts and thus represent the start of a new supply rail.

PE power contact

The power contact labeled PE can be used as a protective earth. For safety reasons this contact mates first when plugging together, and can ground short-circuit currents of up to 125 A.






Fig. 18: Power contact on left side

NOTICE

Possible damage of the device

Note that, for reasons of electromagnetic compatibility, the PE contacts are capacitatively coupled to the mounting rail. This may lead to incorrect results during insulation testing or to damage on the terminal (e.g. disruptive discharge to the PE line during insulation testing of a consumer with a nominal voltage of 230 V). For insulation testing, disconnect the PE supply line at the Bus Coupler or the Power Feed Terminal! In order to decouple further feed points for testing, these Power Feed Terminals can be released and pulled at least 10 mm from the group of terminals.

A WARNING

Risk of electric shock!

The PE power contact must not be used for other potentials!

5.3 Connection

5.3.1 Connection system

WARNING

Risk of electric shock and damage of device!

Bring the bus terminal system into a safe, powered down state before starting installation, disassembly or wiring of the bus terminals!

Overview

The bus terminal system offers different connection options for optimum adaptation to the respective application:

- The terminals of ELxxxx and KLxxxx series with standard wiring include electronics and connection level in a single enclosure.
- The terminals of ESxxxx and KSxxxx series feature a pluggable connection level and enable steady wiring while replacing.
- The High Density Terminals (HD Terminals) include electronics and connection level in a single enclosure and have advanced packaging density.

Standard wiring (ELxxxx / KLxxxx)



Fig. 19: Standard wiring

The terminals of the ELxxxx and KLxxxx series integrate screwless spring-cage technology for quick and easy wiring.

Pluggable wiring (ESxxxx / KSxxxx)



Fig. 20: Pluggable wiring

The terminals of ESxxxx and KSxxxx series feature a pluggable connection level.

The assembly and wiring procedure is the same as for the ELxxxx and KLxxxx series.

The pluggable connection level enables the complete wiring to be removed as a plug connector from the top of the housing for servicing.

The lower section can be removed from the terminal block by pulling the unlocking tab. Insert the new component and plug in the connector with the wiring. This reduces the installation time and eliminates the risk of wires being mixed up.

The familiar dimensions of the terminal only had to be changed slightly. The new connector adds about 3 mm. The maximum height of the terminal remains unchanged.

A tab for strain relief of the cable simplifies assembly in many applications and prevents tangling of individual connection wires when the connector is removed.

Conductor cross sections between 0.08 mm^2 and 2.5 mm^2 can continue to be used with the proven spring force technology.

The overview and nomenclature of the product names for ESxxxx and KSxxxx series has been retained as known from ELxxxx and KLxxxx series.

High Density Terminals (HD Terminals)



Fig. 21: High Density Terminals

The terminals from these series with 16 terminal points are distinguished by a particularly compact design, as the packaging density is twice as large as that of the standard 12 mm bus terminals. Massive conductors and conductors with a wire end sleeve can be inserted directly into the spring loaded terminal point without tools.

Wiring

Wiring HD Terminals

The High Density Terminals of the ELx8xx and KLx8xx series doesn't support pluggable wiring.

Ultrasonically compacted (ultrasonically welded) strands

Ultrasonically compacted (ultrasonically welded) strands

Ultrasonically compacted (ultrasonically welded) strands can also be connected to the standard and high-density terminals. In this case, please note the tables concerning the <u>wire-size width [\blacktriangleright 43]!</u>

5.3.2 Wiring

A WARNING

Risk of electric shock and damage of device!

Bring the bus terminal system into a safe, powered down state before starting installation, disassembly or wiring of the bus terminals!

Terminals for standard wiring ELxxxx/KLxxxx and for pluggable wiring ESxxxx/KSxxxx

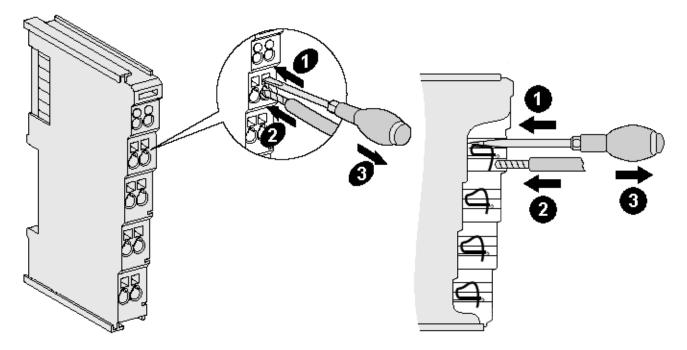


Fig. 22: Connecting a cable on a terminal point

Up to eight terminal points enable the connection of solid or finely stranded cables to the bus terminal. The terminal points are implemented in spring force technology. Connect the cables as follows (see fig. "Connecting a cable on a terminal point":

- 1. Open a terminal point by pushing a screwdriver straight against the stop into the square opening above the terminal point. Do not turn the screwdriver or move it alternately (don't toggle).
- 2. The wire can now be inserted into the round terminal opening without any force.
- 3. When the screwdriver is removed, the terminal point closes automatically and holds the wire securely and permanently in place

See the following table for the suitable wire size width:

Terminal housing	ELxxxx, KLxxxx	ESxxxx, KSxxxx
Wire size width (single core wires)	0.08 2.5 mm ²	0.08 2.5 mm ²
Wire size width (fine-wire conductors)	0.08 2.5 mm ²	0.08 2.5 mm ²
Wire size width (conductors with a wire end sleeve)	0.14 1.5 mm ²	0.14 1.5 mm ²
Wire stripping length	8 9 mm	9 10 mm

High Density Terminals (<u>HD Terminals [▶ 41]</u>) with 16 terminal points

The conductors of the HD Terminals are connected without tools for single-wire conductors using the direct plug-in technique, i.e. after stripping the wire is simply plugged into the terminal point. The cables are released, as usual, using the contact release with the aid of a screwdriver. See the following table for the suitable wire size width.

Terminal housing	High Density Housing
Wire size width (single core wires)	0.08 1.5 mm ²
Wire size width (fine-wire conductors)	0.25 1.5 mm ²
Wire size width (conductors with a wire end sleeve)	0.14 0.75 mm ²
Wire size width (ultrasonically compacted [ultrasonically welded] strands)	only 1.5 mm² (see <u>notice [▶ 41]</u>)
Wire stripping length	8 9 mm

5.3.3 Shielding



Shielding

Encoder, analog sensors and actuators should always be connected with shielded, twisted paired wires.

5.4 Note - power supply

A WARNING

Power supply from SELV / PELV power supply unit!

SELV / PELV circuits (safety extra-low voltage / protective extra-low voltage) according to IEC 61010-2-201 must be used to supply this device.

Notes:

- SELV / PELV circuits may give rise to further requirements from standards such as IEC 60204-1 et al, for example with regard to cable spacing and insulation.
- A SELV supply provides safe electrical isolation and limitation of the voltage without a connection to the protective conductor, a PELV supply also requires a safe connection to the protective conductor.

Version: 1.1.0

5.5 Positioning of passive Terminals

Hint for positioning of passive terminals in the bus terminal block

EtherCAT Terminals (ELxxxx / ESxxxx), which do not take an active part in data transfer within the bus terminal block are so called passive terminals. The passive terminals have no current consumption out of the E-Bus.

To ensure an optimal data transfer, you must not directly string together more than two passive terminals!

Examples for positioning of passive terminals (highlighted)

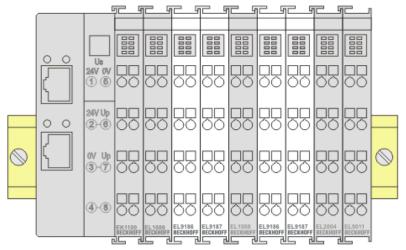


Fig. 23: Correct positioning

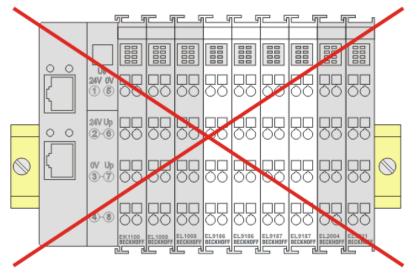


Fig. 24: Incorrect positioning

5.6 Installation positions

NOTICE

Constraints regarding installation position and operating temperature range

Please refer to the technical data for a terminal to ascertain whether any restrictions regarding the installation position and/or the operating temperature range have been specified. When installing high power dissipation terminals ensure that an adequate spacing is maintained between other components above and below the terminal in order to guarantee adequate ventilation!

Optimum installation position (standard)

The optimum installation position requires the mounting rail to be installed horizontally and the connection surfaces of the EL- / KL terminals to face forward (see Fig. "Recommended distances for standard installation position"). The terminals are ventilated from below, which enables optimum cooling of the electronics through convection. "From below" is relative to the acceleration of gravity.

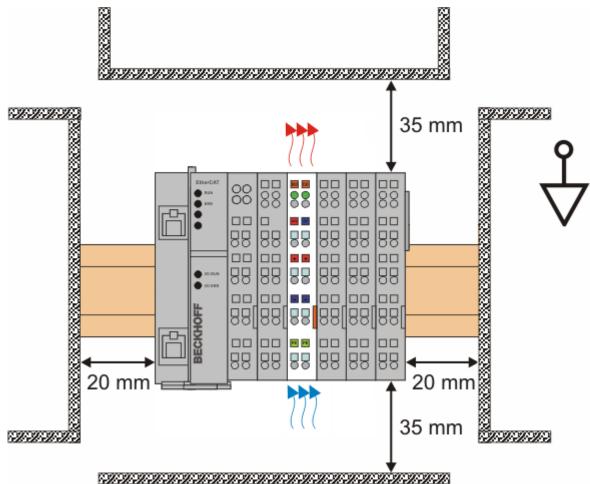


Fig. 25: Recommended distances for standard installation position

Compliance with the distances shown in Fig. "Recommended distances for standard installation position" is recommended.

Other installation positions

All other installation positions are characterized by different spatial arrangement of the mounting rail - see Fig "Other installation positions".

The minimum distances to ambient specified above also apply to these installation positions.

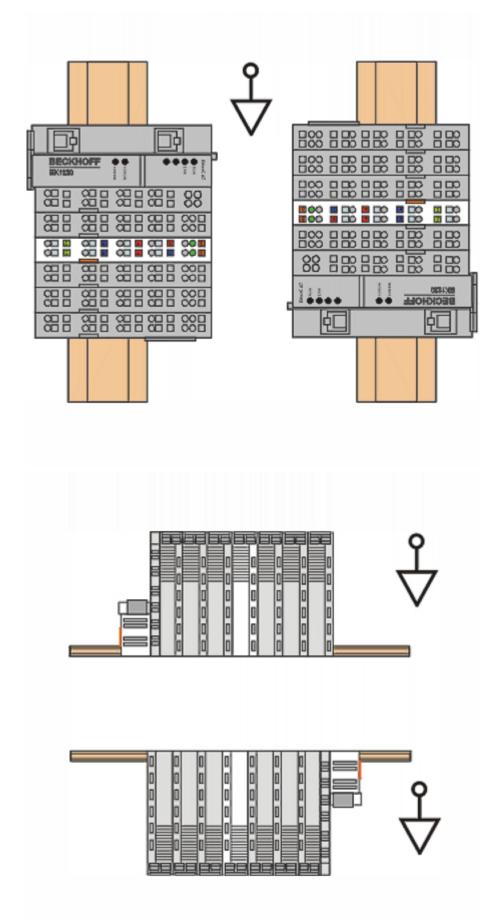


Fig. 26: Other installation positions



5.7 Disposal



Products marked with a crossed-out wheeled bin shall not be discarded with the normal waste stream. The device is considered as waste electrical and electronic equipment. The national regulations for the disposal of waste electrical and electronic equipment must be observed.

6 Commissioning

6.1 TwinCAT Quick Start

TwinCAT is a development environment for real-time control including a multi PLC system, NC axis control, programming and operation. The whole system is mapped through this environment and enables access to a programming environment (including compilation) for the controller. Individual digital or analog inputs or outputs can also be read or written directly, in order to verify their functionality, for example.

For further information, please refer to <u>http://infosys.beckhoff.com</u>:

- EtherCAT System Manual: Fieldbus Components → EtherCAT Terminals → EtherCAT System Documentation → Setup in the TwinCAT System Manager
- **TwinCAT 2** \rightarrow TwinCAT System Manager \rightarrow I/O Configuration
- In particular, for TwinCAT driver installation: Fieldbus components → Fieldbus Cards and Switches → FC900x – PCI Cards for Ethernet → Installation

Devices contain the relevant terminals for the actual configuration. All configuration data can be entered directly via editor functions (offline) or via the `scan function (online):

- **"offline"**: The configuration can be customized by adding and positioning individual components. These can be selected from a directory and configured.
 - The procedure for the offline mode can be found under <u>http://infosys.beckhoff.com</u>: **TwinCAT 2** → TwinCAT System Manager → IO Configuration → Add an I/O device
- "online": The existing hardware configuration is read
 - See also <u>http://infosys.beckhoff.com</u>:
 Fieldbus components → Fieldbus Cards and Switches → FC900x PCI Cards for Ethernet → Installation → Searching for devices

The following relationship is envisaged between the user PC and individual control elements:

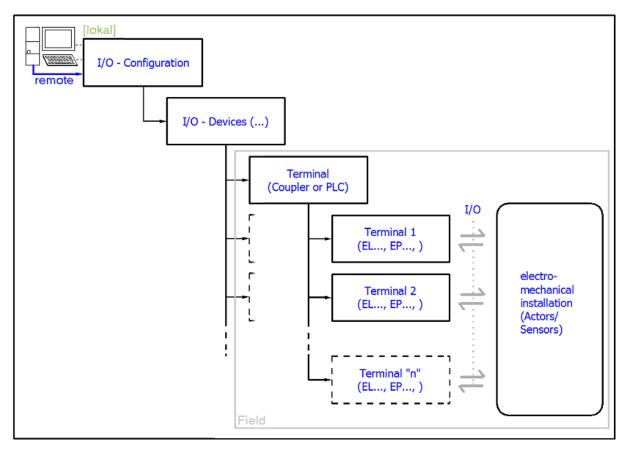


Fig. 27: Relationship between user side (commissioning) and installation

Insertion of certain components (I/O device, terminal, box...) by users functions the same way as in TwinCAT 2 and TwinCAT 3. The descriptions below relate solely to the online procedure.

Example configuration (actual configuration)

Based on the following example configuration, the subsequent subsections describe the procedure for TwinCAT 2 and TwinCAT 3:

- CX2040 control system (PLC) including CX2100-0004 power supply unit
- Connected to CX2040 on the right (E-bus): EL1004 (4-channel digital input terminal 24 V_{DC})
- · Linked via the X001 port (RJ-45): EK1100 EtherCAT Coupler
- Connected to the EK1100 EtherCAT Coupler on the right (E-bus): EL2008 (8-channel digital output terminal 24 V_{DC} ; 0.5 A)
- (Optional via X000: a link to an external PC for the user interface)

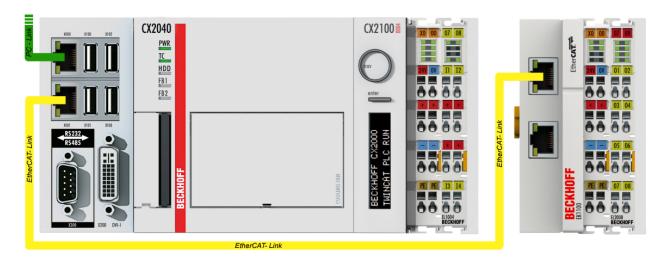


Fig. 28: Control configuration with Embedded PC, input (EL1004) and output (EL2008)

Note that all combinations of a configuration are possible; for example, the EL1004 terminal could also be connected after the coupler, or the EL2008 terminal could additionally be connected to the CX2040 on the right, in which case the EK1100 coupler wouldn't be necessary.

6.1.1 TwinCAT 2

Startup

TwinCAT 2 basically uses two user interfaces: the TwinCAT System Manager for communication with the electromechanical components and TwinCAT PLC Control for the development and compilation of a controller. The starting point is the TwinCAT System Manager.

After successful installation of the TwinCAT system on the PC to be used for development, the TwinCAT 2 System Manager displays the following user interface after startup:

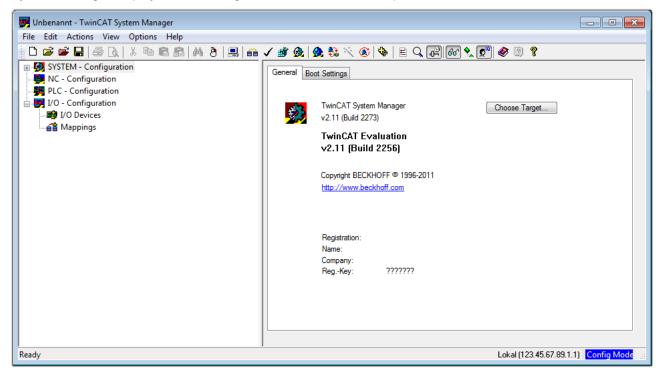


Fig. 29: Initial TwinCAT 2 user interface

Generally, TwinCAT can be used in local or remote mode. Once the TwinCAT system, including the user interface (standard) is installed on the respective PLC, TwinCAT can be used in local mode and thus the next step is "Insert Device [> 54]".

If the intention is to address the TwinCAT runtime environment installed on a PLC remotely from another system used as a development environment, the target system must be made known first. In the menu under

"Actions" \rightarrow "Choose Target System", the following window is o	opened for this via the symbol " 🖃 " or the
"F8" key:	

Choose Target System		X
⊞- ∰ Local (123.45.67.89.1.1)		OK Cancel
		Search (Ethernet)
		Search (Fieldbus)
Connection Timeout (s): 5	5	A V

Fig. 30: Selection of the target system

Use "Search (Ethernet)..." to enter the target system. Thus another dialog opens to either:

- enter the known computer name after "Enter Host Name / IP:" (as shown in red)
- perform a "Broadcast Search" (if the exact computer name is not known)
- enter the known computer IP or AmsNetID

Add Route Dialog			23
Enter Host Name / IP:	Refresh	Status	Broadcast Search
Host Name Connected Address	AMS NetId TwinC/	AT OS Versio	n Comment
Enter destination computer i	name		
& activate "Enter Host Name			
Route Name (Target):	Route Name	(Remote): M	IY-PC
AmsNetId:	- Target Route	e	Remote Route
Transport Type: TCP/IP 🔻	Project		🔘 None
Address Info:	Static		Static
Host Name O IP Address	🔘 Tempora	ary	Temporary
Connection Timeout (s): 5	Add B	oute	Close

Fig. 31: specify the PLC for access by the TwinCAT System Manager: selection of the target system

Once the target system has been entered, it is available for selection as follows (a correct password may have to be entered before this):

After confirmation with "OK", the target system can be accessed via the System Manager.



Adding devices

In the configuration tree of the TwinCAT 2 System Manager user interface on the left, select "I/O Devices" and then right-click to open a context menu and select "Scan Devices...", or start the action in the menu bar

via . The TwinCAT System Manager may first have to be set to "Config Mode" via or via the menu

"Actions" \rightarrow "Set/Reset TwinCAT to Config Mode..." (Shift + F4).

👜 👧 SYSTEM - Configura	
MC - Configuration	
🗄 🛃 I/O - Configuration	🛱 Import Device
I/O Devices	Scan Devices
	Paste Ctrl+V
	Paste Ctri+V

Fig. 32: Select "Scan Devices..."

Confirm the warning message, which follows, and select the "EtherCAT" devices in the dialog:

4 new I/O devices found	×
4 new I/O devices found	OK Cancel Select All Unselect All

Fig. 33: Automatic detection of I/O devices: selection of the devices to be integrated

Confirm the message "Find new boxes", in order to determine the terminals connected to the devices. "Free Run" enables manipulation of input and output values in "Config Mode" and should also be acknowledged.

Based on the <u>example configuration [) 50]</u> described at the beginning of this section, the result is as follows:

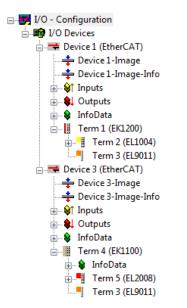


Fig. 34: Mapping of the configuration in the TwinCAT 2 System Manager

The whole process consists of two stages, which can also be performed separately (first determine the devices, then determine the connected elements such as boxes, terminals, etc.). A scan (search function) can also be initiated by selecting "Device ..." from the context menu, which then only reads the elements below which are present in the configuration:

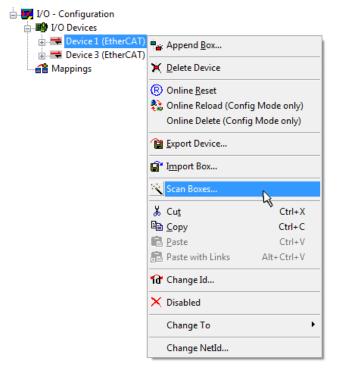


Fig. 35: Reading of individual terminals connected to a device

This functionality is useful if the actual configuration is modified at short notice.

Programming and integrating the PLC

TwinCAT PLC Control is the development environment for generating the controller in different program environments: TwinCAT PLC Control supports all languages described in IEC 61131-3. There are two text-based languages and three graphical languages.

Text-based languages

- Instruction List (IL)
- Structured Text (ST)

- Graphical languages
 - Function Block Diagram (FBD)
 - Ladder Diagram (LD)
 - The Continuous Function Chart Editor (CFC)
 - Sequential Function Chart (SFC)

The following section refers solely to Structured Text (ST).

After starting TwinCAT PLC Control, the following user interface is shown for an initial project:

🥦 TwinCAT PLC Control - (Untitled)* - [MAIN (PRG-ST)]	
🛒 File Edit Project Insert Extras Online Window Help	- 8 ×
POUs 0001 PROGRAM MAIN 0002 VAR 0003 END_VAR 0005 0006 0007 0008 0009 0001 < 0001 0002 0003 0007 0008 0009 0001 </th <th>• •</th>	• •
POUs 📲 Data types 🛱 Visualizations 🖫 Resources	•
Target: Local (123.45.67.89.1.1), Run Time: 1 TwinCAT Config Mode Lin.: 3, Col.: 8 ON	NLINE OV READ

Fig. 36: TwinCAT PLC Control after startup

Example variables and an example program have been created and stored under the name "PLC_example.pro":

Kincat PLC Control - PLC_example.pro -	[MAIN (PRG-ST)]	
👺 File Edit Project Insert Extras On		_ = = ×
≌ <mark>≥∎</mark> ∎ ®% +≣≞≌ <mark>%</mark>		
POUs MAIN (PRG)	0001 PROGRAM MAIN 0002 VAR 0003 nSwitchCtrl : BOOL := TRUE; 0004 nRotateUpper : WORD :=16#8000; 0005 nRotateLower : WORD :=16#01; 0006 END_VAR 0007 VAR_INPUT 0008 bEL1004_Ch4 AT%I* BOOL; 0009 END_VAR 0010 VAR_OUTPUT 0011 nEL2008_value AT%Q* EYTE; 0012 END_VAR 0013	
	• • 0001 (* Program example *) • 0002 IF bEL1004_Ch4 THEN • • •	4
	Implementation of POU 'MAIN' Implementation of task 'Standard' Warning 1990: No 'VAR_CONFIG' for 'MAIN.bEL1004_Ch4' Warning 1990: No 'VAR_CONFIG' for 'MAIN.nEL2008_value' POU indices:51 (2%)	•
POUs To Data	Size of used data: 45 of 1048576 bytes (0.00%) Size of used retain data: 0 of 32768 bytes (0.00%) 0 Error(s), 2 Warning(s).	
1	Target: Local (123.45.67.89.1.1), Run Time: 1 TwinCAT Config Mode Lin.: 13, Col.: 7	ONLINE OV READ

Fig. 37: Example program with variables after a compile process (without variable integration)

Warning 1990 (missing "VAR_CONFIG") after a compile process indicates that the variables defined as external (with the ID "AT%I*" or "AT%Q*") have not been assigned. After successful compilation, TwinCAT PLC Control creates a "*.tpy" file in the directory in which the project was stored. This file ("*.tpy") contains variable assignments and is not known to the System Manager, hence the warning. Once the System Manager has been notified, the warning no longer appears.

First, integrate the TwinCAT PLC Control project in the **System Manager**. This is performed via the context menu of the PLC configuration (right-click) and selecting "Append PLC Project...":

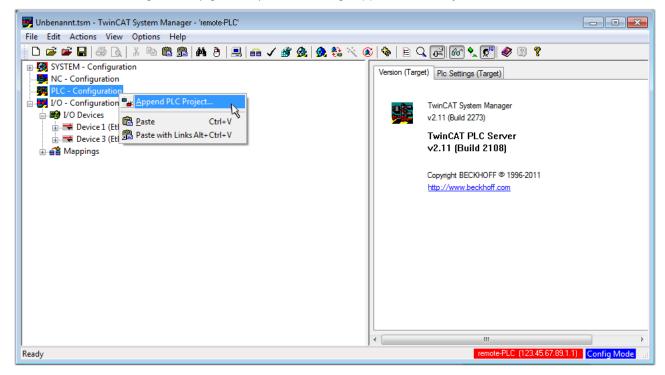


Fig. 38: Appending the TwinCAT PLC Control project

Select the PLC configuration "PLC_example.tpy" in the browser window that opens. The project including the two variables identified with "AT" are then integrated in the configuration tree of the System Manager:




Fig. 39: PLC project integrated in the PLC configuration of the System Manager

The two variables "bEL1004_Ch4" and "nEL2008_value" can now be assigned to certain process objects of the I/O configuration.

Assigning variables

Open a window for selecting a suitable process object (PDO) via the context menu of a variable of the integrated project "PLC_example" and via "Modify Link..." "Standard":

🗾 Unbenannt.tsm - TwinCAT System Ma	nager - 'remote-PLC'				- • •
File Edit Actions View Options	Help				
📄 🗅 📂 🖼 🚽 🎒 🔂 🕹 🖿 🖻	i 📾 🏘 👌 🔜 🖴 🗸 🎯 👧 👧 🗞 🎋	🔇 🌒 🖗 🛛 🖹 🔍	P 60 😒 🔊 🤌	8 🛛 📍	
🕀 🐼 SYSTEM - Configuration		Variable Flags	Online		*
- 🔀 NC - Configuration		Variable Flags	Uniine		
📄 🚔 PLC - Configuration	<u> Change Link</u>	Name:	MAIN.bEL1004_Ch4		
	Clear Link(s)		BOOL		
PLC_example-Image	Goto Link Variable	Type:	BOOL		
Standard	Take Name Over From Linked Variable	Group:	Inputs	Size:	0.1
i Inputs		Address:	0.0	User ID:	0
MAIN.bEL1004_Ch4	🚆 Insert Variable			0001101	
MAIN.nEL2008 valu	🔆 <u>D</u> elete	Linked to]		
□	Move Address	Comment:	Variable of IEC1131 pr	niect "PLC example"	Lodated with Tas
in the configuration	Move Address	Comment.	valiable of IEC 1151 pr	oject i Lo_example .	E
Device 1 (EtherCAT)	→3 Online <u>W</u> rite				
Device 3 (EtherCAT)	→3 Online Force				
	- Release Force				
	🔍 Add To Watch				
	🕅 Remove From Watch				
	Pag Remover roll water				
		ADS Info:	Port: 801, IGrp: 0xF02	1, IOffs: 0x0, Len: 1	
					Ψ.
1		•	III		۱.
			remote-P	LC (123.45.67.89.1.1)	Config Mode

Fig. 40: Creating the links between PLC variables and process objects

In the window that opens, the process object for the "bEL1004_Ch4" BOOL-type variable can be selected from the PLC configuration tree:



Attach Variable MAIN.bEL1004_Ch4 (Input)	—	
I/O - Configuration I/O Devices I/O Input > IX 26.0, BIT [0.1] I/O Input > IX 26.3, BIT [0.1] I/O Input > IX 26.3, BIT [0.1] I/O Provide 3 (EtherCAT) I/O Device 3 (EtherCAT) I/O Term 5 (EL2008) I/O WeState > IX 1522.0, BIT [0.1]	Show Variables Unused Used and unused Exclude disabled Exclude other Devices Exclude same Image Show Tooltips (EL1004) . Device 1 (EtherCAT) . I Matching Type Matching Size All Types Array Mode	/O Devices
	Offsets Continuous Show Dialog Variable Name	
	Hand over Take over	

Fig. 41: Selecting BOOL-type PDO

According to the default setting, only certain PDO objects are now available for selection. In this example, the input of channel 4 of the EL1004 terminal is selected for linking. In contrast, the checkbox "All types" must be ticked to create the link for the output variables, in order to allocate a set of eight separate output bits to a byte variable in this case. The following diagram shows the whole process:

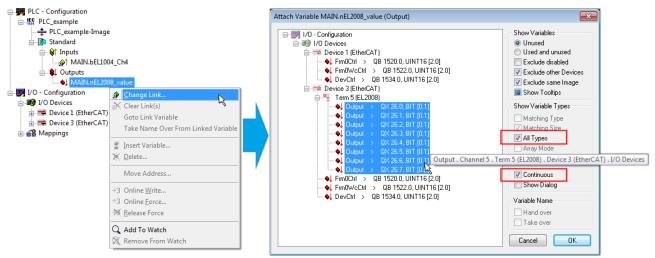


Fig. 42: Selecting several PDOs simultaneously: activate "Continuous" and "All types"

Note that the "Continuous" checkbox was also activated. This is designed to allocate the bits contained in the byte of the "nEL2008_value" variable sequentially to all eight selected output bits of the EL2008 Terminal. It is thus possible to subsequently address all eight outputs of the terminal in the program with a byte

corresponding to bit 0 for channel 1 to bit 7 for channel 8 of the PLC. A special symbol () on the yellow or red object of the variable indicates that a link exists. The links can also be checked by selecting "Goto Link Variable" from the context menu of a variable. The opposite linked object, in this case the PDO, is automatically selected:

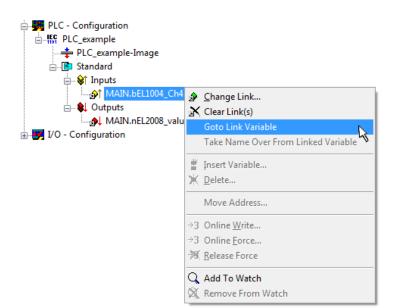


Fig. 43: Application of a "Goto Link Variable", using "MAIN.bEL1004_Ch4" as an example

The process of assigning variables to the PDO is completed via the menu option "Actions" \rightarrow "Create

assignment", or via

This can be visualized in the configuration:

```
    Mappings
    PLC_example (Standard) - Device 1 (EtherCAT)
    PLC_example (Standard) - Device 3 (EtherCAT)
```

The process of creating links can also be performed in the opposite direction, i.e. starting with individual PDOs to a variable. However, in this example, it would not be possible to select all output bits for the EL2008, since the terminal only makes individual digital outputs available. If a terminal has a byte, word, integer or similar PDO, it is also possible to allocate this to a set of bit-standardized variables. Here, too, a "Goto Link Variable" can be executed in the other direction, so that the respective PLC instance can then be selected.

Activation of the configuration

The allocation of PDO to PLC variables has now established the connection from the controller to the inputs and outputs of the terminals. The configuration can now be activated. First, the configuration can be verified

via \checkmark (or via "Actions" \rightarrow "Check Configuration"). If no error is present, the configuration can be

activated via (or via "Actions" \rightarrow "Activate Configuration...") to transfer the System Manager settings to the runtime system. Confirm the messages "Old configurations will be overwritten!" and "Restart TwinCAT system in Run mode" with "OK".

A few seconds later, the real-time status **RTime 0%** is displayed at the bottom right in the System Manager. The PLC system can then be started as described below.

Starting the controller

Starting from a remote system, the PLC control has to be linked with the embedded PC over the Ethernet via "Online" \rightarrow "Choose Runtime System...":

Login	F11		
Logout	F12		
Download			
Run	F5		
Stop	Shift+F8		
Reset			
Reset All		Choose Run-Time System	
Toggle Breakpoint	F9		
Breakpoint Dialog		□ਡੋLocal (149.35.17.99.1.1)	OK
Step over	F10	Emerge CDeraulty (200.200.200.200.200.200)	Cance
Step in	F8	Laufzeitsystem 1 (Port 801)	
Single Cycle	Ctrl+F5	4	
Write Values	Ctrl+F7		Version In
Force Values	F7		version in
Release Force	Shift+F7		
Write/Force-Dialog	Ctrl+Shift+F7		
Show Call Stack			
Display Flow Control	Ctrl+F11		
Simulation Mode		,	
Communication Parameters			
Sourcecode download	-/-		
Choose Run-Time System	R		
Create Bootproject			
Create Bootproject (offline)			

Fig. 44: Choose target system (remote)

In this example, "Runtime system 1 (port 801)" is selected and confirmed. Link the PLC with the real-time

system via the menu option "Online" \rightarrow "Login", the F11 key or by clicking on the symbol \square . The control program can then be loaded for execution. This results in the message "No program on the controller! Should the new program be loaded?", which should be confirmed with "Yes". The runtime environment is ready for the program start:

WinCAT PLC Control - PLC_example.pro*	- [MAIN (PRG-ST)]		
🥦 File Edit Project Insert Extras O	nline Window Help		- 8 ×
E 4 0 ∞ 4 2 2 2 4	x 🗈 📾 🙀 🙀		
POUS Lung MAIN (PRG)	0001 nSwitchCtrl = TRUE 0002 nRotateUpper = 16#0080 0003 nRotateLower = 16#0100 0004 bEL1004_Ch4 (%K0.0) = FALSE 0005 nEL2008_value (%QB0) = 16#80 0006 0007 0008 0009 0011 0012 0013 0014		
POUs POUs Data 💭 Visu 🔀 Res	0001 (* Program example *) 0002 IF bEL1004_Ch4 THEN 0003 IF nSwitchCtrl := FALSE; 0005 nRotateLower := ROL(nRotateLower, 2); 0006 nRotateUoper := ROR(nRotateUpper, 2); 0007 nEL2008_value := WORD_TO_BYTE(nRotate 0009 ELSE 0010 IF NOT nSwitchCtrl := TRUE; 0011 IS ND_IF 0012 END_IF 0013 END_IF 0014 0015	nSwitchCtrl = TRUE nSwitchCtrl = TRUE	nRotateLower = 16#0100
]	Target: remote-PLC (123.45.67.89.1.1),Run Time: 1	Lin.: 1, Col.: 18 ONLINE:	SIM RUN BP FORCE OV READ

Fig. 45: PLC Control logged in, ready for program startup

The PLC can now be started via "Online" \rightarrow "Run", F5 key or

6.1.2 TwinCAT 3

Startup

TwinCAT 3 makes the development environment areas available all together, with Microsoft Visual Studio: after startup, the project folder explorer appears on the left in the general window area (see "TwinCAT System Manager" of TwinCAT 2) for communication with the electromechanical components.

After successful installation of the TwinCAT system on the PC to be used for development, TwinCAT 3 (shell) displays the following user interface after startup:

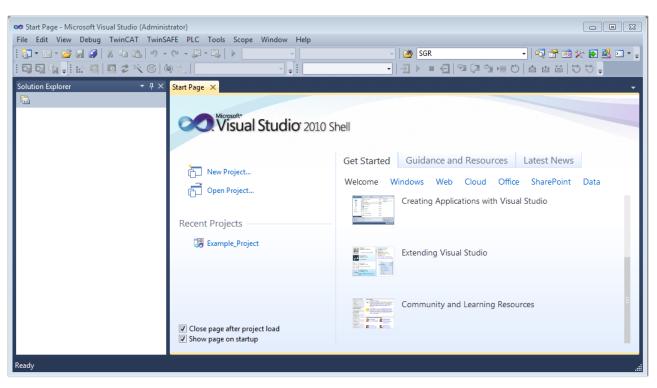


Fig. 46: Initial TwinCAT 3 user interface

First create a new project via \bigvee New TwinCAT Project... (or under "File" \rightarrow "New" \rightarrow "Project..."). In the following dialog, make the corresponding entries as required (as shown in the diagram):

New Project			? 💌
Recent Templates		.NET Framework 4 Sort by: Default	🔹 🔝 📰 Search Installed Tem 🔎
Installed Templates		TwinCAT XAE Project (XML format)	Type: TwinCAT Projects
 Other Project Type TwinCAT Measure TwinCAT Projects 	ment		TwinCAT XAE System Manager Configuration
Online Templates			
Name:	Evample Project		
Location:	Example_Project		
	C:\my_tc3_proje		Browse
Solution:	Create new solut	tion 👻	
Solution name:	Example_Project		Create directory for solution
			Add to Source Control
			OK Cancel

Fig. 47: Create new TwinCAT 3 project

The new project is then available in the project folder explorer:




Fig. 48: New TwinCAT 3 project in the project folder explorer

Generally, TwinCAT can be used in local or remote mode. Once the TwinCAT system including the user interface (standard) is installed on the respective PLC (locally), TwinCAT can be used in local mode and the process can be continued with the next step, "Insert Device [\blacktriangleright 65]".

If the intention is to address the TwinCAT runtime environment installed on a PLC remotely from another system used as a development environment, the target system must be made known first. Via the symbol in the menu bar:

File Edit	View	Project	Build	Debug	TwinCAT	TwinSAFE	PLC	Tools	Scope	Window	Help	
i 🛅 🕶 😐	- 🔁 🛛	3 🗿 7	X D	B 9	- @ - @	- 🖳 🕨	Relea	se	• Tw	inCAT RT ()	c64)	
	la - I -	> 🖪 🛛	1	10	0 🐁 🛛	<local></local>			₽ E [

expand the pull-down menu:

<local></local>	-	
<local></local>		
Choose Target System	1	
	-	_

and open the following window:

Choose Target System	X
⊡ <mark>-</mark> <local> (123.45.67.89.1.1)</local>	ОК
	Cancel
	Search (Ethernet)
	Search (Fieldbus)
	🔲 Set as Default
Connection Timeout (s): 5	

Fig. 49: Selection dialog: Choose the target system


Use "Search (Ethernet)..." to enter the target system. Thus another dialog opens to either:

- enter the known computer name after "Enter Host Name / IP:" (as shown in red)
- perform a "Broadcast Search" (if the exact computer name is not known)
- enter the known computer IP or AmsNetID

Add Route Dialog						X
Enter Host Name / IP:				Refresh Status		Broadcast Search
Host Name	Connected	Address	AMS NetId	TwinCAT	OS Vers	ion Comment
Enter dest	ination	compute	er name			
& activate	"Enter	Host Nai	me / IP"			
Davida Marca (Taraa))	_		_	Dauta Marra (Danu		MY-PC
Route Name (Target):			_	Route Name (Rem	otej:	
AmsNetId:				 Target Route Project 		Remote Route
Transport Type:	TCP/IP		•	 Static 		 Static
Address Info:				 Temporary 		 Temporary
💿 Host Name 🛛 🔿 I	P Address					
Connection Timeout (s):	5	ł	* *	r		
		_		Add Route		Close

Fig. 50: specify the PLC for access by the TwinCAT System Manager: selection of the target system

Once the target system has been entered, it is available for selection as follows (the correct password may have to be entered beforehand):



After confirmation with "OK" the target system can be accessed via the Visual Studio shell.

Adding devices

In the project folder explorer on the left of the Visual Studio shell user interface, select "Devices" within the

element "I/O", then right-click to open a context menu and select "Scan" or start the action via

menu bar. The TwinCAT System Manager may first have to be set to "Config mode" via $\overset{4}{\models}$ or via the menu "TwinCAT" \rightarrow "Restart TwinCAT (Config Mode)".

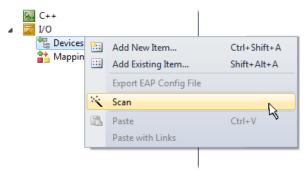


Fig. 51: Select "Scan"

Confirm the warning message, which follows, and select the "EtherCAT" devices in the dialog:

in the

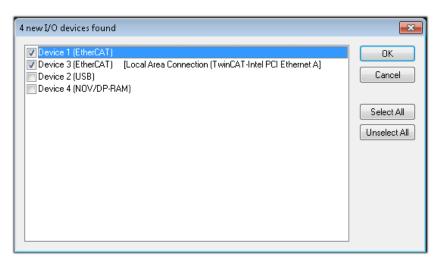


Fig. 52: Automatic detection of I/O devices: selection of the devices to be integrated

Confirm the message "Find new boxes", in order to determine the terminals connected to the devices. "Free Run" enables manipulation of input and output values in "Config Mode" and should also be acknowledged.

Based on the <u>example configuration [> 50]</u> described at the beginning of this section, the result is as follows:

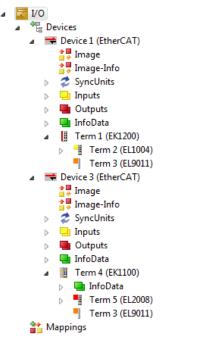


Fig. 53: Mapping of the configuration in VS shell of the TwinCAT 3 environment

The whole process consists of two stages, which can also be performed separately (first determine the devices, then determine the connected elements such as boxes, terminals, etc.). A scan (search function) can also be initiated by selecting "Device ..." from the context menu, which then only reads the elements below which are present in the configuration:



۵

Image: Provide and the provided and the pr	Add Existing Item Remove Change NetId Save Device 1 (EtherCAT) As. Append EtherCAT Cmd Append Dynamic Container Online Reset	Ctrl+Shift+A Shift+Alt+A Del
	Online Reload Online Delete Scan	
	Change Id Change To	Ą
	Сору	Ctrl+C
*	Cut	Ctrl+X
	Paste	Ctrl+V
	Paste with Links	
	Independent Project File	
	Disable	

Fig. 54: Reading of individual terminals connected to a device

This functionality is useful if the actual configuration is modified at short notice.

Programming the PLC

TwinCAT PLC Control is the development environment for generating the controller in different program environments: TwinCAT PLC Control supports all languages described in IEC 61131-3. There are two text-based languages and three graphical languages.

- Text-based languages
 - Instruction List (IL)
 - Structured Text (ST)
- Graphical languages
 - Function Block Diagram (FBD)
 - Ladder Diagram (LD)
 - The Continuous Function Chart Editor (CFC)
 - Sequential Function Chart (SFC)

The following section refers solely to Structured Text (ST).

In order to create a programming environment, a PLC subproject is added to the example project via the context menu of the "PLC" in the project folder explorer by selecting "Add New Item....":

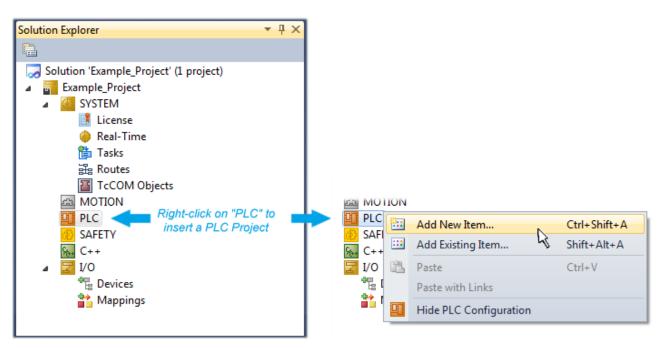


Fig. 55: Adding the programming environment in "PLC"

In the dialog that opens, select "Standard PLC project" and enter "PLC_example" as project name, for example, and select a corresponding directory:

Add New Item - Example	e_Project				8 X
Installed Templates		Sort by:	Default	• III 🔳	Search Installed Templates
Plc Templates Online Templates			Standard PLC Project	Plc Templates	Type: Plc Templates Creates a new TwinCAT PLC project
			Empty PLC Project	Plc Templates	containing a task and a program.
Name:	PLC_example				
Location:	C:\my_tc3_proje	cts\Examp	le_Project\Example_Proje	ct\ ▼ [Browse
					Add Cancel

Fig. 56: Specifying the name and directory for the PLC programming environment

The "Main" program, which already exists due to selecting "Standard PLC project", can be opened by double-clicking on "PLC_example_project" in "POUs". The following user interface is shown for an initial project:

🚥 Example_Project - Microsoft Visual Studio (Admin	istrator)	
	CAT TwinSAFE PLC Tools Scope Window Help	
: 🔁 • 🖽 • 💕 🔜 🥥 🕹 🛍 • 🔍		- 12
I 🖓 🖓 🖕 I 🔐 🚨 🗖 🖉 🔨 🔞 🔍 "		
Solution Explorer	MAIN × 1 PROGRAM MAIN VAR BND_VAR 1 N VAR N VAR N VAR	
⊳ 🔁 V0		
Ready	🛃 Ln 1 Col 1 Ch 1 IN	Si

Fig. 57: Initial "Main" program for the standard PLC project

Now example variables and an example program have been created for the next stage of the process:

	CAT TwinSAFE PLC Tools Scope Window Help					
🋅 🕶 🗁 🛃 🎒 👗 🛍 🛍 🕫 – 🔍 – 💭 – 🖳 🕨 Release 📼 TwinCAT RT (x64) 🔤 🏄 SGR 🔤 🚽						
🖓 🖓 🖕 💀 🚾 🙋 🛠 🎯 🔞 🐦 👘 remote-PLC 🔹 🗸 i PLC_example 🔹 🖅 🕨 = 🚭 🖄 🗊 🖷 🔿 🙄						
lution Explorer 🔹	A MAIN ×					
	1 PROGRAM MAIN					
Solution 'Example_Project' (1 project)	▲ ² VAR					
Example_Project	3 HOWLCHCEFT : BOOL := IROE;					
SYSTEM	4 nRotateUpper : WORD :=16#8000;					
MOTION	5 nRotateLower : WORD :=16#01;					
PLC	6 =					
PLC_example	7 bEL1004_Ch4 AT%I* : BOOL;					
PLC_example Project	8 9 nEL2008 value AT%0* : BYTE:					
External Types						
References	10 END_VAR					
GVLs	1 (* Program example *)					
POUs	E 2 IF bEL1004_Ch4 THEN					
MAIN (PRG)	3 IF nSwitchCtrl THEN					
VISUs	<pre>4 nSwitchCtrl := FALSE;</pre>					
PLC_example.tmc	5 nRotateLower := ROL(nRotateLower, 2);					
∡ Big PicTask (PicTask)	<pre>6 nRotateUpper := ROR(nRotateUpper, 2);</pre>					
	7 nEL2008_value := WORD_TO_BYTE (nRotateLower OR nRotateUpper);					
PLC_example Instance	8 END_IF					
PicTask Inputs	9 ELSE					
MAIN.bEL1004 Ch4	If NOT nSwitchCtrl THEN					
PlcTask Outputs	11 nSwitchCtrl := TRUE;					
MAIN.nEL2008_value	12 END_IF 13 END_IF					
SAFETY	13 END_IF					
% C++	***					

Fig. 58: Example program with variables after a compile process (without variable integration)

The control program is now created as a project folder, followed by the compile process:





Fig. 59: Start program compilation

The following variables, identified in the ST/PLC program with "AT%", are then available under "Assignments" in the project folder explorer:

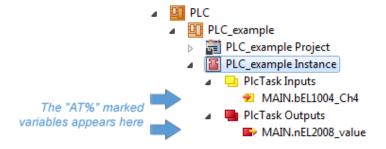

Assigning variables

Via the menu of an instance – variables in the "PLC" context, use the "Modify Link..." option to open a window to select a suitable process object (PDO) for linking:



 PLC PLC_example PLC_example Project PLC_example Instance PLC_example Instance 		
MAIN.bEL1004_Ch4	1	Change Link
PIcTask Outputs MAIN.nEL2008 value	X	Clear Link(s)
SAFETY		Goto Link Variable
% C++		Take Name Over from linked Variable
⊳ <mark>⊠</mark> I/O		Move Address
		Online Write '0'
		Online Write '1'
	→3	Online Write
	→3	Online Force
	-Ж	Release Force
	2	Add to Watch
	×	Remove from Watch

Fig. 60: Creating the links between PLC variables and process objects

In the window that opens, the process object for the "bEL1004_Ch4" BOOL-type variable can be selected from the PLC configuration tree:

Search: X Show Variables I/O Devices Unused Device 1 [EtherCAT] Exclude disabled Continuous SyncUnits Exclude same Image WeState > IX 1526.0, BIT [0.1] Soft by Address New Variable Types Show Variable Types Input > IX 26.3, BIT [0.1] Matching Type Input > IX 26.3, BIT [0.1] Matching Size VeState > IX 1524.0, BIT [0.1] Matching Size Vestate > IX 1526.0, BIT [0.1] Show Dialog Variable Name Hand over WeState > IX 1522.0, BIT [0.1] Take over	Attach Variable MAIN.bEL1004_Ch4 (Input)	— ×-
Cancel OK	<pre>I/0 Devices Device 1 (EtherCAT) SyncUnits Curreferenced> Curr</pre>	 Unused Used and unused Exclude disabled Exclude other Devices Exclude same Image Show Tooltips Sort by Address Show Variable Types Matching Type Matching Size All Types Array Mode Offsets Continuous Show Dialog Variable Name Hand over Take over

Fig. 61: Selecting BOOL-type PDO

According to the default setting, only certain PDO objects are now available for selection. In this example, the input of channel 4 of the EL1004 terminal is selected for linking. In contrast, the checkbox "All types" must be ticked to create the link for the output variables, in order to allocate a set of eight separate output bits to a byte variable in this case. The following diagram shows the whole process:

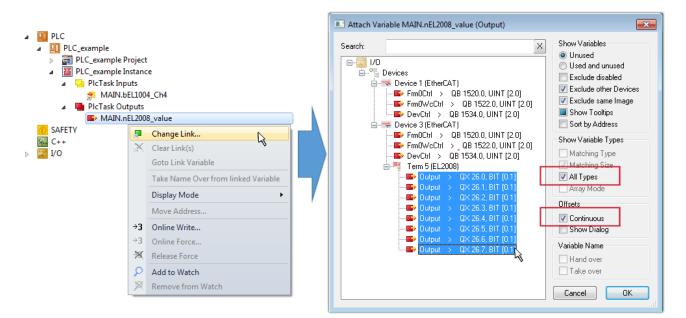


Fig. 62: Selecting several PDOs simultaneously: activate "Continuous" and "All types"

Note that the "Continuous" checkbox was also activated. This is designed to allocate the bits contained in the byte of the "nEL2008_value" variable sequentially to all eight selected output bits of the EL2008 Terminal. It is thus possible to subsequently address all eight outputs of the terminal in the program with a byte

corresponding to bit 0 for channel 1 to bit 7 for channel 8 of the PLC. A special symbol () on the yellow or red object of the variable indicates that a link exists. The links can also be checked by selecting "Goto Link Variable" from the context menu of a variable. The opposite linked object, in this case the PDO, is automatically selected:

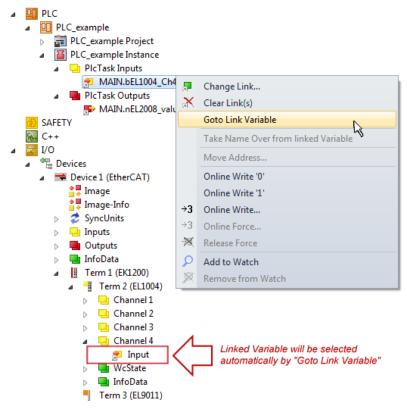


Fig. 63: Application of a "Goto Link Variable", using "MAIN.bEL1004_Ch4" as an example

The process of creating links can also be performed in the opposite direction, i.e. starting with individual PDOs to a variable. However, in this example, it would not be possible to select all output bits for the EL2008, since the terminal only makes individual digital outputs available. If a terminal has a byte, word,

integer or similar PDO, it is also possible to allocate this to a set of bit-standardized variables. Here, too, a "Goto Link Variable" can be executed in the other direction, so that the respective PLC instance can then be selected.

Note on type of variable assignment

The following type of variable assignment can only be used from TwinCAT version V3.1.4024.4 onwards and is only available for terminals with a microcontroller.

In TwinCAT, a structure can be created from the mapped process data of a terminal. An instance of this structure can then be created in the PLC, so it is possible to access the process data directly from the PLC without having to declare own variables.

The procedure for the EL3001 1-channel analog input terminal -10...+10 V is shown as an example.

- 1. First, the required process data must be selected in the "Process data" tab in TwinCAT.
- 2. After that, the PLC data type must be generated in the "PLC" tab via the check box.
- 3. The data type in the "Data Type" field can then be copied using the "Copy" button.

General	EtherCAT	Settings	Process Data	Plc	Startup	CoE - Online	Online	
⊡Cr	eate PLC Da	ata Type			-			
Pe	er Channel:							\sim
Data	Type:		MDP5001	_300_C3	8DD20B		Сору	
Link	To PLC							

Fig. 64: Creating a PLC data type

4. An instance of the data structure of the copied data type must then be created in the PLC.




Fig. 65: Instance_of_struct

- 5. Then the project folder must be created. This can be done either via the key combination "CTRL + Shift + B" or via the "Build" tab in TwinCAT.
- 6. The structure in the "PLC" tab of the terminal must then be linked to the created instance.

General EtherCAT Settings Pr	ocess Data Plc Startup CoE - Online Online	
Create PLC Data Type		
Per Channel:	\sim	
Data Type:	MDP5001_300_C38DD20B Copy	
Link To PLC		
	Select Axis PLC Reference ('Term 1 (EL3001)')	×
	(nono) MAIN.EL3001 (Untitled1 Instance)	OK Cancel
		Unused
		⊖ All

Fig. 66: Linking the structure

7. In the PLC, the process data can then be read or written via the structure in the program code.

MAIN	*	÷Þ	× .
	1		PROGRAM MAIN
	2		VAR
	з		EL3001 : MDP5001_300_C38DD20B;
	4		
	5		nVoltage: INT;
	6		END_VAR
	1		nVoltage := EL3001.MDP5001_300_Input.
	2		MDP5001_300_AI_Standard_Status
	3		MDP5001_300_AI_Standard_Value
	4		

Fig. 67: Reading a variable from the structure of the process data

Activation of the configuration

The allocation of PDO to PLC variables has now established the connection from the controller to the inputs

and outputs of the terminals. The configuration can now be activated with if or via the menu under "TwinCAT" in order to transfer the settings of the development environment to the runtime system. Confirm the messages "Old configurations will be overwritten!" and "Restart TwinCAT system in Run mode" with "OK". The corresponding assignments can be seen in the project folder explorer:

⊿	📸 Mappings
	📸 PLC_example Instance - Device 3 (EtherCAT) 1
	PLC_example Instance - Device 1 (EtherCAT) 1

A few seconds later, the corresponding status of the Run mode is displayed in the form of a rotating symbol

at the bottom right of the VS shell development environment. The PLC system can then be started as described below.

Starting the controller

Select the menu option "PLC" \rightarrow "Login" or click on \checkmark to link the PLC with the real-time system and load the control program for execution. This results in the message "*No program on the controller! Should the new program be loaded?*", which should be acknowledged with "Yes". The runtime environment is ready for

the program to be started by clicking on symbol *k*, the "F5" key or via "PLC" in the menu, by selecting "Start". The started programming environment shows the runtime values of individual variables:

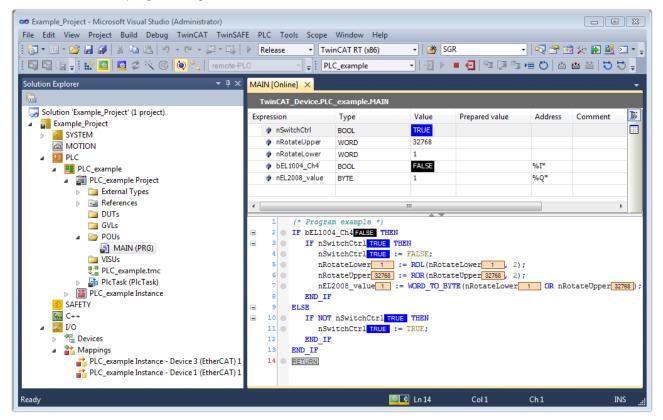


Fig. 68: TwinCAT 3 development environment (VS shell): logged-in, after program startup

The two operator control elements for stopping and logout result in the required action (also, "Shift + F5" can be used for stop, or both actions can be selected via the PLC menu).

6.2 TwinCAT Development Environment

The Software for automation TwinCAT (The Windows Control and Automation Technology) will be distinguished into:

- TwinCAT 2: System Manager (Configuration) & PLC Control (Programming)
- TwinCAT 3: Enhancement of TwinCAT 2 (Programming and Configuration takes place via a common Development Environment)

Details:

- TwinCAT 2:
 - · Connects I/O devices to tasks in a variable-oriented manner
 - · Connects tasks to tasks in a variable-oriented manner
 - Supports units at the bit level
 - Supports synchronous or asynchronous relationships
 - Exchange of consistent data areas and process images
 - Datalink on NT Programs by open Microsoft Standards (OLE, OCX, ActiveX, DCOM+, etc.)
 - Integration of IEC 61131-3-Software-SPS, Software- NC and Software-CNC within Windows NT/ 2000/XP/Vista, Windows 7, NT/XP Embedded, CE
 - Interconnection to all common fieldbusses
 - <u>More...</u>

Additional features:

- **TwinCAT 3** (eXtended Automation):
 - Visual Studio® integration
 - Choice of the programming language
 - Supports object orientated extension of IEC 61131-3
 - Usage of C/C++ as programming language for real time applications
 - · Connection to MATLAB®/Simulink®
 - Open interface for expandability
 - Flexible run-time environment
 - · Active support of multi-core- and 64 bit operating system
 - · Automatic code generation and project creation with the TwinCAT Automation Interface
 - <u>More...</u>

Within the following sections commissioning of the TwinCAT Development Environment on a PC System for the control and also the basically functions of unique control elements will be explained.

Please see further information to TwinCAT 2 and TwinCAT 3 at <u>http://infosys.beckhoff.com</u>.

6.2.1 Installation of the TwinCAT real-time driver

In order to assign real-time capability to a standard Ethernet port of an IPC controller, the Beckhoff real-time driver has to be installed on this port under Windows.

This can be done in several ways.

A: Via the TwinCAT Adapter dialog

In the System Manager call up the TwinCAT overview of the local network interfaces via Options \rightarrow Show Real Time Ethernet Compatible Devices.




Fig. 69: System Manager "Options" (TwinCAT 2)

This have to be called up by the menu "TwinCAT" within the TwinCAT 3 environment:

🚥 Example_Project - Microsoft Visual Studio ((Administrator)
File Edit View Project Build Debug	TwinCAT TwinSAFE PLC Tools Scope Window Help
: 🛅 • 🖽 • 💕 🛃 🥥 👗 🛍 🛍 🔊	Activate Configuration
i 🖸 🖓 🖕 🕴 🔛 🧧 🖉 🖄 🎯	Restart TwinCAT System
	Restart TwinConcer/IP Link Register
	Opulate Firmware/EEPROM
	Show Realtime Ethernet Compatible Devices
	File Handling
	EtherCAT Devices
	About TwinCAT

Fig. 70: Call up under VS Shell (TwinCAT 3)

B: Via TcRteInstall.exe in the TwinCAT directory

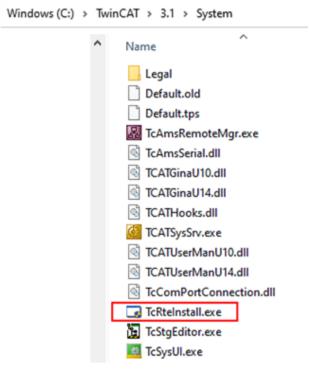


Fig. 71: TcRteInstall in the TwinCAT directory

In both cases, the following dialog appears:

Installation of TwinCAT RT-Ethernet Adapters	×
Ethernet Adapters	Update List
 Installed and ready to use devices LAN3 - TwinCAT-Intel PCI Ethernet Adapter (Gigabit) 	Install
IOOM - TwinCAT-Intel PCI Ethernet Adapter IG - TwinCAT-Intel PCI Ethernet Adapter (Gigabit)	Bind
Compatible devices Incompatible devices	Unbind
Disabled devices	Enable
	Disable
	Show Bindings

Fig. 72: Overview of network interfaces

Interfaces listed under "Compatible devices" can be assigned a driver via the "Install" button. A driver should only be installed on compatible devices.

A Windows warning regarding the unsigned driver can be ignored.

Alternatively an EtherCAT-device can be inserted first of all as described in chapter <u>Offline configuration</u> <u>creation, section "Creating the EtherCAT device"</u> [▶ 87] in order to view the compatible ethernet ports via its EtherCAT properties (tab "Adapter", button "Compatible Devices…"):

SYSTEM - Configuration SYSTEM - Configuration SY PLC - Configuration SY PLC - Configuration	General Adapter Et		oE - Online	
ian I/O - Configuration ian III I/O Devices		💿 OS (NDIS)	O PCI	O DPRAM
⊕ ➡ Device 1 (EtherCAT) ☐ Mappings	Description:	1G (Intel(R) PR0/	/1000 PM Networ	k Connection - Packet Sched
	Device Name:	\DEVICE\{2E554	A7C2-AF68-48A2-	A9B8-7C0DE2A44BF0}
	PCI Bus/Slot:			Search
	MAC Address:	00 01 05 05 f9 54	ł	Compatible Devices
	IP Address:	169.254.1.1 (255.	.255.0.0)	

Fig. 73: EtherCAT device properties (TwinCAT 2): click on "Compatible Devices..." of tab "Adapter"

TwinCAT 3: the properties of the EtherCAT device can be opened by double click on "Device .. (EtherCAT)" within the Solution Explorer under "I/O":



After the installation the driver appears activated in the Windows overview for the network interface (Windows Start \rightarrow System Properties \rightarrow Network)

🕹 1G Properties 💿 🛛				
General Authentication Advanced				
Connect using:				
TwinCAT-Intel PCI Ethernet Adapter (
This connection uses the following items:				
 Client for Microsoft Networks Elie and Printer Sharing for Microsoft Networks 				
QoS Packet Scheduler				
▼ TwinCAT Ethernet Protocol				
I <u>n</u> stall <u>U</u> ninstall P <u>r</u> operties				
Description				
Allows your computer to access resources on a Microsoft network.				
 Show icon in notification area when connected Notify me when this connection has limited or no connectivity 				
OK Cancel				

Fig. 74: Windows properties of the network interface


A correct setting of the driver could be:


thernet Adapters	Update List
Installed and ready to use devices in- March Landres (Gigabit)	Install
TwinCAT Ethernet Protocol Compatible devices Incompatible devices LAN-Verbindung 2 - Intel(R) 82579LM Gigabit Network Connection Disabled devices	Bind
	Unbind
	Enable
	Disable

Fig. 75: Exemplary correct driver setting for the Ethernet port

Other possible settings have to be avoided:

hernet Adapters	Update List
Installed and ready to use devices	Install
TwinCAT Ethernet Protocol for all Network Adapters Survey and the second sec	Bind
🖃 🕵 LAN-Verbindung - TwinCAT-Intel PCI Ethernet Adapter (Gigabit)	Unbind
— ✓ ▲ TwinCAT Ethernet Protocol for all Network Adapters — □ □ □ □ ↓ TwinCAT Rt-Ethernet Intermediate Driver	Enable
Compatible devices	Disable
WRONG: both driver enabled	Show Bindings

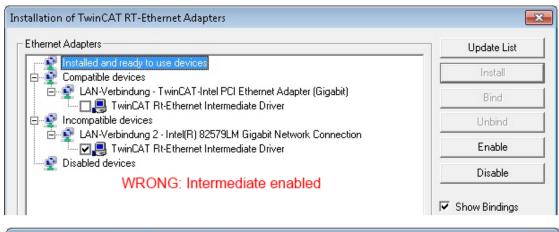

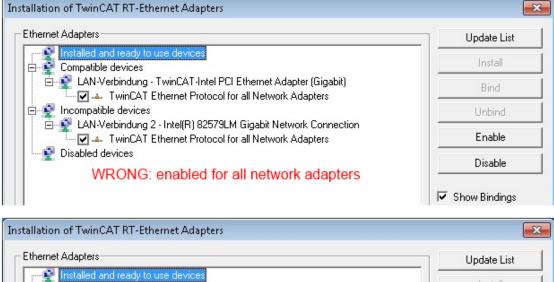

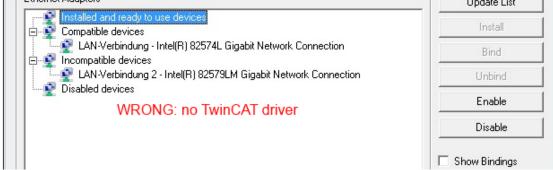


Fig. 76: Incorrect driver settings for the Ethernet port

IP address of the port used



IP address/DHCP

In most cases an Ethernet port that is configured as an EtherCAT device will not transport general IP packets. For this reason and in cases where an EL6601 or similar devices are used it is useful to specify a fixed IP address for this port via the "Internet Protocol TCP/IP" driver setting and to disable DHCP. In this way the delay associated with the DHCP client for the Ethernet port assigning itself a default IP address in the absence of a DHCP server is avoided. A suitable address space is 192.168.x.x, for example.

👍 1G Properties 📀 🔀
General Authentication Advanced
Connect using:
TwinCAT-Intel PCI Ethernet Adapter (Configure
This connection uses the following items:
🗹 🚚 QoS Packet Scheduler 🛛 🔼
V TwinCAT Ethernet Protocol
Internet Protocol (TCP/IP)
< > >
Install Uninstall Properties
Install Uninstall Properties Internet Protocol (TCP/IP) Properties
Internet Protocol (TCP/IP) Properties
Internet Protocol (TCP/IP) Properties
Internet Protocol (TCP/IP) Properties General You can get IP settings assigned automatically if your network suppor this capability. Otherwise, you need to ask your network administrator
Internet Protocol (TEP/IP) Properties General You can get IP settings assigned automatically if your network suppor this capability. Otherwise, you need to ask your network administrator the appropriate IP settings.

Fig. 77: TCP/IP setting for the Ethernet port

6.2.2 Notes regarding ESI device description

Installation of the latest ESI device description

The TwinCAT EtherCAT master/System Manager needs the device description files for the devices to be used in order to generate the configuration in online or offline mode. The device descriptions are contained in the so-called ESI files (EtherCAT Slave Information) in XML format. These files can be requested from the respective manufacturer and are made available for download. An *.xml file may contain several device descriptions.

The ESI files for Beckhoff EtherCAT devices are available on the Beckhoff website.

The ESI files should be stored in the TwinCAT installation directory.

Default settings:

- TwinCAT 2: C:\TwinCAT\IO\EtherCAT
- TwinCAT 3: C:\TwinCAT\3.1\Config\Io\EtherCAT

The files are read (once) when a new System Manager window is opened, if they have changed since the last time the System Manager window was opened.

A TwinCAT installation includes the set of Beckhoff ESI files that was current at the time when the TwinCAT build was created.

For TwinCAT 2.11/TwinCAT 3 and higher, the ESI directory can be updated from the System Manager, if the programming PC is connected to the Internet; by

- TwinCAT 2: Option → "Update EtherCAT Device Descriptions"
- TwinCAT 3: TwinCAT → EtherCAT Devices → "Update Device Descriptions (via ETG Website)..."

The <u>TwinCAT ESI Updater [86]</u> is available for this purpose.



The *.xml files are associated with *.xsd files, which describe the structure of the ESI XML files. To update the ESI device descriptions, both file types should therefore be updated.

Device differentiation

EtherCAT devices/slaves are distinguished by four properties, which determine the full device identifier. For example, the device identifier EL2521-0025-1018 consists of:

- · family key "EL"
- name "2521"
- type "0025"
- and revision "1018"

(EL2521-0025-1018) Revision

Fig. 78: Identifier structure

The order identifier consisting of name + type (here: EL2521-0025) describes the device function. The revision indicates the technical progress and is managed by Beckhoff. In principle, a device with a higher revision can replace a device with a lower revision, unless specified otherwise, e.g. in the documentation. Each revision has its own ESI description. See further notes.

Online description

If the EtherCAT configuration is created online through scanning of real devices (see section Online setup) and no ESI descriptions are available for a slave (specified by name and revision) that was found, the System Manager asks whether the description stored in the device should be used. In any case, the System Manager needs this information for setting up the cyclic and acyclic communication with the slave correctly.

TwinCAT System Manager				
New device type found (EL2521-0024 - 'EL2521-0024 1K. Pulse Train 24V DC Ausgang'). ProductRevision EL2521-0024-1016				
Use available online description instead				
Apply to all	Yes No			

Fig. 79: OnlineDescription information window (TwinCAT 2)

In TwinCAT 3 a similar window appears, which also offers the Web update:

TwinCAT XAE								
New device type found (EL2521-0024 - 'EL2521-0024 1K, Pulse Train 24V DC Ausgang'). ProductRevision EL2521-0024-1016								
Use available online description instead (YES) or try to load appropriate descriptions from the web								
Apply to all	Yes No Online ESI Update (Web access required)							

Fig. 80: Information window OnlineDescription (TwinCAT 3)

If possible, the Yes is to be rejected and the required ESI is to be requested from the device manufacturer. After installation of the XML/XSD file the configuration process should be repeated.

NOTICE						
Changing the "usual" configuration through a scan						
✓ If a scan discovers a device that is not yet known to TwinCAT, distinction has to be made between two cases. Taking the example here of the EL2521-0000 in the revision 1019						
a) no ESI is present for the EL2521-0000 device at all, either for the revision 1019 or for an older revision. The ESI must then be requested from the manufacturer (in this case Beckhoff).						
b) an ESI is present for the EL2521-0000 device, but only in an older revision, e.g. 1018 or 1017. In this case an in-house check should first be performed to determine whether the spare parts stock allows the integration of the increased revision into the configuration at all. A new/higher revision usually also brings along new features. If these are not to be used, work can continue without reservations with the previous revision 1018 in the configuration. This is also stated by the Beckhoff compatibility rule.						

Refer in particular to the chapter "<u>General notes on the use of Beckhoff EtherCAT IO components</u>" and for manual configuration to the chapter "<u>Offline configuration creation [▶ 87]</u>".

If the OnlineDescription is used regardless, the System Manager reads a copy of the device description from the EEPROM in the EtherCAT slave. In complex slaves the size of the EEPROM may not be sufficient for the complete ESI, in which case the ESI would be *incomplete* in the configurator. Therefore it's recommended using an offline ESI file with priority in such a case.

The System Manager creates for online recorded device descriptions a new file "OnlineDescription0000...xml" in its ESI directory, which contains all ESI descriptions that were read online.

OnlineDescriptionCache00000002.xml

Fig. 81: File OnlineDescription.xml created by the System Manager

Is a slave desired to be added manually to the configuration at a later stage, online created slaves are indicated by a prepended symbol ">" in the selection list (see Figure *Indication of an online recorded ESI of EL2521 as an example*).

Add Ether Search:	CAT device at port B (E-Bus) o el2	f Term 1 Name: Term 2	Multiple: 1 🚖	ОК
Туре:	EL2004 4Ch. [EL2032 2Ch. [•	Cancel Port B (E-Bus) C (Ethernet) X2 OUT'
	Extended Information	Show Hidden Devices	V Show Sub Groups	

Fig. 82: Indication of an online recorded ESI of EL2521 as an example

If such ESI files are used and the manufacturer's files become available later, the file OnlineDescription.xml should be deleted as follows:

- close all System Manager windows
- restart TwinCAT in Config mode
- delete "OnlineDescription0000...xml"
- restart TwinCAT System Manager

This file should not be visible after this procedure, if necessary press <F5> to update

OnlineDescription for TwinCAT 3.x

In addition to the file described above "OnlineDescription0000...xml", a so called EtherCAT cache with new discovered devices is created by TwinCAT 3.x, e.g. under Windows 7:

C:\User\[USERNAME]\AppData\Roaming\Beckhoff\TwinCAT3\Components\Base\EtherCATCache.xml (Please note the language settings of the OS!) You have to delete this file, too.

Faulty ESI file

If an ESI file is faulty and the System Manager is unable to read it, the System Manager brings up an information window.

TwinCAT	System Manager Error parsing EtherCAT device description! File 'C:\TwinCAT\Io\EtherCAT\Beckhoff EL9xx.xml' Device 'EL9999' PD0 'Status Us' is assigned to a not existing Sync Manager instance (0) Description will be ignored.	Microsoft Visual Studio Error parsing EtherCAT device description! File 'C:\TwinCAT\lo\EtherCAT\Beckhoff EL9xx.xml' Device 'EL9999' PDD 'Status Us' is assigned to a not existing Sync Manager instance (0) Description will be ignored.
	ОК	ОК

Fig. 83: Information window for faulty ESI file (left: TwinCAT 2; right: TwinCAT 3)

Reasons may include:

- Structure of the *.xml does not correspond to the associated *.xsd file \rightarrow check your schematics
- Contents cannot be translated into a device description \rightarrow contact the file manufacturer

6.2.3 TwinCAT ESI Updater

For TwinCAT 2.11 and higher, the System Manager can search for current Beckhoff ESI files automatically, if an online connection is available:

File	Edit	Actions	View	Options	Help
D	🖻 🛯	i 🖬 🖓	5 Q.	Upda	te EtherCAT Device Descriptions

Fig. 84: Using the ESI Updater (>= TwinCAT 2.11)

The call up takes place under:

"Options" \rightarrow "Update EtherCAT Device Descriptions"

Selection under TwinCAT 3:

👓 Example_Project - Microsoft Visual Stu	lio (Administrator)	
File Edit View Project Build Deb	g TwinCAT TwinSAFE PLC Tools Scope Window He	lp
🛅 • 🕮 • 💕 🛃 🥥 🖇 🛍 🛍	Activate Configuration	🕒 📲 😼 SGR 🔹 🖓
- E 🖸 🖓 🖕 E 🔛 🧧 🖉 🌾 (👸 🤷 Restart TwinCAT System	
	Restart TwinCA	
	Science nem	
	EtherCAT Devices	Update Device Descriptions (via ETG Website)
	About TwinCAT	Reload Device Descriptions
EtherCAT Slave Informatio	n (ESI) Updater	23
Vendor	Loaded URL	
EECK KOFF Beckhoff Automation G	mbH 0 http://download.beckhoff.com/download/Config/Eth	erCAT/XML_Device_Description/Beckhoff_EtherC
Target Path: C:\TwinC	AT\3.1\Config\Io\EtherCAT	OK Cancel

Fig. 85: Using the ESI Updater (TwinCAT 3)

The ESI Updater (TwinCAT 3) is a convenient option for automatic downloading of ESI data provided by EtherCAT manufacturers via the Internet into the TwinCAT directory (ESI = EtherCAT slave information). TwinCAT accesses the central ESI ULR directory list stored at ETG; the entries can then be viewed in the Updater dialog, although they cannot be changed there.

The call up takes place under:

"TwinCAT" \rightarrow "EtherCAT Devices" \rightarrow "Update Device Description (via ETG Website)...".

6.2.4 Distinction between Online and Offline

The distinction between online and offline refers to the presence of the actual I/O environment (drives, terminals, EJ-modules). If the configuration is to be prepared in advance of the system configuration as a programming system, e.g. on a laptop, this is only possible in "Offline configuration" mode. In this case all components have to be entered manually in the configuration, e.g. based on the electrical design.

If the designed control system is already connected to the EtherCAT system and all components are energised and the infrastructure is ready for operation, the TwinCAT configuration can simply be generated through "scanning" from the runtime system. This is referred to as online configuration.

In any case, during each startup the EtherCAT master checks whether the slaves it finds match the configuration. This test can be parameterised in the extended slave settings. Refer to <u>note "Installation of the latest ESI-XML device description" [\triangleright 82].</u>

For preparation of a configuration:

- the real EtherCAT hardware (devices, couplers, drives) must be present and installed
- the devices/modules must be connected via EtherCAT cables or in the terminal/ module strand in the same way as they are intended to be used later
- · the devices/modules be connected to the power supply and ready for communication

• TwinCAT must be in CONFIG mode on the target system.

The online scan process consists of:

- <u>detecting the EtherCAT device [92]</u> (Ethernet port at the IPC)
- <u>detecting the connected EtherCAT devices [> 93]</u>. This step can be carried out independent of the preceding step
- <u>troubleshooting</u> [▶ 96]

The <u>scan with existing configuration</u> [▶ <u>97</u>] can also be carried out for comparison.

6.2.5 **OFFLINE** configuration creation

Creating the EtherCAT device

Create an EtherCAT device in an empty System Manager window.

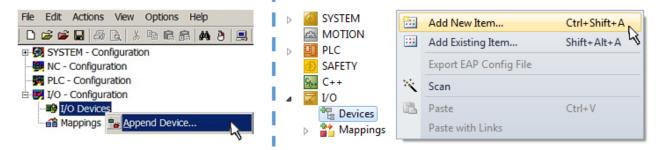


Fig. 86: Append EtherCAT device (left: TwinCAT 2; right: TwinCAT 3)

Select type "EtherCAT" for an EtherCAT I/O application with EtherCAT slaves. For the present publisher/ subscriber service in combination with an EL6601/EL6614 terminal select "EtherCAT Automation Protocol via EL6601".

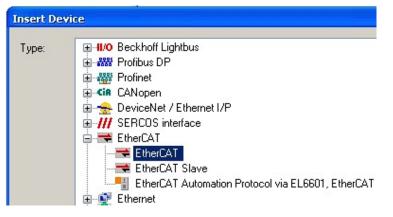


Fig. 87: Selecting the EtherCAT connection (TwinCAT 2.11, TwinCAT 3)

Then assign a real Ethernet port to this virtual device in the runtime system.

Device Found At	
(none) 100M (Intel(R) PR0/100 VE Network Connection - Packet Scheduler h LAN3 (Intel(R) 82541ER Based Gigabit Ethernet Controller - Packet Sc 1G (Intel(R) PR0/1000 PM Network Connection - Packet Scheduler M	r Cancel
	⊙ <u>U</u> nused ○ <u>A</u> ll

Fig. 88: Selecting the Ethernet port

This query may appear automatically when the EtherCAT device is created, or the assignment can be set/ modified later in the properties dialog; see Fig. "EtherCAT device properties (TwinCAT 2)".

SYSTEM - Configuration NC - Configuration PLC - Configuration I/O - Configuration I/O - Configuration I/O Devices Device 1 (EtherCAT)	General Adapter Et	
Appings		
	Device Name:	\DEVICE\{2E55A7C2-AF68-48A2-A9B8-7C0DE2A44BF0}
	PCI Bus/Slot:	Search
	MAC Address:	00 01 05 05 f9 54 Compatible Devices
	IP Address:	169.254.1.1 (255.255.0.0)
		Promiscuous Mode (use with Netmon/Wireshark only)
		Virtual Device Names
	O Adapter Referen	nce
	Adapter:	×
	Freerun Cycle (ms):	4

Fig. 89: EtherCAT device properties (TwinCAT 2)

TwinCAT 3: the properties of the EtherCAT device can be opened by double click on "Device .. (EtherCAT)" within the Solution Explorer under "I/O":

I/O
 ¹ Devices
 Device 1 (EtherCAT)



Selecting the Ethernet port

Ethernet ports can only be selected for EtherCAT devices for which the TwinCAT real-time driver is installed. This has to be done separately for each port. Please refer to the respective installation page [\blacktriangleright 76].

Defining EtherCAT slaves

Further devices can be appended by right-clicking on a device in the configuration tree.

🗄 🖅 I/O - Configuration	4	7	I/C)			
🗐 🏘 I/O Devices	1	⊿		Devices			
Device 1 (EtherCAT)	<u> </u> -		Þ	Device 1 (EtherCAT)	-	Add New Item	Ctrl+Shift+A
Mappings	<u> </u> -		Ľ.	Mappings		Add Existing Item	CLIFF AIFLA
	Ь.,				\times	Remove	

Fig. 90: Appending EtherCAT devices (left: TwinCAT 2; right: TwinCAT 3)

The dialog for selecting a new device opens. Only devices for which ESI files are available are displayed.

Only devices are offered for selection that can be appended to the previously selected device. Therefore, the physical layer available for this port is also displayed (Fig. "Selection dialog for new EtherCAT device", A). In the case of cable-based Fast-Ethernet physical layer with PHY transfer, then also only cable-based devices are available, as shown in Fig. "Selection dialog for new EtherCAT device". If the preceding device has several free ports (e.g. EK1122 or EK1100), the required port can be selected on the right-hand side (A).

Overview of physical layer

• "Ethernet": cable-based 100BASE-TX: couplers, box modules, devices with RJ45/M8/M12 connector

 "E-Bus": LVDS "terminal bus", EtherCAT plug-in modules (EJ), EtherCAT terminals (EL/ES), various modular modules

The search field facilitates finding specific devices (since TwinCAT 2.11 or TwinCAT 3).

earch:		Name:	Term 1	Multiple:	1	*	ОК
ype:	Beckhoff Automation GmbH STS Steven Couplers CX1100-0004 Ether(CAT) EK1100 Ether(CAT) EK1100 Ether(CAT) EK1100 Ether(CAT) EK1100 Ether(CAT) EK1101 Ether(CAT) EX100 E	components CU25xx) Is (EL6xxx) CAT Power supply (2 Coupler (2A E-Bus) Coupler (2A E-Bus, PD Coupler (2A E-Bus, PD Coupler (1A E-Bu D-Coupler (1A E-Bu D-Coupler (1A E-Bu D-Coupler (1A E-Bu CAT ID-Coupler (1A Xxx, ILxxxx-B110) nals	D switch) 2A E-Bus) OF, ID switch) s, 4 Ch. Dig. In, 3ms s, 8 Ch. Dig. In, 3ms s, 4 Ch. Dig. In, 3ms	, 4 Ch. Dig. Out 24\ , 8 Ch. Dig. Out 24\	/, 0,5A)	A E	Cancel Port A D B (Ethernet) C

Fig. 91: Selection dialog for new EtherCAT device

By default, only the name/device type is used as selection criterion. For selecting a specific revision of the device, the revision can be displayed as "Extended Information".

Add Ether	CAT device at port B (E-Bu	s) of Term 1 (EK1100)				23
Search:	el2521	Name:	Term 2	Multiple: 1	* *	ОК
Туре:	Ecck boff Automati Digital Output EL2521 10 EL2521-00 EL2521-00 EL2521-00 EL2521-00 EL2521-01 EL2521-01	120)	Cancel Port			
L	Extended Information	🥅 Show Hidde	n Devices	📝 Show Sub Gro	ups	

Fig. 92: Display of device revision

In many cases several device revisions were created for historic or functional reasons, e.g. through technological advancement. For simplification purposes (see Fig. "Selection dialog for new EtherCAT device") only the last (i.e. highest) revision and therefore the latest state of production is displayed in the selection dialog for Beckhoff devices. To show all device revisions available in the system as ESI descriptions tick the "Show Hidden Devices" check box, see Fig. "Display of previous revisions".

Add Ether	CAT device at port B (E-Bus) of Term	1 (EK1100)				[X]
Search:	el2521	Name:	Term 2	Multiple:	1	ОК
Туре:	EL2521 1Ch. Puk EL2521 1Ch. Puk EL2521 1Ch. Puk EL2521 1Ch. Puk EL2521-0024 Ch. Pu	EL2xxx) rain Output NEL25 se Train Output (E se Train Output (E se Train Output (E se Train Output (E se Train Output (E ulse Train 24V DC 1 n. Pulse Train 24V	L2521-0000-0000) L2521-0000-1016) L2521-0000-1017) L2521-0000-1020) L2521-0000-1021) Dutput (EL2521-0024-1) DC Output (EL2521-002 DC Output (EL2521-002	24-1016)	► b Groups	Cancel Port B (E-Bus) C (Ethernet) X2 OUT'

Fig. 93: Display of previous revisions

Device selection based on revision, compatibility

The ESI description also defines the process image, the communication type between master and slave/device and the device functions, if applicable. The physical device (firmware, if available) has to support the communication queries/settings of the master. This is backward compatible, i.e. newer devices (higher revision) should be supported if the EtherCAT master addresses them as an older revision. The following compatibility rule of thumb is to be assumed for Beckhoff EtherCAT Terminals/ Boxes/ EJ-modules:

device revision in the system >= device revision in the configuration

This also enables subsequent replacement of devices without changing the configuration (different specifications are possible for drives).

Example

If an EL2521-0025-1018 is specified in the configuration, an EL2521-0025-1018 or higher (-1019, -1020) can be used in practice.

(EL2521-0025-1018) Revision

Fig. 94: Name/revision of the terminal

If current ESI descriptions are available in the TwinCAT system, the last revision offered in the selection dialog matches the Beckhoff state of production. It is recommended to use the last device revision when creating a new configuration, if current Beckhoff devices are used in the real application. Older revisions should only be used if older devices from stock are to be used in the application.

In this case the process image of the device is shown in the configuration tree and can be parameterized as follows: linking with the task, CoE/DC settings, plug-in definition, startup settings, ...

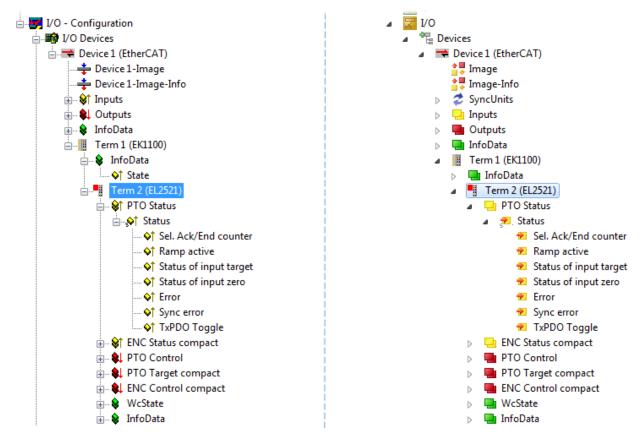


Fig. 95: EtherCAT terminal in the TwinCAT tree (left: TwinCAT 2; right: TwinCAT 3)

6.2.6 **ONLINE** configuration creation

Detecting/scanning of the EtherCAT device

The online device search can be used if the TwinCAT system is in CONFIG mode. This can be indicated by a symbol right below in the information bar:

- on TwinCAT 2 by a blue display "Config Mode" within the System Manager window: Config Mode .
- on TwinCAT 3 within the user interface of the development environment by a symbol ⁴

TwinCAT can be set into this mode:

- TwinCAT 2: by selection of in the Menubar or by "Actions" → "Set/Reset TwinCAT to Config Mode…"
- TwinCAT 3: by selection of 🧧 in the Menubar or by "TwinCAT" → "Restart TwinCAT (Config Mode)"

Online scanning in Config mode

The online search is not available in RUN mode (production operation). Note the differentiation between TwinCAT programming system and TwinCAT target system.

The TwinCAT 2 icon (2) or TwinCAT 3 icon (2) within the Windows-Taskbar always shows the TwinCAT mode of the local IPC. Compared to that, the System Manager window of TwinCAT 2 or the user interface of TwinCAT 3 indicates the state of the target system.

TwinCAT 2.x Systemmanager	TwinCAT target system mode_	TwinCAT	3.x GUI
Local (192.168.0.20.1.1) Config Mode			> (0
0:36		•• 🗟 🖾 💽	12:37 05.02.2015
	TwinCAT local system mode		

Fig. 96: Differentiation local/target system (left: TwinCAT 2; right: TwinCAT 3)

Right-clicking on "I/O Devices" in the configuration tree opens the search dialog.

🖶 🥵 SYSTEM - Configuration	4	I/O				
MC - Configuration Append Device			Devices Mappin		Add New Item Add Existing Item	Ctrl+Shift+A Shift+Alt+A
I/O - Configuration Import Device					Export EAP Config File	Shire Ale A
Mappings Scan Devices				***	Scan	
Paste Ctrl+V				Ľ.	Paste	Ctrl+V
Paste with Links Alt+Ctrl+V					Paste with Links	

Fig. 97: Scan Devices (left: TwinCAT 2; right: TwinCAT 3)

This scan mode attempts to find not only EtherCAT devices (or Ethernet ports that are usable as such), but also NOVRAM, fieldbus cards, SMB etc. However, not all devices can be found automatically.

TwinCAT System Manager	Microsoft Visual Studio
HINT: Not all types of devices can be found automatically	HINT: Not all types of devices can be found automatically
OK Cancel	OK Cancel

Fig. 98: Note for automatic device scan (left: TwinCAT 2; right: TwinCAT 3)

Ethernet ports with installed TwinCAT real-time driver are shown as "RT Ethernet" devices. An EtherCAT frame is sent to these ports for testing purposes. If the scan agent detects from the response that an EtherCAT slave is connected, the port is immediately shown as an "EtherCAT Device".

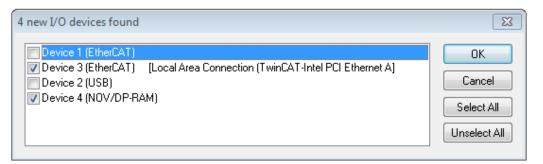


Fig. 99: Detected Ethernet devices

Via respective checkboxes devices can be selected (as illustrated in Fig. "Detected Ethernet devices" e.g. Device 3 and Device 4 were chosen). After confirmation with "OK" a device scan is suggested for all selected devices, see Fig.: "Scan query after automatic creation of an EtherCAT device".



BECKHOFF

Selecting the Ethernet port

Ethernet ports can only be selected for EtherCAT devices for which the TwinCAT real-time driver is installed. This has to be done separately for each port. Please refer to the respective installation page [1276].

Detecting/Scanning the EtherCAT devices



Online scan functionality

During a scan the master queries the identity information of the EtherCAT slaves from the slave EEPROM. The name and revision are used for determining the type. The respective devices are located in the stored ESI data and integrated in the configuration tree in the default state defined there.



Fig. 100: Example default state

NOTICE

Slave scanning in practice in series machine production

The scanning function should be used with care. It is a practical and fast tool for creating an initial configuration as a basis for commissioning. In series machine production or reproduction of the plant, however, the function should no longer be used for the creation of the configuration, but if necessary for <u>comparison [>97]</u> with the defined initial configuration.Background: since Beckhoff occasionally increases the revision version of the delivered products for product maintenance reasons, a configuration can be created by such a scan which (with an identical machine construction) is identical according to the device list; however, the respective device revision may differ from the initial configuration.

Example:

Company A builds the prototype of a machine B, which is to be produced in series later on. To do this the prototype is built, a scan of the IO devices is performed in TwinCAT and the initial configuration "B.tsm" is created. The EL2521-0025 EtherCAT terminal with the revision 1018 is located somewhere. It is thus built into the TwinCAT configuration in this way:

General	EtherCAT	DC	Process Da	ta	Startup	CoE - Online	Online
Type:		EL252	1-0025 1Ch.	Pul	se Train 2	4V DC Output	negative
Product	/Revision:	EL252	1-0025-1018	(09) d93052/	03fa0019)	

Fig. 101: Installing EthetCAT terminal with revision -1018

Likewise, during the prototype test phase, the functions and properties of this terminal are tested by the programmers/commissioning engineers and used if necessary, i.e. addressed from the PLC "B.pro" or the NC. (the same applies correspondingly to the TwinCAT 3 solution files).

The prototype development is now completed and series production of machine B starts, for which Beckhoff continues to supply the EL2521-0025-0018. If the commissioning engineers of the series machine production department always carry out a scan, a B configuration with the identical contents results again for each machine. Likewise, A might create spare parts stores worldwide for the coming series-produced machines with EL2521-0025-1018 terminals.

After some time Beckhoff extends the EL2521-0025 by a new feature C. Therefore the FW is changed, outwardly recognizable by a higher FW version and **a new revision -1019**. Nevertheless the new device naturally supports functions and interfaces of the predecessor version(s); an adaptation of "B.tsm" or even "B.pro" is therefore unnecessary. The series-produced machines can continue to be built with "B.tsm" and "B.pro"; it makes sense to perform a <u>comparative scan [> 97]</u> against the initial configuration "B.tsm" in order to check the built machine.

However, if the series machine production department now doesn't use "B.tsm", but instead carries out a scan to create the productive configuration, the revision **-1019** is automatically detected and built into the configuration:

General	EtherCAT	DC	Proce	ss Data	Startup	CoE - Online
Type:		EL252	1-0025	1Ch. P	ulse Train 2	4V DC Output r
Product	/Revision:	EL252	1-0025	1019 ((09d93052 /	03fb0019)

Fig. 102: Detection of EtherCAT terminal with revision -1019

This is usually not noticed by the commissioning engineers. TwinCAT cannot signal anything either, since a new configuration is essentially created. According to the compatibility rule, however, this means that no EL2521-0025-**1018** should be built into this machine as a spare part (even if this nevertheless works in the vast majority of cases).

In addition, it could be the case that, due to the development accompanying production in company A, the new feature C of the EL2521-0025-1019 (for example, an improved analog filter or an additional process data for the diagnosis) is discovered and used without in-house consultation. The previous stock of spare part devices are then no longer to be used for the new configuration "B2.tsm" created in this way. Þ if series machine production is established, the scan should only be performed for informative purposes for comparison with a defined initial configuration. Changes are to be made with care!

If an EtherCAT device was created in the configuration (manually or through a scan), the I/O field can be scanned for devices/slaves.

TwinCAT System Manager 🛛 🕅
Scan for boxes
Yes No




Fig. 103: Scan query after automatic creation of an EtherCAT device (left: TwinCAT 2; right: TwinCAT 3)

<u>.</u>	/O - Configuration			4	7	I/O *ि⊑ [Devices			
	Device 1 (EtherCAT)	Paria Box					➡ Device 1 (EtherCAT) ➡ Device 2 (EtherCAT)		Add New Item	Ctrl+Shift+A
	🖀 Mappings		:				Mappings	×	Add Existing Item.	Shift+Alt+A Del
		Scan Boxes						***	Online Delete Scan	
		∦ Cu <u>t</u>	Ctrl+X						Change Id Independent Projec	
		Change NetId						•	Disable	

Fig. 104: Manual scanning for devices on a specified EtherCAT device (left: TwinCAT 2; right: TwinCAT 3)

In the System Manager (TwinCAT 2) or the User Interface (TwinCAT 3) the scan process can be monitored via the progress bar at the bottom in the status bar.

Scanning	remote-PLC (123.45.67.89.1.1)	Config Mode	н
			-

Fig. 105: Scan progressexemplary by TwinCAT 2

The configuration is established and can then be switched to online state (OPERATIONAL).






Fig. 106: Config/FreeRun query (left: TwinCAT 2; right: TwinCAT 3)

In Config/FreeRun mode the System Manager display alternates between blue and red, and the EtherCAT device continues to operate with the idling cycle time of 4 ms (default setting), even without active task (NC, PLC).

TwinCAT 2.x	TwinCAT 3.x
Free Run	toggling

Fig. 107: Displaying of "Free Run" and "Config Mode" toggling right below in the status bar

🙊 🙊 🗞 🔨 🚳 🖹 🔍 🖓 🚳 🖉	i 🔝 🖪 🛃 🌮 🔨 🎯 🐂 🔍 <local> 🔹 🚽</local>
General EtherCAToggle Free Run State (Ctrl-F5)	Toggle Free Run State
General EtherCA Toggle Free Run State (Ctrl-F5)	Toggie Tree Kull State

Fig. 108: TwinCAT can also be switched to this state by using a button (left: TwinCAT 2; right: TwinCAT 3)

The EtherCAT system should then be in a functional cyclic state, as shown in Fig. Online display example.

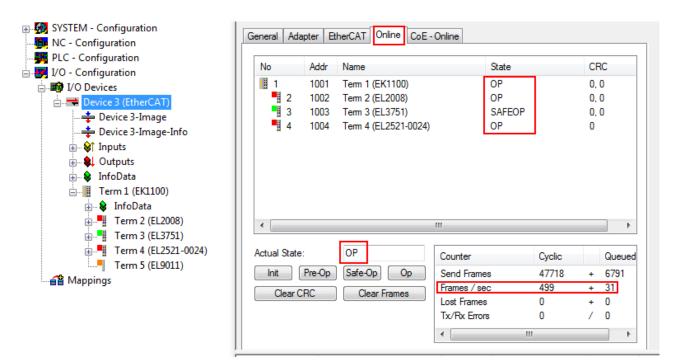


Fig. 109: Online display example

Please note:

- all slaves should be in OP state
- the EtherCAT master should be in "Actual State" OP
- "frames/sec" should match the cycle time taking into account the sent number of frames
- no excessive "LostFrames" or CRC errors should occur

The configuration is now complete. It can be modified as described under manual procedure [87].

Troubleshooting

Various effects may occur during scanning.

- An unknown device is detected, i.e. an EtherCAT slave for which no ESI XML description is available. In this case the System Manager offers to read any ESI that may be stored in the device. This case is described in the chapter "Notes regarding ESI device description".
- Device are not detected properly

Possible reasons include:

- $\circ\;$ faulty data links, resulting in data loss during the scan
- slave has invalid device description

The connections and devices should be checked in a targeted manner, e.g. via the emergency scan. Then re-run the scan.

🚍 📲 I/O Devices
🖻 🗮 Device 4 (EtherCAT)
🕂 🕂 Device 4-Image
🚽 📫 Device 4-Image-Info
庄 😪 💱 Inputs
庄 📲 🌒 Outputs
庄 😪 InfoData
庄 🌑 Box 1 (P30165940 R59302651)
Term 7 (EK0000)

Fig. 110: Faulty identification

In the System Manager such devices may be set up as EK0000 or unknown devices. Operation is not possible or meaningful.

RECKHOEE

Scan over existing Configuration

NOTICE

Change of the configuration after comparison

With this scan (TwinCAT 2.11 or 3.1) only the device properties vendor (manufacturer), device name and revision are compared at present! A "ChangeTo" or "Copy" should only be carried out with care, taking into consideration the Beckhoff IO compatibility rule (see above). The device configuration is then replaced by the revision found; this can affect the supported process data and functions.

If a scan is initiated for an existing configuration, the actual I/O environment may match the configuration exactly or it may differ. This enables the configuration to be compared.






Fig. 111: Identical configuration (left: TwinCAT 2; right: TwinCAT 3)

If differences are detected, they are shown in the correction dialog, so that the user can modify the configuration as required.

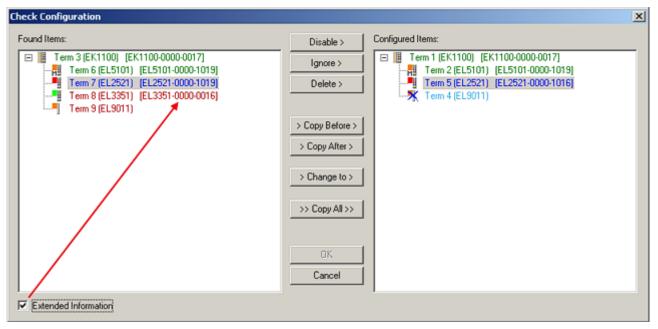


Fig. 112: Correction dialog

It is advisable to tick the "Extended Information" check box to reveal differences in the revision.

Color	Explanation
green	This EtherCAT slave matches the entry on the other side. Both type and revision match.
blue	This EtherCAT slave is present on the other side, but in a different revision. This other revision car have other default values for the process data as well as other/additional functions. If the found revision is higher than the configured revision, the slave may be used provided compatibility issues are taken into account.
	If the found revision is lower than the configured revision, it is likely that the slave cannot be used. The found device may not support all functions that the master expects based on the higher revision number.
light blue	This EtherCAT slave is ignored ("Ignore" button)
red	This EtherCAT slave is not present on the other side.
	 It is present, but in a different revision, which also differs in its properties from the one specified. The compatibility principle then also applies here: if the found revision is higher than the configured revision, use is possible provided compatibility issues are taken into account, since the successor devices should support the functions of the predecessor devices. If the found revision is lower than the configured revision, it is likely that the slave cannot be used. The found device may not support all functions that the master expects based on the higher revision number.

Device selection based on revision, compatibility

The ESI description also defines the process image, the communication type between master and slave/device and the device functions, if applicable. The physical device (firmware, if available) has to support the communication queries/settings of the master. This is backward compatible, i.e. newer devices (higher revision) should be supported if the EtherCAT master addresses them as an older revision. The following compatibility rule of thumb is to be assumed for Beckhoff EtherCAT Terminals/ Boxes/ EJ-modules:

device revision in the system >= device revision in the configuration

This also enables subsequent replacement of devices without changing the configuration (different specifications are possible for drives).

Example

If an EL2521-0025-1018 is specified in the configuration, an EL2521-0025-1018 or higher (-1019, -1020) can be used in practice.

<u>Name</u>	
(EL2521-0025-1018	3)
Revis	ion

Fig. 113: Name/revision of the terminal

If current ESI descriptions are available in the TwinCAT system, the last revision offered in the selection dialog matches the Beckhoff state of production. It is recommended to use the last device revision when creating a new configuration, if current Beckhoff devices are used in the real application. Older revisions should only be used if older devices from stock are to be used in the application.

In this case the process image of the device is shown in the configuration tree and can be parameterized as follows: linking with the task, CoE/DC settings, plug-in definition, startup settings, ...

ound Items:	Disable >	Configured Items:
Term 3 [EK1100] [EK1100-0000-0017] Term 6 (EL5101) [EL5101-0000-1019] Term 7 (EL2521) [EL2521-0000-1019] Term 8 (EL3351) (EL3351-0000-0016) Term 9 (EL9011)	Disable > Ignore > Delete > Copy Before > Copy After > Co	Term 1 [EK1100] [EK1100-0000-0017] Term 2 [EL5101) [EL5101-0000-1019] Term 5 [EL2521) [EL2521-0000-1016] Term 8 (EL3351) Term 4 (EL9011)

Fig. 114: Correction dialog with modifications

Once all modifications have been saved or accepted, click "OK" to transfer them to the real *.tsm configuration.

Change to Compatible Type

TwinCAT offers a function *Change to Compatible Type…* for the exchange of a device whilst retaining the links in the task.

⊟= Device 1 (EtherCAT)	4	:	🖶 Device 1 (EtherCAT)		
⊟-⊶∎ Box 1 (AX5101-0000-0011) ⊕- �↑ AT ■- Append Box	Þ	∔ ⊳	Drive 2 (AX5101-0000-0011) AT MDT		Add New Item
			WcState	•	Change to Compatible Type
InfoData Change to Compatible Type Add to Hot Connect Groups		2			Add to HotConnect group Delete from HotConnect group

Fig. 115: Dialog "Change to Compatible Type..." (left: TwinCAT 2; right: TwinCAT 3)

The following elements in the ESI of an EtherCAT device are compared by TwinCAT and assumed to be the same in order to decide whether a device is indicated as "compatible":

- Physics (e.g. RJ45, Ebus...)
- FMMU (additional ones are allowed)
- SyncManager (SM, additional ones are allowed)
- EoE (attributes MAC, IP)
- CoE (attributes SdoInfo, PdoAssign, PdoConfig, PdoUpload, CompleteAccess)
- FoE
- PDO (process data: Sequence, SyncUnit SU, SyncManager SM, EntryCount, Ent-ry.Datatype)

This function is preferably to be used on AX5000 devices.

Change to Alternative Type

The TwinCAT System Manager offers a function for the exchange of a device: Change to Alternative Type

🖮 📲 Term 1 (EK1100)	
🗄 象 InfoData	
Term 2 (EL1202)	_
🚔 Append Box	
	-
Change to Compatible 198-	
	T
Add to Hot Connect Groups	
Change to Alternative Type	EL1202-0100 2Ch. Fast Dig. Input 24V, 1µs, DC Latch
change to Alternative Type	222222 0200 2 cm r dst bigi input 244, 1ps, b c tatem

Fig. 116: TwinCAT 2 Dialog Change to Alternative Type

If called, the System Manager searches in the procured device ESI (in this example: EL1202-0000) for details of compatible devices contained there. The configuration is changed and the ESI-EEPROM is overwritten at the same time – therefore this process is possible only in the online state (ConfigMode).

6.2.7 EtherCAT subscriber configuration

In the left-hand window of the TwinCAT 2 System Manager or the Solution Explorer of the TwinCAT 3 Development Environment respectively, click on the element of the terminal within the tree you wish to configure (in the example: EL3751 Terminal 3).



Fig. 117: Branch element as terminal EL3751

In the right-hand window of the TwinCAT System Manager (TwinCAT 2) or the Development Environment (TwinCAT 3), various tabs are now available for configuring the terminal. And yet the dimension of complexity of a subscriber determines which tabs are provided. Thus as illustrated in the example above the terminal EL3751 provides many setup options and also a respective number of tabs are available. On the contrary by the terminal EL1004 for example the tabs "General", "EtherCAT", "Process Data" and "Online" are available only. Several terminals, as for instance the EL6695 provide special functions by a tab with its own terminal name, so "EL6695" in this case. A specific tab "Settings" by terminals with a wide range of setup options will be provided also (e.g. EL3751).

"General" tab

Name:	Term 6 (EL5001)	ld: 4
Туре:	EL5001 1Ch. SSI Encoder	
Comment:		A
	☐ Disabled	Create symbols 🗖

Fig. 118: "General" tab

Commissioning

BECKHOFF

Name	Name of the EtherCAT device
ld	Number of the EtherCAT device
Туре	EtherCAT device type
Comment	Here you can add a comment (e.g. regarding the system).
Disabled	Here you can deactivate the EtherCAT device.
Create symbols	Access to this EtherCAT slave via ADS is only available if this control box is activated.

"EtherCAT" tab

General	EtherCAT	Process Data Startup Co	E - Online Online
Type:		EL5001 1Ch. SSI Encoder	
Product	/Revision:	EL5001-0000-0000	
Auto Inc	c Addr:	FFFD	
EtherC/	AT Addr: 🕅	1004 븣	Advanced Settings
EtherC/ Previou		1004 🗧 Term 5 (EL6021) - B	Advanced Settings
			Advanced Settings
			Advanced Settings

Fig. 119: "EtherCAT" tab

Type Product/Revision Auto Inc Addr.	EtherCAT device type Product and revision number of the EtherCAT device Auto increment address of the EtherCAT device. The auto increment address can be used for addressing each EtherCAT device in the communication ring through its physical position. Auto increment addressing is used during the start-up phase when the EtherCAT master allocates addresses to the EtherCAT devices. With auto increment addressing the first EtherCAT slave in the ring has the address 0000 _{hex} . For each further slave the address is decremented by 1 (FFFF _{hex} , FFFE _{hex} etc.).
EtherCAT Addr.	Fixed address of an EtherCAT slave. This address is allocated by the EtherCAT master during the start-up phase. Tick the control box to the left of the input field in order to modify the default value.
Previous Port	Name and port of the EtherCAT device to which this device is connected. If it is possible to connect this device with another one without changing the order of the EtherCAT devices in the communication ring, then this combination field is activated and the EtherCAT device to which this device is to be connected can be selected.
Advanced Settings	This button opens the dialogs for advanced settings.

The link at the bottom of the tab points to the product page for this EtherCAT device on the web.

"Process Data" tab

Indicates the configuration of the process data. The input and output data of the EtherCAT slave are represented as CANopen process data objects (**P**rocess **D**ata **O**bjects, PDOs). The user can select a PDO via PDO assignment and modify the content of the individual PDO via this dialog, if the EtherCAT slave supports this function.

byric ii	lanager:				PDO List:							
SM	Size	Туре	Flags		Index	Size	Name	Flags		SM	SU	
0	246	MbxOut			0x1A00	5.0	Channel 1			3	0	
1	246	MbxIn										
2	0	Outputs										
3	5	Inputs										
		: (0x1C13):		1	PDO Content	: (0x1A00):						
		: (UX IC I3):		1	Index	Size	Offs	Name	Туре		Default (he:	x)
⊘ 0x1/		: (UX IC 13):			Index 0x3101:01	Size 1.0	Offs 0.0	Status	BYTE		Default (he:	x)
		: (UKICI3):			Index	Size	Offs				Default (he:	x)
₽ 0x1/		: (DKTCT3):			Index 0x3101:01	Size 1.0	Offs 0.0 1.0	Status Value	BYTE UDINT		Default (he:	x)

Fig. 120: "Process Data" tab

The process data (PDOs) transferred by an EtherCAT slave during each cycle are user data which the application expects to be updated cyclically or which are sent to the slave. To this end the EtherCAT master (Beckhoff TwinCAT) parameterizes each EtherCAT slave during the start-up phase to define which process data (size in bits/bytes, source location, transmission type) it wants to transfer to or from this slave. Incorrect configuration can prevent successful start-up of the slave.

For Beckhoff EtherCAT EL, ES, EM, EJ and EP slaves the following applies in general:

- The input/output process data supported by the device are defined by the manufacturer in the ESI/XML description. The TwinCAT EtherCAT Master uses the ESI description to configure the slave correctly.
- The process data can be modified in the System Manager. See the device documentation. Examples of modifications include: mask out a channel, displaying additional cyclic information, 16-bit display instead of 8-bit data size, etc.
- In so-called "intelligent" EtherCAT devices the process data information is also stored in the CoE directory. Any changes in the CoE directory that lead to different PDO settings prevent successful startup of the slave. It is not advisable to deviate from the designated process data, because the device firmware (if available) is adapted to these PDO combinations.

If the device documentation allows modification of process data, proceed as follows (see Figure *Configuring the process data*).

- A: select the device to configure
- B: in the "Process Data" tab select Input or Output under SyncManager (C)
- D: the PDOs can be selected or deselected
- H: the new process data are visible as linkable variables in the System Manager The new process data are active once the configuration has been activated and TwinCAT has been restarted (or the EtherCAT master has been restarted)
- E: if a slave supports this, Input and Output PDO can be modified simultaneously by selecting a socalled PDO record ("predefined PDO settings").

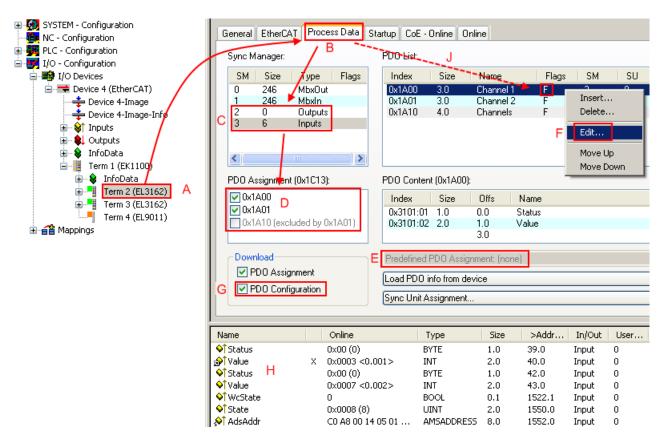


Fig. 121: Configuring the process data

Manual modification of the process data

According to the ESI description, a PDO can be identified as "fixed" with the flag "F" in the PDO overview (Fig. *Configuring the process data*, J). The configuration of such PDOs cannot be changed, even if TwinCAT offers the associated dialog ("Edit"). In particular, CoE content cannot be displayed as cyclic process data. This generally also applies in cases where a device supports download of the PDO configuration, "G". In case of incorrect configuration the EtherCAT slave usually refuses to start and change to OP state. The System Manager displays an "invalid SM cfg" logger message: This error message ("invalid SM IN cfg" or "invalid SM OUT cfg") also indicates the reason for the failed start.

A <u>detailed description [108]</u> can be found at the end of this section.

"Startup" tab

The *Startup* tab is displayed if the EtherCAT slave has a mailbox and supports the *CANopen over EtherCAT* (CoE) or *Servo drive over EtherCAT* protocol. This tab indicates which download requests are sent to the mailbox during startup. It is also possible to add new mailbox requests to the list display. The download requests are sent to the slave in the same order as they are shown in the list.

ransition	Protocol	Index	Data	Comment
<ps></ps>	CoE	0x1C12:00	0x00 (0)	clear sm pdos (0x1C12)
<ps></ps>	CoE	0x1C13:00	0x00 (0)	clear sm pdos (0x1C13)
<ps></ps>	CoE	0x1C13:01	0x1A00 (6656)	download pdo 0x1C13:01 index
<ps></ps>	CoE	0x1C13:00	0x01 (1)	download pdo 0x1C13 count

Fig. 122: "Startup" tab

Column	Description
Transition	Transition to which the request is sent. This can either be
	• the transition from pre-operational to safe-operational (PS), or
	 the transition from safe-operational to operational (SO).
	If the transition is enclosed in "<>" (e.g. <ps>), the mailbox request is fixed and cannot be modified or deleted by the user.</ps>
Protocol	Type of mailbox protocol
Index	Index of the object
Data	Date on which this object is to be downloaded.
Comment	Description of the request to be sent to the mailbox

Move Up	This button moves the selected request up by one position in the list.
Move Down	This button moves the selected request down by one position in the list.
New	This button adds a new mailbox download request to be sent during startup.
Delete	This button deletes the selected entry.
Edit	This button edits an existing request.

"CoE - Online" tab

The additional *CoE* - *Online* tab is displayed if the EtherCAT slave supports the *CANopen over EtherCAT* (CoE) protocol. This dialog lists the content of the object list of the slave (SDO upload) and enables the user to modify the content of an object from this list. Details for the objects of the individual EtherCAT devices can be found in the device-specific object descriptions.

Update Li	st 📃 Auto Update		
Advanced All Objects			
Index	Name	Flags	Value
1000	Device type	RO	0x0000000 (0)
1008	Device name	RO	EL5001-0000
1009	Hardware version	RO	V00.01
100A	Software version	RO	V00.08
Ė∽ 1011:0	Restore default parameter	RW	>1<
1011:01	SubIndex 001	RW	0
Ė∽ 1018:0	Identity object	RO	> 4 <
1018:01	Vendor id	RO	0x0000002 (2)
1018:02	Product code	RO	0x13893052 (327757906)
1018:03	Revision number	RO	0x0000000 (0)
1018:04	Serial number	RO	0x0000001 (1)
Ė 1A00:0	TxPDO 001 mapping	RO	>2<
	Subindex 001	RO	0x3101:01, 8
1A00:02	Subindex 002	RO	0x3101:02, 32
Ė… 1C00:0	SM type	RO	> 4 <
1C00:01	SubIndex 001	RO	0x01 (1)
1C00:02	SubIndex 002	RO	0x02 (2)
1C00:03	SubIndex 003	RO	0x03 (3)
1C00:04	SubIndex 004	RO	0x04 (4)
É 1C13:0	SM 3 PDO assign (inputs)	RW	>1<
1C13:01	SubIndex 001	RW	0x1A00 (6656)
Ė - 3101:0	Inputs	RO P	>2<
3101:01	Status	RO P	0x41 (65)
3101:02	Value	RO P	0x0000000 (0)
⊡ 4061:0	Feature bits	RW	> 4 <
4061:01	disable frame error	RW	FALSE
4061:02	enbale power failure Bit	RW	FALSE
4061:03	enable inhibit time	RW	FALSE
4061:04	enable test mode	RW	FALSE
4066	SSI-coding	RW	Gray code (1)
4067	SSI-baudrate	RW	500 kBaud (3)
4068	SSI-frame type	RW	Multitum 25 bit (0)
4069	SSI frame size	RW	0x0019 (25)
406A	Data length	RW	0x0018 (24)
406B	Min. inhibit time[us]	RW	0x0000 (0)

Fig. 123: "CoE - Online" tab

Object list display

Column	Description		
Index	Index	Index and sub-index of the object	
Name	Nam	Name of the object	
Flags	RW	The object can be read, and data can be written to the object (read/write)	
	RO	The object can be read, but no data can be written to the object (read only)	
	Р	An additional P identifies the object as a process data object.	
Value	Value of the object		

Update List	The Update list button updates all objects in the displayed list		
Auto Update	If this check box is selected, the content of the objects is updated automatically.		
Advanced	The <i>Advanced</i> button opens the <i>Advanced Settings</i> dialog. Here you can specify which objects are displayed in the list.		

Advanced Settings		×
Backup	Dictionary Image: Online - via SDO Information All Objects Mappable Objects (RxPDO) Mappable Objects (TxPDO) Backup Objects Settings Objects Image: Offline - via EDS File Image: Offline - via EDS File	
1	OK Cancel	

Fig. 124: Dialog "Advanced settings"

Online - via SDO InformationIf this option button is selected, the list of the objects included in the object
list of the slave is uploaded from the slave via SDO information. The list
below can be used to specify which object types are to be uploaded.Offline - via EDS FileIf this option button is selected, the list of the objects included in the object
list is read from an EDS file provided by the user.

"Online" tab

General EtherCAT Process Data Startup CoE - Online Online				
State Machi	ne			
Init Bootstrap			OP	
Pre-Op	Safe-Op		OP	
Ор	Clear Error	Requested State:	jor	
DLL Status				
Port A:	Carrier / Open			
FOIL A.				
Port B:	ort B: Carrier / Open			
Port C:	No Carrier / Closed			
Port D:	Port D: No Carrier / Closed			
File Access over EtherCAT				

Fig. 125: "Online" tab

State Machine	
Init	This button attempts to set the EtherCAT device to the Init state.
Pre-Op	This button attempts to set the EtherCAT device to the pre-operational state.
Ор	This button attempts to set the EtherCAT device to the operational state.
Bootstrap	This button attempts to set the EtherCAT device to the <i>Bootstrap</i> state.
Safe-Op	This button attempts to set the EtherCAT device to the safe-operational state.
Clear Error	This button attempts to delete the fault display. If an EtherCAT slave fails during change of state it sets an error flag.
	Example: An EtherCAT slave is in PREOP state (pre-operational). The master now requests the SAFEOP state (safe-operational). If the slave fails during change of state it sets the error flag. The current state is now displayed as ERR PREOP. When the <i>Clear Error</i> button is pressed the error flag is cleared, and the current state is displayed as PREOP again.
Current State	Indicates the current state of the EtherCAT device.
Requested State	Indicates the state requested for the EtherCAT device.

DLL Status

Indicates the DLL status (data link layer status) of the individual ports of the EtherCAT slave. The DLL status can have four different states:

Status	Description
No Carrier / Open	No carrier signal is available at the port, but the port is open.
No Carrier / Closed	No carrier signal is available at the port, and the port is closed.
Carrier / Open	A carrier signal is available at the port, and the port is open.
Carrier / Closed	A carrier signal is available at the port, but the port is closed.

File Access over EtherCAT

Download	With this button a file can be written to the EtherCAT device.
Upload	With this button a file can be read from the EtherCAT device.

"DC" tab (Distributed Clocks)

General EtherCAT Settings	DC Process Data Startup CoE - Online Diag History Online	
Operation Mode:	DC-Synchron (input based)	
	Advanced Settings	

Fig. 126: "DC" tab (Distributed Clocks)

Operation Mode Options (optional):

- FreeRun
- SM-Synchron
- DC-Synchron (Input based)
- DC-Synchron

Advanced Settings... Advanced settings for readjustment of the real time determinant TwinCAT-clock

Detailed information to Distributed Clocks is specified on http://infosys.beckhoff.com:

 $\label{eq:Fieldbus Components} \rightarrow \mbox{EtherCAT Terminals} \rightarrow \mbox{EtherCAT System documentation} \rightarrow \mbox{EtherCAT basics} \rightarrow \mbox{Distributed Clocks}$

6.2.7.1 Detailed description of Process Data tab

Sync Manager

Lists the configuration of the Sync Manager (SM).

If the EtherCAT device has a mailbox, SM0 is used for the mailbox output (MbxOut) and SM1 for the mailbox input (MbxIn).

SM2 is used for the output process data (outputs) and SM3 (inputs) for the input process data.

If an input is selected, the corresponding PDO assignment is displayed in the PDO Assignment list below.

PDO Assignment

PDO assignment of the selected Sync Manager. All PDOs defined for this Sync Manager type are listed here:

- If the output Sync Manager (outputs) is selected in the Sync Manager list, all RxPDOs are displayed.
- If the input Sync Manager (inputs) is selected in the Sync Manager list, all TxPDOs are displayed.

The selected entries are the PDOs involved in the process data transfer. In the tree diagram of the System Manager these PDOs are displayed as variables of the EtherCAT device. The name of the variable is identical to the *Name* parameter of the PDO, as displayed in the PDO list. If an entry in the PDO assignment list is deactivated (not selected and greyed out), this indicates that the input is excluded from the PDO assignment. In order to be able to select a greyed out PDO, the currently selected PDO has to be deselected first.

Activation of PDO assignment

- ✓ If you have changed the PDO assignment, in order to activate the new PDO assignment,
- a) the EtherCAT slave has to run through the PS status transition cycle (from pre-operational to safe-operational) once (see <u>Online tab [▶ 106]</u>),
- b) and the System Manager has to reload the EtherCAT slaves

🟙 button for TwinCAT 2 or 🧟 button for TwinCAT 3)

PDO list

List of all PDOs supported by this EtherCAT device. The content of the selected PDOs is displayed in the *PDO Content* list. The PDO configuration can be modified by double-clicking on an entry.

Column	Description		
Index	PDO index	PDO index.	
Size	Size of the	PDO in bytes.	
Name	Name of the PDO. If this PDO is assigned to a Sync Manager, it appears as a variable of the slave with this parameter as the name.		
Flags	F	Fixed content: The content of this PDO is fixed and cannot be changed by the System Manager.	
	Μ	Mandatory PDO. This PDO is mandatory and must therefore be assigned to a Sync Manager! Consequently, this PDO cannot be deleted from the <i>PDO Assignment</i> list	
SM	Sync Manager to which this PDO is assigned. If this entry is empty, this PDO does not take part in the process data traffic.		
SU	Sync unit to which this PDO is assigned.		

PDO Content

Indicates the content of the PDO. If flag F (fixed content) of the PDO is not set the content can be modified.

Download

If the device is intelligent and has a mailbox, the configuration of the PDO and the PDO assignments can be downloaded to the device. This is an optional feature that is not supported by all EtherCAT slaves.

PDO Assignment

If this check box is selected, the PDO assignment that is configured in the PDO Assignment list is downloaded to the device on startup. The required commands to be sent to the device can be viewed in the <u>Startup [b_103]</u> tab.

PDO Configuration

If this check box is selected, the configuration of the respective PDOs (as shown in the PDO list and the PDO Content display) is downloaded to the EtherCAT slave.

6.2.8 Import/Export of EtherCAT devices with SCI and XTI

SCI and XTI Export/Import – Handling of user-defined modified EtherCAT slaves

6.2.8.1 Basic principles

An EtherCAT slave is basically parameterized through the following elements:

- Cyclic process data (PDO)
- Synchronization (Distributed Clocks, FreeRun, SM-Synchron)
- CoE parameters (acyclic object dictionary)

Note: Not all three elements may be present, depending on the slave.

For a better understanding of the export/import function, let's consider the usual procedure for IO configuration:

- The user/programmer processes the IO configuration in the TwinCAT system environment. This involves all input/output devices such as drives that are connected to the fieldbuses used. Note: In the following sections, only EtherCAT configurations in the TwinCAT system environment are considered.
- For example, the user manually adds devices to a configuration or performs a scan on the online system.
- This results in the IO system configuration.
- On insertion, the slave appears in the system configuration in the default configuration provided by the vendor, consisting of default PDO, default synchronization method and CoE StartUp parameter as defined in the ESI (XML device description).
- If necessary, elements of the slave configuration can be changed, e.g. the PDO configuration or the synchronization method, based on the respective device documentation.

It may become necessary to reuse the modified slave in other projects in this way, without having to make equivalent configuration changes to the slave again. To accomplish this, proceed as follows:


- Export the slave configuration from the project,
- · Store and transport as a file,
- Import into another EtherCAT project.

TwinCAT offers two methods for this purpose:

- within the TwinCAT environment: Export/Import as **xti** file or
- outside, i.e. beyond the TwinCAT limits: Export/Import as sci file.

An example is provided below for illustration purposes: an EL3702 terminal with standard setting is switched to 2-fold oversampling (blue) and the optional PDO "StartTimeNextLatch" is added (red):


BECKHOFF

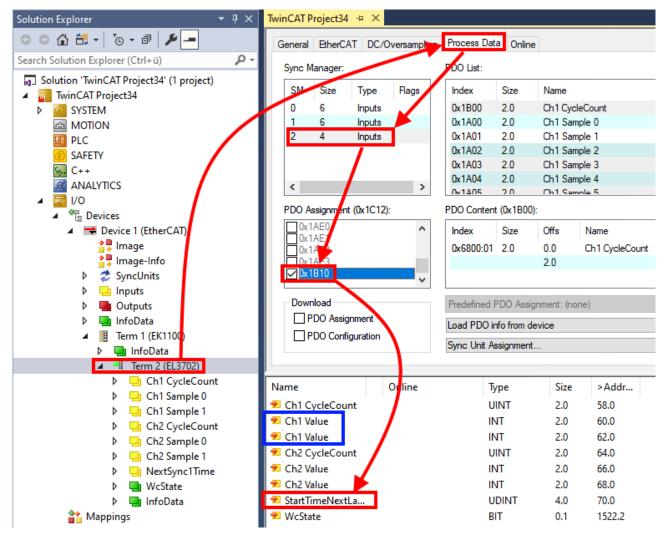

The two methods for exporting and importing the modified terminal referred to above are demonstrated below.

6.2.8.2 Procedure within TwinCAT with xti files


Each IO device can be exported/saved individually:



The xti file can be stored:



and imported again in another TwinCAT system via "Insert Existing item":



6.2.8.3 Procedure within and outside TwinCAT with sci file


Note regarding availability (2021/01)

The SCI method is available from TwinCAT 3.1 build 4024.14.

The Slave Configuration Information (SCI) describes a specific complete configuration for an EtherCAT slave (terminal, box, drive...) based on the setting options of the device description file (ESI, EtherCAT Slave Information). That is, it includes PDO, CoE, synchronization.

Export:

 select a single device via the menu (multiple selection is also possible): TwinCAT → EtherCAT Devices → Export SCI.

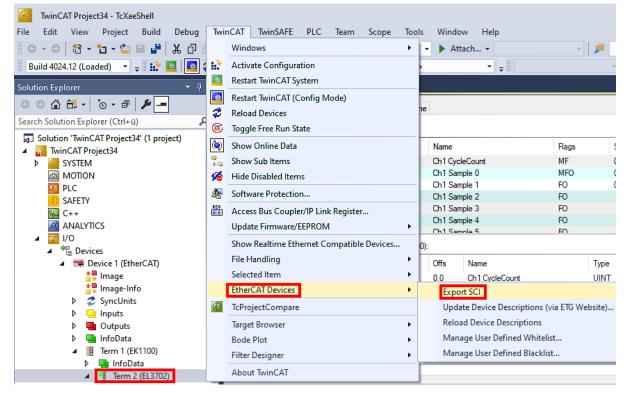

• If TwinCAT is offline (i.e. if there is no connection to an actual running controller) a warning message may appear, because after executing the function the system attempts to reload the EtherCAT segment. However, in this case this is not relevant for the result and can be acknowledged by clicking OK:

TcXaeShell	×
Init12\IO: Set State TComObj SAFEOP: Set Objects (2) to SAFEOP > AdsError: 1823 (0x71f, '')	>
ОК	

- BECKHOFF
 - A description may also be provided:

Export SCI based on specification 1.0.12.3 (Draft)				
Name	EL3702 with added StartTimeNextLatch			
Description	just an example for a specific description			
Options	Keep Modules			
options	Keep FSoE Module Information			
	AoE Set AmsNetId			
	EoE Set MAC and IP			
	CoE Set cycle time (0x1C3x.2)			
	Export			

• Explanation of the dialog box:

Name		Name of the SCI, assigned by the user.
Descriptio	n	Description of the slave configuration for the use case, assigned by the user.
Options	Keep modules	If a slave supports modules/slots, the user can decide whether these are to be exported or whether the module and device data are to be combined during export.
	AoE Set AmsNetId	The configured AmsNetId is exported. Usually this is network-dependent and cannot always be determined in advance.
	EoE Set MAC and IP	The configured virtual MAC and IP addresses are stored in the SCI. Usually these are network-dependent and cannot always be determined in advance.
	CoE Set cycle time(0x1C3x.2)	The configured cycle time is exported. Usually this is network-dependent and cannot always be determined in advance.
ESI	- ·	Reference to the original ESI file.
Export		Save SCI file.

• A list view is available for multiple selections (*Export multiple SCI files*):

	Export SCI		x
Inputs	All None	Name	Box 1 (Drive1)
 Outputs InfoData 	Box 1 (Drive1) Box 2 (Drive1)	-	
 ✓ ➡ Box 1 (Drive1) ✓ ➡ Module 1 (Position Mode) 	Dox 2 (Driver)	Description	 1 of 2 axis is configured (in position mode) Distributed clocks synchronization is enabled Software position range limit (0x607D) is set
 Position Inputs Position Outputs 			
▷ 🛄 WcState ▷ 🛄 InfoData			
Box 2 (Drive1)			
Mappings		Options	✓ Keep Modules
📸 NC-Task 1 SAF - Device 1 (EtherCAT) 1			AoE Set AmsNetId [10.35.16.42.2.2]
			EoE Set MAC and IP [02 01 05 10 03 e9 192.1
			CoE Set cycle time (0x1C3x.2)
			Export

- Selection of the slaves to be exported:
 - All:
 - All slaves are selected for export.

- None: All slaves are deselected.
- The sci file can be saved locally:

Dateiname:	EL3702 with added StartTimeNextLatch.sci
Dateityp:	SCI file (*.sci)


• The export takes place:

Ex	port SCI ba	sed on specification 1.0.12.3 (Draft)
Na	ame	EL3702 with added StartTimeNextLatch
De	escription	just an example for a specific description
	SCI Created	×
0		e 'C:\TwinCAT\3.1\Config\lo\EtherCAT\EL3702 with added
0		lextLatch.sci' was created Open Folder Close
0		IextLatch.sci' was created Image: Close Open Folder Close
0		lextLatch.sci' was created Open Folder Close
0		IextLatch.sci' was created Open Folder Close AoE Set AmsNetId EoE Set MAC and IP

Import

- An sci description can be inserted manually into the TwinCAT configuration like any normal Beckhoff device description.
- The sci file must be located in the TwinCAT ESI path, usually under: C:\TwinCAT\3.1\Config\lo\EtherCAT

	EL3702 with added StartTimeNextLatch.sci	11.01.2021 13:29	SCI-Datei	6 KB
• 0	pen the selection dialog:			



- BECKHOFF
 - Display SCI devices and select and insert the desired device:

Add EtherCAT device at port B (E-Bus) of Term 3 (EL1008)					
Search: EL370 Name: Term 4 Multiple: 1 🜩	OK				
Type: Beckhoff Automation GmbH & Co. KG	Cancel				
 Analog Input Terminals XFC (EL3xxx) EL3702 2Ch. Ana. Input +/-10V, DIFF, Oversample EL3702-0015 2Ch. Ana. Input +/-150mV, DIFF, Oversample (SCI) Term 2 (EL3702) with Start 	Port A D				
Extended Information Show Hidden Devices Show Sub Check Connector Show preconfigured Devices (SCI)	B (E-Bus) C Groups				

Additional Notes

• Settings for the SCI function can be made via the general Options dialog (Tools → Options → TwinCAT → Export SCI):

Options					?	×
Search Options (Ctrl+E) Tabs and Windows Task List Trust Settings Web Browser Projects and Solutions Source Control Work Items Text Editor Debugging NuGet Package Manager Text Templating Text Templating TwinCAT Export SCI Measurement	^	*	Default export options AoE Add AmsNetId CoE Set cycle time 0x1C3x.2 EoE Add IP and MAC Keep Modules Generic Reload Devices	False True False True Yes		~
 PLC Environment TwinSAFE Environment XAE Environment 	*	lf t	F Add AmsNetId he slaves supports AoE the init comm e SCI, otherwise the flags "GenerateOv			
-				ОК	Cance	

Explanation of the settings:

Default export	AoE Set AmsNetId	Default setting whether the configured AmsNetId is exported.
options	CoE Set cycle time(0x1C3x.2)	Default setting whether the configured cycle time is exported.
	EoE Set MAC and IP	Default setting whether the configured MAC and IP addresses are exported.
	Keep modules	Default setting whether the modules persist.
Generic	Reload Devices	Setting whether the Reload Devices command is executed before the SCI export. This is strongly recommended to ensure a consistent slave configuration.



SCI error messages are displayed in the TwinCAT logger output window if required:

Output		
Show output from:	Export SCI	- <u>4</u> <u>4</u> <u>4</u> <u>4</u> <u>4</u>
02/07/2020 14:0	09:17 Reload Devices	
02/07/2020 14:0	09:18 Box 1 (Drive1) No EtherCAT Slave	Information (ESI) available for 'Box 1 (Drive1)

6.3 General Commissioning Instructions for an EtherCAT Slave

This summary briefly deals with a number of aspects of EtherCAT Slave operation under TwinCAT. More detailed information on this may be found in the corresponding sections of, for instance, the <u>EtherCAT</u> <u>System Documentation</u>.

Diagnosis in real time: WorkingCounter, EtherCAT State and Status

Generally speaking an EtherCAT Slave provides a variety of diagnostic information that can be used by the controlling task.

This diagnostic information relates to differing levels of communication. It therefore has a variety of sources, and is also updated at various times.

Any application that relies on I/O data from a fieldbus being correct and up to date must make diagnostic access to the corresponding underlying layers. EtherCAT and the TwinCAT System Manager offer comprehensive diagnostic elements of this kind. Those diagnostic elements that are helpful to the controlling task for diagnosis that is accurate for the current cycle when in operation (not during commissioning) are discussed below.

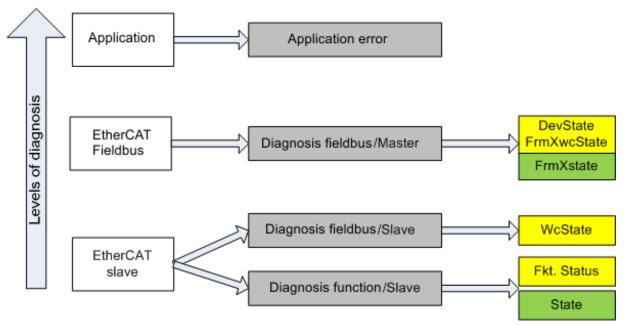


Fig. 127: Selection of the diagnostic information of an EtherCAT Slave

In general, an EtherCAT Slave offers

 communication diagnosis typical for a slave (diagnosis of successful participation in the exchange of process data, and correct operating mode) This diagnosis is the same for all slaves.

as well as

• function diagnosis typical for a channel (device-dependent) See the corresponding device documentation

The colors in Fig. Selection of the diagnostic information of an EtherCAT Slave also correspond to the variable colors in the System Manager, see Fig. Basic EtherCAT Slave Diagnosis in the PLC.

Colour	Meaning
yellow	Input variables from the Slave to the EtherCAT Master, updated in every cycle
red	Output variables from the Slave to the EtherCAT Master, updated in every cycle
green	Information variables for the EtherCAT Master that are updated acyclically. This means that it is possible that in any particular cycle they do not represent the latest possible status. It is therefore useful to read such variables through ADS.

Fig. *Basic EtherCAT Slave Diagnosis in the PLC* shows an example of an implementation of basic EtherCAT Slave Diagnosis. A Beckhoff EL3102 (2-channel analogue input terminal) is used here, as it offers both the communication diagnosis typical of a slave and the functional diagnosis that is specific to a channel. Structures are created as input variables in the PLC, each corresponding to the process image.

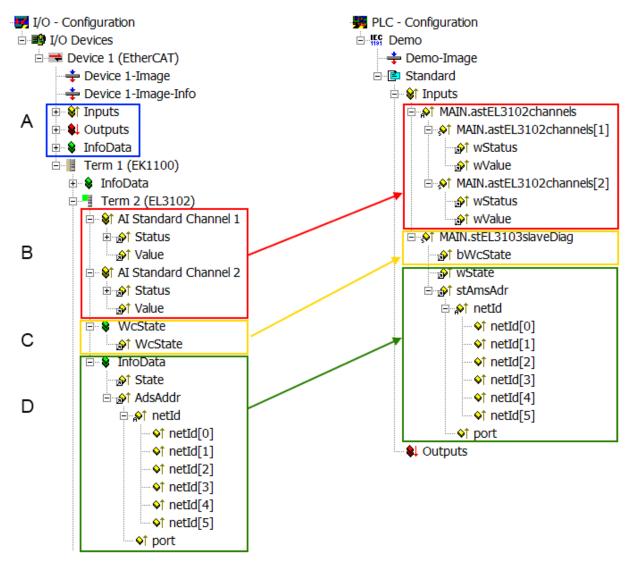


Fig. 128: Basic EtherCAT Slave Diagnosis in the PLC

The following aspects are covered here:

BECKHOFF

Code	Function	Implementation	Application/evaluation
A	The EtherCAT Master's diagnostic information		At least the DevState is to be evaluated for the most recent cycle in the PLC.
	updated acyclically (yellow) or provided acyclically (green).		The EtherCAT Master's diagnostic information offers many more possibilities than are treated in the EtherCAT System Documentation. A few keywords:
			CoE in the Master for communication with/through the Slaves
			Functions from <i>TcEtherCAT.lib</i>
			Perform an OnlineScan
В	In the example chosen (EL3102) the EL3102 comprises two analogue input channels that transmit a single function status for the most recent cycle.	 Status the bit significations may be found in the device documentation other devices may supply more information, or none that is typical of a slave 	In order for the higher-level PLC task (or corresponding control applications) to be able to rely on correct data, the function status must be evaluated there. Such information is therefore provided with the process data for the most recent cycle.
С	For every EtherCAT Slave that has cyclic process data, the Master displays, using what is known as a WorkingCounter, whether the slave is participating successfully and without error in the cyclic exchange of process data. This important, elementary information is therefore provided for the most recent cycle in the System Manager	WcState (Working Counter) 0: valid real-time communication in the last cycle 1: invalid real-time communication This may possibly have effects on the process data of other Slaves that are located in the same SyncUnit	In order for the higher-level PLC task (or corresponding control applications) to be able to rely on correct data, the communication status of the EtherCAT Slave must be evaluated there. Such information is therefore provided with the process data for the most recent cycle.
	 at the EtherCAT Slave, and, with identical contents as a collective variable at the 		
	EtherCAT Master (see Point A)		
	for linking.		
D	Diagnostic information of the EtherCAT Master which, while it is represented at the slave for linking, is actually determined by the Master for the Slave concerned and represented there. This information cannot be characterized as real-time, because it	State current Status (INITOP) of the Slave. The Slave must be in OP (=8) when operating normally. <i>AdsAddr</i>	Information variables for the EtherCAT Master that are updated acyclically. This means that it is possible that in any particular cycle they do not represent the latest possible status. It is therefore possible to read such variables through ADS.
	 is only rarely/never changed, except when the system starts up is itself determined acyclically (e.g. EtherCAT Status) 	The ADS address is useful for communicating from the PLC/task via ADS with the EtherCAT Slave, e.g. for reading/writing to the CoE. The AMS-NetID of a slave corresponds to the AMS-NetID of the EtherCAT Master; communication with the individual Slave is possible via the <i>port</i> (= EtherCAT address).	

NOTICE

Diagnostic information

It is strongly recommended that the diagnostic information made available is evaluated so that the application can react accordingly.

CoE Parameter Directory

The CoE parameter directory (CanOpen-over-EtherCAT) is used to manage the set values for the slave concerned. Changes may, in some circumstances, have to be made here when commissioning a relatively complex EtherCAT Slave. It can be accessed through the TwinCAT System Manager, see Fig. *EL3102, CoE directory*:

General EtherCA	T DC Process Data St	artup CoE	Online Online	
Update	List 📃 Auto Upo	late 🔽 S	Single Update 🔽	
Advance	ed			
Add to Sta	rtup Offline Data		Module OD (Aol	
Index	Name	Flags	Value	
	Al Inputs Ch.2	RO	> 17 <	
	Channels	RO	>2<	
Ė~ 8000:0	Al Settings Ch.1	RW	> 24 <	
8000:01	Enable user scale	RW	FALSE	
8000:02	Presentation	RW	Signed (0)	
8000:05	Siemens bits	RW	FALSE	
8000:06	Enable filter	RW	FALSE	
8000:07	Enable limit 1	RW	FALSE	
80:008	Enable limit 2	RW	FALSE	
A0:008	Enable user calibration	RW	FALSE	
8000:0B	Enable vendor calibration	RW	TRUE	

Fig. 129: EL3102, CoE directory



EtherCAT System Documentation

The comprehensive description in the <u>EtherCAT System Documentation</u> (EtherCAT Basics --> CoE Interface) must be observed!

A few brief extracts:

- Whether changes in the online directory are saved locally in the slave depends on the device. EL terminals (except the EL66xx) are able to save in this way.
- The user must manage the changes to the StartUp list.

Commissioning aid in the TwinCAT System Manager

Commissioning interfaces are being introduced as part of an ongoing process for EL/EP EtherCAT devices. These are available in TwinCAT System Managers from TwinCAT 2.11R2 and above. They are integrated into the System Manager through appropriately extended ESI configuration files.

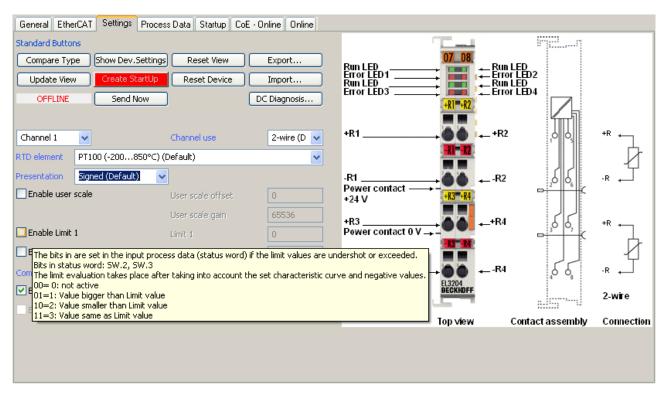


Fig. 130: Example of commissioning aid for a EL3204

This commissioning process simultaneously manages

- CoE Parameter Directory
- DC/FreeRun mode
- the available process data records (PDO)

Although the "Process Data", "DC", "Startup" and "CoE-Online" that used to be necessary for this are still displayed, it is recommended that, if the commissioning aid is used, the automatically generated settings are not changed by it.

The commissioning tool does not cover every possible application of an EL/EP device. If the available setting options are not adequate, the user can make the DC, PDO and CoE settings manually, as in the past.

EtherCAT State: automatic default behaviour of the TwinCAT System Manager and manual operation

After the operating power is switched on, an EtherCAT Slave must go through the following statuses

- INIT
- PREOP
- SAFEOP
- OP

to ensure sound operation. The EtherCAT Master directs these statuses in accordance with the initialization routines that are defined for commissioning the device by the ES/XML and user settings (Distributed Clocks (DC), PDO, CoE). See also the section on "Principles of <u>Communication, EtherCAT State Machine [] 28]</u>" in this connection. Depending how much configuration has to be done, and on the overall communication, booting can take up to a few seconds.

The EtherCAT Master itself must go through these routines when starting, until it has reached at least the OP target state.

The target state wanted by the user, and which is brought about automatically at start-up by TwinCAT, can be set in the System Manager. As soon as TwinCAT reaches the status RUN, the TwinCAT EtherCAT Master will approach the target states.

Standard setting

The advanced settings of the EtherCAT Master are set as standard:

- EtherCAT Master: OP
- Slaves: OP

This setting applies equally to all Slaves.

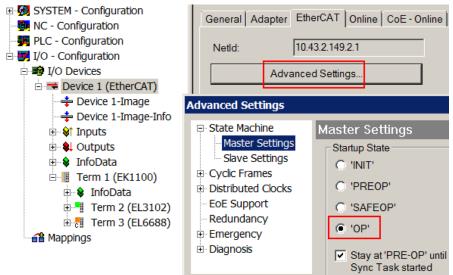


Fig. 131: Default behaviour of the System Manager

In addition, the target state of any particular Slave can be set in the "Advanced Settings" dialogue; the standard setting is again OP.

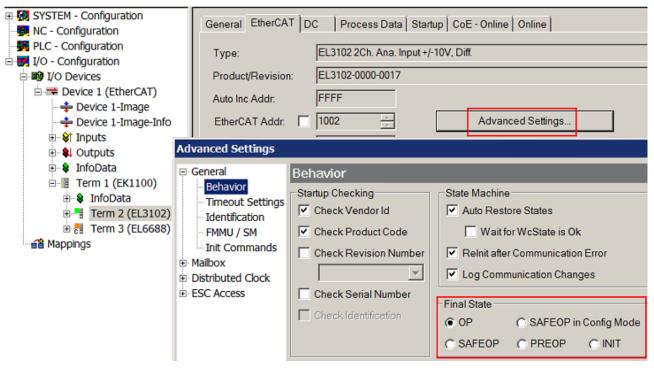


Fig. 132: Default target state in the Slave

Manual Control

There are particular reasons why it may be appropriate to control the states from the application/task/PLC. For instance:

- · for diagnostic reasons
- to induce a controlled restart of axes

• because a change in the times involved in starting is desirable

In that case it is appropriate in the PLC application to use the PLC function blocks from the *TcEtherCAT.lib*, which is available as standard, and to work through the states in a controlled manner using, for instance, *FB_EcSetMasterState*.

It is then useful to put the settings in the EtherCAT Master to INIT for master and slave.

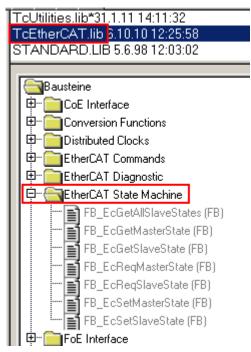


Fig. 133: PLC function blocks

Note regarding E-Bus current

EL/ES terminals are placed on the DIN rail at a coupler on the terminal strand. A Bus Coupler can supply the EL terminals added to it with the E-bus system voltage of 5 V; a coupler is thereby loadable up to 2 A as a rule. Information on how much current each EL terminal requires from the E-bus supply is available online and in the catalogue. If the added terminals require more current than the coupler can supply, then power feed terminals (e.g. EL9410) must be inserted at appropriate places in the terminal strand.

The pre-calculated theoretical maximum E-Bus current is displayed in the TwinCAT System Manager as a column value. A shortfall is marked by a negative total amount and an exclamation mark; a power feed terminal is to be placed before such a position.

BECKHOFF

General Ad	apter EtherCAT Online	CoE - On	line			
NetId:	10.43.2.149.2.1			Advanced S	ettings	
Number	Box Name	Address	Туре	In Size	Out S	E-Bus (
1	Term 1 (EK1100)	1001	EK1100			
2	Term 2 (EL3102)	1002	EL3102	8.0		1830
3	Term 4 (EL2004)	1003	EL2004		0.4	1730
4	Term 5 (EL2004)	1004	EL2004		0.4	1630
'≝ 5	Term 6 (EL7031)	1005	EL7031	8.0	8.0	1510
6	Term 7 (EL2808)	1006	EL2808		1.0	1400
1 7	Term 8 (EL3602)	1007	EL3602	12.0		1210
8	Term 9 (EL3602)	1008	EL3602	12.0		1020
9	Term 10 (EL3602)	1009	EL3602	12.0		830
10	Term 11 (EL3602)	1010	EL3602	12.0		640
11	Term 12 (EL3602)	1011	EL3602	12.0		450
12	Term 13 (EL3602)	1012	EL3602	12.0		260
13	Term 14 (EL3602)	1013	EL3602	12.0		70
c 14	Term 3 (EL6688)	1014	EL6688	22.0		-240 !

Fig. 134: Illegally exceeding the E-Bus current

From TwinCAT 2.11 and above, a warning message "E-Bus Power of Terminal..." is output in the logger window when such a configuration is activated:

Message

E-Bus Power of Terminal 'Term 3 (EL6688)' may to low (-240 mA) - please check!

Fig. 135: Warning message for exceeding E-Bus current

NOTICE

Caution! Malfunction possible!

The same ground potential must be used for the E-Bus supply of all EtherCAT terminals in a terminal block!

6.4 Settings and application notes

6.4.1 Default setting

The EL3204-0162 can be used for direct temperature or resistance measurements.

The relationship between temperature and resistance of a PT100/PT1000 sensor is shown below:

Temperature	typical resistance, approx.
850 °C	ΡΤ1000: 3.9 kΩ
	ΡΤ100: 390 Ω
320 °C	ΡΤ1000: 2.2 kΩ
	ΡΤ100: 220 Ω
-200 °C	ΡΤ1000: 180 Ω
	ΡΤ100: 18 Ω

Characteristic sensor curves are available from the sensor manufacturers.

You can obtain further information in the chapters <u>Object description and parameterization</u> [▶ <u>143</u>] and <u>Process data and operating modes</u> [▶ <u>128</u>].

	EL3204-0162
Default/factory setting	2-wire connection
	• Pt100 (CoE 0x <u>80n00:19 [</u> ▶ <u>144]</u>)
	 Presentation signed (CoE 0x<u>80n00:02 [▶ 144]</u>)
	Limits disabled
	 50 Hz filter enabled
	All channels enabled
Area of application	The terminal is calibrated in the measuring range "1/16 Ω " (10 Ω 4 k Ω) and can be used in this resistance range.

Note regarding Resistance Measurement mode

In Resistance Measurement mode the measured value is always displayed unsigned, irrespective of the Presentation setting (CoE 0x80n00:02 [▶ 144]), as 0..xFFFF with the respective valence.

1/16 Ω -> ~62 mΩ/digit

1/64 Ω -> ~15 mΩ/digit

6.4.2 Changing the slave parameters in the CoE directory

During commissioning it may be necessary to change the CoE parameters.

- If the terminal is accessed online, the CoE directory is read from the slave and can be changed, example EL3201, see fig. Accessing the CoE parameters in the TwinCAT System Manager, example EL3201.
- If the terminal is accessed offline (the terminal is then not addressable) the data from the XML description is used. The parameters cannot be changed.

The CoE parameters (CAN over EtherCAT) can be changed in the "CoE-Online" tab of the EtherCAT slave.

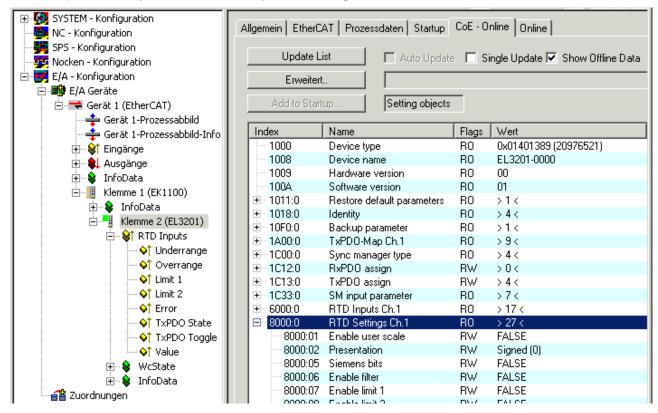


Fig. 136: Accessing the CoE parameters in TwinCAT System Manager, example EL3201

NOTICE

Changes in the CoE directory, in the case of exchange

So that, in the case of exchanging an EtherCAT slave, the CoE parameters are set correctly in the new slave, changes on the customer side must be entered in the start-up list.

Changes in the CoE directory, program access

The CoE parameters can also be read and written during operation (insofar as it makes sense) by the PLC using corresponding control commands. For details, see the corresponding articles in the Beckhoff Information System, for example.

For detailed information on settings and operation modes, please read the chapter <u>"Process data and operation modes"</u> [> <u>128</u>].

6.4.3 Further application notes

"Filter enable" setting

The filter function is always active, even if the object 0x8000:06 "Filter enable" is set to FALSE

"Connection technology" setting

In addition to 2-, 3- and 4-wire connection (on the EL3204-0162, the 3- and 4-wire settings have no function), "not connected" can also be selected here for each channel. The channel concerned is completely disabled and the conversion time of the EL3204-0162 is correspondingly shortened. By means of a double click on the corresponding object 0x80x0:1A, the respective channels can be switched off in the Set Value Dialog by selecting the "Enum" value "not connected". (See fig. *"not connected" setting*)

Set Value Dia	olog 🛛 🗙	
Dec:	0 OK	
Hex:	0x00000000 Abbruch	
Enum:	2-wire	
	2-wire 3-wire	
Bool:	4-wire Edit	
Binär:	00 00 00 00 4	
Bitgröße	○1 ○8 ○16 ● 32 ○ 64 ○ ?	

Fig. 137: "not connected" setting

6.5 **Process data and operation modes**

6.5.1 Sync Manager

PDO assignment of sync managers

SM3, PDO	SM3, PDO Assignment 0x1C13					
Index	Index of excluded PDOs	Size (byte.bit)	Name	PDO Content		
0x1A00 (default)	-	4.0	RTD Inputs Channel 1	Index 0x6000:01 [▶ 150] Status_Underrange Index 0x6000:02 [▶ 150] Status_Overrange Index 0x6000:03 [▶ 150] Status_Limit 1 Index 0x6000:05 [▶ 150] Status_Limit 2 Index 0x6000:07 [▶ 150] Status_Error Index 0x6000:07 [▶ 150] Status_TxPDO Status Index 0x6000:07 [▶ 150] Status_TxPDO Toggle Index 0x6000:11 [▶ 150] Value		
0x1A01 (default)	-	4.0	RTD Inputs Channel 2	$eq:linear_line$		
				Index 0x6010:0F [▶ 150] - Status_TxPDO Status Index 0x6010:10 [▶ 150] - Status_TxPDO Toggle Index 0x6010:11 [▶ 150] - Value		
0x1A02 (default)	-	4.0	Al Standard Channel 1	$eq:linear_line$		
				Index <u>0x1802:07</u> [▶ <u>155]</u> - Status_TxPDO Status Index <u>0x1802:09</u> [▶ <u>155]</u> - Status_TxPDO Toggle Index <u>0x6020:11</u> [▶ <u>151]</u> - Value		
0x1A03	-	2.0	Al Compact Channel 1	Index <u>0x6020:11 [▶ 151]</u> - Value		
0x1A04 (default)	-	4.0	Al Standard Channel 2	$eq:linear_line$		
				Index 0x1804:07 [▶ 156] - Status_TxPDO Status Index 0x1804:09 [▶ 156] - Status_TxPDO Toggle Index 0x6030:11 [▶ 151] - Value		
0x1A05	-	2.0	AI Compact Channel 2	Index <u>0x6030:11 [▶ 151]</u> - Value		

6.5.2 Operation modes and settings (RTD channels)

6.5.2.1 Presentation, index 0x8000:02 / 0x8010:02

In the delivery state, the measured value is output in increments of 1/10 °C in two's complement format (signed integer).

The complete measuring range is output for each resistance sensor. Index 0x8000:02 [\blacktriangleright 144] and 0x8010:02 [\blacktriangleright 146] offers the possibility to change the method of representation of the measured value.

Measured value	Output (hexadecimal)	Output (signed integer, decimal)
-250.0 °C	0xF63C	-2500
-200.0 °C	0xF830	-2000
-100.0 °C	0xFC18	-1000
-0.1 °C	0xFFFF	-1
-0.0 °C	0x0000	0
-0.1 °C	0x0001	1
100.0 °C	0x03E8	1000
200.0 °C	0x07D0	2000
500.0 °C	0x1388	5000
850.0 °C	0x2134	8500



```
Presentation
```

Signed Integer:

The measured value is represented in two's complement

⇒ Maximum representation range with 16-bit = -32768 ... + 32767

 $\Rightarrow \text{Example:} \\ 1000\ 0000\ 0000\ 0000_{\text{bin}} = 0x8000_{\text{hex}} = -32768_{\text{dec}} \\ 1111\ 1111\ 1111\ 1110_{\text{bin}} = 0xFFF_{\text{hex}} = -2_{\text{dec}} \\ 1111\ 1111\ 1111\ 1111\ _{\text{bin}} = 0xFFF_{\text{hex}} = -1_{\text{dec}} \\ 0000\ 0000\ 0000\ 0001\ _{\text{bin}} = 0x0001_{\text{hex}} = +1_{\text{dec}} \\ 0000\ 0000\ 0000\ 0001\ _{\text{bin}} = 0x0002_{\text{hex}} = +2_{\text{dec}} \\ 0111\ 1111\ 1111\ 1111\ _{\text{bin}} = 0xFFF_{\text{hex}} = +32767_{\text{dec}} \\ \end{cases}$

• Absolute value with MSB as sign: The measured value is output in signed amount representation.

A Maximum representation range with 16-bit = -32767 ... + 32767

⇒ Example:

 $\begin{array}{l} 1111 \ 1111 \ 1111 \ 1111_{\text{bin}} = 0 x \text{FFF}_{\text{hex}} = - 32767_{\text{dec}} \\ 1000 \ 0000 \ 0000 \ 0010_{\text{bin}} = 0 x 8002_{\text{hex}} = - 2_{\text{dec}} \\ 1000 \ 0000 \ 0000 \ 0001_{\text{bin}} = 0 x 8001_{\text{hex}} = - 1_{\text{dec}} \\ 0000 \ 0000 \ 0000 \ 0001_{\text{bin}} = 0 x 0001_{\text{hex}} = + 1_{\text{dec}} \\ 0000 \ 0000 \ 0000 \ 0010_{\text{bin}} = 0 x 0002_{\text{hex}} = + 2_{\text{dec}} \\ 0111 \ 1111 \ 1111 \ 1111_{\text{bin}} = 0 x 7 \text{FFF}_{\text{hex}} = + 32767_{\text{dec}} \end{array}$

 High resolution (1/100 °C): The measured value is output in 1/100 °C steps. The maximum measuring range is thus limited to 32767_{dec} * (1/100)°C = 327.67 °C, but can be extended by user scaling!

6.5.2.2 Siemens bits, index 0x8000:05 / 0x8010:05

If the bit in index 0x8000:05 [\blacktriangleright 144] / 0x8010:05 [\blacktriangleright 146] is set, status displays are shown for the lowest 3 bits. In the error case "overrange" or "underrange", bit 0 is set.

6.5.2.3 Underrange (index 0x6000:01 / 0x6010:01), Overrange (index 0x6000:02 / 0x6010:02)

Underrange and overrange of the measuring range

Overrange, Pt100: T > 850 °C (R > 400 Ω):

The bits in index $0x6000:02 \ [b 150] / 0x6010:02 \ [b 150]$ (overrange bit) and index $0x6000:07 \ [b 150] / 0x6010:07 \ [b 150]$ (error bit) are set. The linearization of the characteristic curve is continued with the coefficients of the upper range limit up to the limit stop of the A/D converter (approx. 500 Ω for PT100).

 Underrange, Pt100: T < - 200°C (R < 18 Ω): The bits in index 0x6000:01 [▶ 150] / 0x6010:01 [▶ 150] (underrange bit) and index 0x6000:07 [▶ 150] / 0x6010:07 [▶ 150] (error bit) are set. The smallest negative number is displayed (0x8001 corresponds to -32767).

For overrange or underrange the red error LED is switched on.

6.5.2.4 Notch filter (conversion times), index 0x8000:06 / 0x8000:15

The EL3204-0162 terminal is equipped with a digital filter for each of the RTD channels and AI channels. The filters work as notch filters and determine the conversion time of the terminal. They are each parameterized via the index $0x8000:15 [\blacktriangleright 144]$ (RTD) or $0x8020:15 [\blacktriangleright 148]$ (AI). The higher the filter frequency, the faster the conversion time.

Notch filter means that the filter has zeros (notches) in the frequency response at the specified filter frequency and multiples thereof, i.e. it masks out these frequencies. In order to filter out 50 Hz, therefore, the 50 Hz or the 10 Hz filter can be used. Since all frequencies lower than the notch frequency usually have to be measured, however, the "50 Hz" setting is to be used in this case.

typ. Frequency response Notch filter

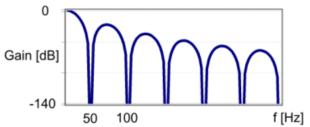


Fig. 138: Typical frequency response of a notch filter, set to 50 Hz

Index <u>0x80n00:06 [} 146]</u>

The filter function is always active even if the bit is not set, since this is obligatory for the measurement process!

Details of the conversion time

- The conversion time depends on *number of active channels, filter time, const. computing time.*
- The process data TxPDO Toggle changes its state if a new measured value is present.

The filter characteristics are set via index 0x8000:15

The filter frequencies are set for all RTD channels of the EL3204-0162 terminal centrally via index 0x8000:15 [▶ 144] (channel 1 RTD).





Switching off the unused channels of multi-channel terminals

Unused channels should be switched off if filter frequencies are \geq 1 kHz (optimization of conversion times)! The channel concerned is completely disabled and the conversion time of the EL3204-0162 is correspondingly shortened.

• By double-clicking on the corresponding object <u>0x8000:1A [▶ 144]</u>/ <u>0x8010:1A [▶ 146]</u> the corresponding channels can be switched off in the Set Value dialog by selecting the "Enum" value "not connected".

The settings "3-wire" and "4-wire" are present for compatibility reasons and have no function. (see Fig.: Set Value dialog)

Set Value Di	alog	×
Dec:	0	OK
Hex:	0x0000000	Abbruch
Enum:	2-wire	•
	2-wire 3-wire	
Bool:	4-wire not connected	Edit
Binär:	00 00 00 00	4
Bitgröße	○1 ○8 ○16 ○32 ○6	i4 C ?

Fig. 139: Set Value Dialog

6.5.2.5 Limit 1 (index 0x8000:13 / 0x8010:13) and limit 2 (index 0x8000:14 / 0x8010:14)

A range of values can be set which is compared with the values in the indices $0x8000:13 [\blacktriangleright 144] / 0x8010:13$ [$\blacktriangleright 146$] and $0x8000:14 [\blacktriangleright 144] / 0x8010:14 [\blacktriangleright 146]$. The bits are set in the process data if the limit values are undershot or exceeded.

The limit evaluation takes place after taking into account the set characteristic curve and negative values.

Limit [2 Bit] Interpretation (default), Index <u>0x6000:03</u> [▶ <u>150]</u> / <u>0x6010:03</u> [▶ <u>150]</u>, <u>0x6000:05</u> [▶ <u>150]</u> / <u>0x6010:05</u> [▶ <u>150]</u>:

00_{bin}, 0: not active

01_{bin}, 1: value is greater than limit value

 $10_{\mbox{\tiny bin}},$ 2: value is smaller than limit value

 11_{bin} , 3: value is equal to limit value

6.5.2.6 Calibration



Use of the term "calibration

The concept "calibration", which has historical roots at Beckhoff, is used here even if it has nothing to do with the deviation statements of a calibration certificate. Actually, this is a description of the vendor or customer calibration data/adjustment data used by the device during operation in order to maintain the assured measuring accuracy.

User scaling, index 0x8000:01 [) 144] / 0x8010:01 [) 146]

The user scaling is enabled via index 0x8000:01 [\blacktriangleright 144] / 0x8010:01 [\blacktriangleright 146]. Parameterization takes place via the indices.

- <u>0x8000:11 [▶ 144]</u> / <u>0x8010:11 [▶ 146]</u> User scaling offset
- <u>0x8000:12 [▶ 144]</u> / <u>0x8010:12 [▶ 146]</u> User scaling gain

Vendor calibration, index 0x800F [> 154] / 0x801F [> 154]

The vendor calibration is enabled via index 0x8000:0B [\blacktriangleright 144] / 0x8010:0B [\blacktriangleright 146]. Parameterization takes place via the indices

- <u>0x800F:01 [▶ 154]</u> / <u>0x801F:01 [▶ 154]</u> Calibration offset
- <u>0x800F:02</u> [▶ <u>154</u>] / <u>0x01F:02</u> [▶ <u>154</u>] Calibration gain
- <u>0x800F:03</u> [▶ <u>154</u>] / <u>0x01F:03</u> [▶ <u>154</u>] Calibration offset (input RL)
- <u>0x800F:04</u> [▶ <u>154</u>] / <u>0x801F:04</u> [▶ <u>154</u>] Calibration gain (input RL)
- <u>0x800F:05</u> [▶ <u>154</u>] / <u>0x801F:05</u> [▶ <u>154</u>] (no function, only present for compatibility reasons)
- <u>0x800F:06 [▶ 154]</u> / <u>0x801F:06 [▶ 154]</u> (no function, only present for compatibility reasons)

User calibration, index 0x8000:17 [> 144] / 0x8010:17 [> 146], 0x8000:18 [> 144] / 0x8010:18 [> 146]

The user calibration is enabled via index <u>0x80x0:0A [▶ 144]</u>. Parameterization takes place via the indices.

• <u>0x8000:17 [▶ 144]</u> / <u>0x8010:17 [▶ 146]</u> User calibration offset • <u>0x8000:18 [▶ 144]</u> / <u>0x8010:18 [▶ 146]</u> User calibration gain

Process data calculation

The terminal records measured values continuously and places the raw values of its A/D converter into the ADC raw value object $0x800E:01 [\blacktriangleright 153] / 0x801E:01 [\blacktriangleright 153]$ or $0x800E:02 [\blacktriangleright 153] / 0x801E:02 [\blacktriangleright 153]$. The calculation of the correction with the vendor calibration values takes place after each acquisition of the analog signal. User scaling then follows (optionally):

	Measured value offer the user cooling	
	<u>0x8000:0A [▶ 144]</u> / <u>0x8010:0A [▶ 146]</u> inactive)	
$Y_{H} = (X_{ADC} - B_{K}) \times A_{K}$	measured value after vendor calibration (corresponds to $Y_{\mbox{\scriptsize A}}$ if index	

$Y = Y \times A \times 2 + B_{A H W}^{-16} W$ Measured value after the user scaling

Key

Name	Name	Index (hex)
X _{ADC}	Output value of the A/D converter	800E:01 [▶_153] / 801E:01 [▶_153], 800E:02 [▶_153] / 801E:02 [▶_153]
Β _κ	Vendor calibration offset (can only be changed if the object "Producer codeword" <u>0xF008 [▶ 160]</u> is set)	800F:01 [▶ 154] / 801F:01 [▶ 154], 800F:03 [▶ 154] / 801F:03 [▶ 154]
A _K	Vendor calibration gain (can only be changed if the object "Producer codeword" <u>0xF008 [▶ 160]</u> is set)	800F:02 [▶ 154] / 801F:02 [▶ 154], 800F:04 [▶ 154] / 801F:04 [▶ 154]
B _w	User scaling offset (can be enabled via index <u>0x8000:0A</u> [▶ <u>144]</u> / <u>0x8010:0A</u> [▶ <u>146]</u>)	<u>8000:17 [▶ 144]</u> / <u>8010:17 [▶ 146]</u>
A _w	User scaling gain (can be enabled via index <u>0x8000:0A</u> [▶ <u>144]</u> / <u>0x8010:0A</u> [▶ <u>146]</u>)	<u>8000:18 [▶ 144]</u> / <u>8010:18 [▶ 146]</u>
Y _A	Process data for controller	-

6.5.3 Operation modes and settings (AI channels)

6.5.3.1 Presentation, index 0x8020:02 / 0x8030:02

The measured value is output ex works in two's complement presentation (signed integer). Index 0x8020:02 [\blacktriangleright 148] or 0x8030:02 [\blacktriangleright 149] offer the possibility to change the presentation of the measured value.

Signed integer presentation

The negative output value is represented in two's complement (negated + 1). Maximum representation range at 16 bits = $-32768 \dots +32767_{dec}$

Input signal			Value	
(Index <u>0x8020:19 [▶ 148], 0x8030:19 [▶ 149]</u>) range: -10+10 V	(Index <u>0x8020:19 [▶ 148]</u> , <u>0x8030:19 [▶ 149]</u>) range: 0+10 V	Decimal	Hexadecimal	
10 V	10 V	32767	0x7FFF	
5 V	5 V	16383	0x3FFF	
			0x0001	
0 V	0 V	0	0x0000	
			0xFFFF	
-5 V		-16383	0xC001	
-10 V		-32768	0x8000	

Unsigned integer presentation

The output value is represented with 15-bit resolution without sign, therefore polarity detection is no longer possible.

Maximum representation range with 16 bits = 0 ... +32767_{dec}

Input signal	Value	Value		
(Index <u>0x8020:19 [▶ 148]</u> , <u>0x8030:19 [▶ 149]</u>) range: -10+10 V	(Index <u>0x8020:19 [▶ 148]</u> , <u>0x8030:19 [▶ 149]</u>) range: 0+10 V	Decimal	Hexadecimal	
10 V	10 V	32767	0x7FFF	
5 V	5 V	16383	0x3FFF	
			0x0001	
0 V	0 V	0	0x0000	
			0x0001	
-5 V		16383	0x3FFF	
-10 V		32767	0x7FFF	

Absolute value with MSB as sign presentation

The output value is output in the signed amount representation: MSB=1 (highest bit) for negative values. Maximum representation range with 16 bits = $-32768 \dots +32767_{dec}$

Input signal	Value		
(Index <u>0x8020:19 [▶ 148]</u> , <u>0x8030:19 [▶ 149]</u>) range: -10+10 V	(Index <u>0x8020:19 [▶ 148]</u> , <u>0x8030:19 [▶ 149]</u>) range: 0+10 V	Decimal	Hexadecimal
10 V	10 V	32767	0x7FFF
5 V	5 V	16383	0x3FFF
			0x0001
0 V	0 V	0	0x0000
			0x8000
-5 V		[-16383]	0xBFFF
-10 V		[-32767]	0xFFFF

Presentation types

The presentation types "Unsigned integer" and "Absolute value with MSB as sign" have no function for unipolar terminals. There is no change in the presentation in the positive range.

6.5.3.2 Siemens bits, index 0x8020:05 / 0x8030:05

If the bit in index 0x8020:05 [\blacktriangleright 148] / 0x8030:05 [\blacktriangleright 149] is set, status displays are shown for the lowest 3 bits. In the error case "overrange" or "underrange", bit 0 is set.

6.5.3.3 Underrange (index 0x6020:01 / 0x6030:01), Overrange (index 0x6020:02 / 0x6030:02)

Underrange and overrange of the measuring range

• Underrange:

The bits in index $0x6020:01 \ [b 151] / 0x6030:01 \ [b 151]$ (underrange bit) and index $0x6020:07 \ [b 151] / 0x6030:07 \ [b 151]$ (error bit) are set.

- Indicates that the output value is below -256 (approx. 0.8 % of end value; -32767 for bipolar terminals).
- The output value is limited to 0 (-32768).
- For bipolar terminals underrange is also set if the ADC outputs the lower limit value.
- Overrange:

The bits in index <u>0x6020:02</u> [▶ <u>151</u>] / <u>0x6030:02</u> [▶ <u>151</u>] (overrange bit) and index <u>0x6020:07</u> [▶ <u>151</u>] / <u>0x6030:07</u> [▶ <u>151</u>] (error bit) are set.

- Indicates that the output value is above 32768.
- The output value is limited to 32768.
- Overrange is also set if the ADC outputs the upper limit value.

For overrange or underrange the red error LED is switched on.

6.5.3.4 Notch filter (conversion times), index 0x8020:06 / 0x8020:15

The EL3204-0162 terminal is equipped with a digital filter for each of the RTD channels and AI channels. The filters work as notch filters and determine the conversion time of the terminal. They are each parameterized via the index $0x8000:15 \ [b] 144$ (RTD) or $0x8020:15 \ [b] 148$ (AI). The higher the filter frequency, the faster the conversion time.

Notch filter means that the filter has zeros (notches) in the frequency response at the specified filter frequency and multiples thereof, i.e. it masks out these frequencies. In order to filter out 50 Hz, therefore, the 50 or the 10 Hz filter can be used. Since all frequencies lower than the notch frequency usually have to be measured, however, the "50 Hz" setting is to be used in this case.

typ. Frequency response Notch filter

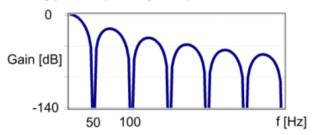


Fig. 140: Typical frequency response of a notch filter, set to 50 Hz



Index 0x80n00:06 [> 149]

The filter function is always active even if the bit is not set, since this is obligatory for the measurement process!

Details of the conversion time

• The conversion time depends on number of active channels, filter time, const. computing time.

• The process data *TxPDO Toggle* changes its state if a new measured value is present.

•

The filter characteristics are set via index 0x8020:15

The filter frequencies are set for all channels of the EL3204-0162 terminal centrally via index 0x8020:15 (channel 3 [channel 1 AI]).

Unused channels should be switched off if filter frequencies are \geq 1 kHz (optimization of conversion times)! The channel concerned is completely disabled and the conversion time of the EL3204-0162 is correspondingly shortened.

• By double-clicking on the corresponding object <u>0x8020:1A</u> / <u>0x8030:1A</u> the corresponding channels can be switched off in the Set Value dialog by selecting the "Enum" value "not connected".

The settings "3-wire" and "4-wire" are present for compatibility reasons and have no function. (see Fig. *Set Value dialog*)

Set Value Di	alog 🗙
Dec:	0 ОК
Hex:	0x00000000 Abbruch
Enum:	2-wire
	2-wire 3-wire
Bool:	4-wire Edit
Binär:	00 00 00 00
Bitgröße	○1 ○8 ○16 ○32 ○64 ○ ?

Fig. 141: Set Value Dialog

6.5.3.5 Limit 1 (index 0x8020:13 / 0x8030:13) and limit 2 (index 0x8020:14 / 0x8030:14)

A range of values can be set which is compared with the values in the indices 0x8020:13 [\blacktriangleright 148] / 0x8030:13 [\blacktriangleright 149] and 0x8020:14 [\blacktriangleright 148] / 0x8030:14 [\blacktriangleright 149]. The bits are set in the process data if the limit values are undershot or exceeded.

The limit evaluation takes place after taking into account the set characteristic curve and negative values.

Limit [2 Bit] Interpretation (default), Index <u>0x6020:03</u> [▶ <u>151</u>] / <u>0x6030:03</u> [▶ <u>151</u>], <u>0x6020:05</u> [▶ <u>151</u>] / <u>0x6030:05</u> [▶ <u>151</u>]:

00_{bin}, 0: not active

01_{bin}, 1: value is greater than limit value

 10_{bin} , 2: value is smaller than limit value

11_{bin}, 3: value is equal to limit value

6.5.3.6 Calibration



Use of the term "calibration

The concept "calibration", which has historical roots at Beckhoff, is used here even if it has nothing to do with the deviation statements of a calibration certificate. Actually, this is a description of the vendor or customer calibration data/adjustment data used by the device during operation in order to maintain the assured measuring accuracy.

User scaling, index 0x8020:01 [> 148] / 0x8030:01 [> 149]

The user scaling is enabled via index 0x8020:01 [\blacktriangleright 148] / 0x8030:01 [\blacktriangleright 149]. Parameterization takes place via the indices.

- <u>0x8020:11 [▶ 148]</u> / <u>0x8030:11 [▶ 149]</u> User scaling offset
- <u>0x8020:12 [▶ 148]</u> / <u>0x8030:12 [▶ 149]</u> User scaling gain

Vendor calibration, index 0x802F [154] / 0x803F [154]

The vendor calibration is enabled via index 0x8020:0B [\blacktriangleright 148] / 0x8030:0B [\blacktriangleright 149]. Parameterization takes place via the indices.

- <u>0x802F:01 [▶ 154]</u> / <u>0x803F:01 [▶ 154]</u> Calibration offset
- <u>0x802F:02</u> [▶<u>154</u>] / <u>0x803F:02</u> [▶<u>154</u>] Calibration gain

User calibration, index 0x8020:17 [> 148] / 0x8030:17 [> 149], 0x8020:18 [> 148] / 0x8030:18 [> 149]

The user calibration is enabled via index 0x8020:0B [\blacktriangleright 148] / 0x8030:0B [\blacktriangleright 149]. Parameterization takes place via the indices.

- <u>0x8020:17 [▶ 148]</u> / <u>0x8030:17 [▶ 149]</u> User calibration offset
- <u>0x8020:18 [▶ 148]</u> / <u>0x8030:18 [▶ 149]</u> User calibration gain

Process data calculation

The terminal records measured values continuously and places the raw values of its A/D converter into the ADC raw value object 0x802E:01 [\blacktriangleright 153] / 0x803E:01 [\blacktriangleright 153]. The calculation of the correction with the vendor calibration values takes place after each acquisition of the analog signal. User scaling then follows (optionally):

$Y_{H} = (X_{ADC} - B_{K}) \times A_{K}$	Measured value after vendor calibration (corresponds to Y_A if index
	<u>0x8020:0A [▶ 148]</u> / <u>0x8030:0A [▶ 149]</u> inactive)
Y = Y x A x 2 + B _{A H W} $^{-16}$ _W	Measured value after the user scaling

Key

Name	Name	Index
X _{ADC}	Output value of the A/D converter	<u>0x802E:01 [▶ 153]</u> / <u>0x803E:01 [▶ 153]</u>
Β _κ	Vendor calibration offset (can only be changed if the object "Producer codeword" <u>0xF008 [▶ 160]</u> is set)	0x802F:01 [▶_154] / 0x803F:01 [▶_154]
A _K	Vendor calibration gain (can only be changed if the object "Producer codeword" <u>0xF008 [▶ 160]</u> is set)	0x802F:02 [▶_154] / 0x803F:02 [▶_154]
B _w	User scaling offset (can be enabled via index <u>0x8020:0A [▶ 148]</u> / <u>0x8030:0A [▶ 149]</u>)	<u>0x8020:17 [▶ 148]</u> / <u>0x8030:17 [▶ 149]</u>
A _w	User scaling gain (can be enabled via index <u>0x8020:0A [▶ 148]</u> / <u>0x8030:0A [▶ 149]</u>)	0x8020:18 [▶_148] / 0x8030:18 [▶_149]
Y _A	Process data for controller	-

6.5.4 Producer Codeword



The vendor reserves the authority for the basic calibration of the terminals. The Producer codeword is therefore at present reserved.

6.5.5 Interference from equipment

When operating the EL3204-0162 analog EtherCAT Terminals, high frequency superimposed signals from interfering devices (e.g. proportional valves, stepper motors or DC motor output stages) can be picked up by the terminal. In order to guarantee interference-free operation, we recommend the use of separate power supply units for the terminals and the interference-causing devices.

6.6 Status word

The status information for each channel of the EL32xx and EL33xx is transmitted cyclically from the terminal to the EtherCAT Master as process data (PDO). Two versions of the device description are available for the EL32xx and EL33xx, representing the process image in individual and extended forms.

The difference can be seen in the revision number EL3xxx-xxxx-XXXX.

The EL32xx or EL33xx transmit the following process data:

- Underrange: Measurement is below range
- Overrange: Range of measurement exceeded ("Cable break" together with "Error")
- Limit 1: Limit value monitoring 0: ok, 1: Limit value overshot, 2: Limit value undershot
- Limit 2: Limit value monitoring 0: ok, 1: Limit value overshot, 2: Limit value undershot
- Error: The error bit is set if the process data is invalid (cable break, overrange, underrange)
- **TxPDO State:** Validity of the data of the associated TxPDO (0 = valid, 1 = invalid).
- **TxPDO Toggle**: The TxPDO toggle is toggled by the slave when the data of the associated TxPDO is updated. This allows the currently required conversion time to be derived.

The limit evaluation is set in the "8000" objects in the CoE directory.

Differences in the versions of the EL32xx and EL33xx series The revision differences are illustrated below, using the EL32xx series as an example. The principles of the description apply equally to the EL33xx series.

Revision -0016 (EL32xx-xxxx-0016)

These terminal revisions have the **single process image**, see "*EL32xx-0000-0016 process image in the TwinCAT 2.11 representation*".

Each item of status information is transmitted as a single, linkable process data.

Term 2 (EL3202-0000-0016)	Name	Туре	Size
🖻 💱 RTD Inputs Channel 1	♦↑ Underrange	BOOL	0.1
	♦↑ Underrange ♦↑ Overrange ♦↑ Limit 1 ♦↑ Limit 2 ♦↑ Error ♦↑ TxPDO State ♦↑ TxPDO Toggle ♦↑ Value ♦↑ Underrange ♦↑ Overrange ♦↑ Overrange ♦↑ Limit 1 ♦↑ Limit 1 ♦↑ Limit 2 ♦↑ Error ♦↑ TxPDO State ♦↑ TxPDO State ♦↑ TxPDO State ♦↑ TxPDO State ♦↑ TxPDO Toggle ♦↑ Value	BOOL BOOL BIT2 BIT2 BOOL BOOL BOOL BOOL BIT2 BIT2 BIT2 BIT2 BOOL BOOL BOOL BOOL BOOL BOOL BOOL	0.1 0.2 0.2 0.1 0.1 0.1 0.1 0.1 0.1 0.2 0.1 0.2 0.1 0.1 0.2 0.1 0.1 0.2 0.1 0.1 0.1 0.1 0.1 0.1 0.1 0.1
	♦1 State ♦1 AdsAddr	UINT AMSADD	2.0 8.0

Fig. 142: EL32xx-0000-0016 process image in the TwinCAT 2.11 representation

Revisions -0017 (EL32xx-xxxx-0017) and higher

These terminal revisions also have the **summarized process image**, see *"EL32xx-0000-0017 process image in the TwinCAT 2.11 representation"*.

The individual units of information are assembled here in the usual Beckhoff representation as a 16-bit status word, and can be linked into the controller in this way.

Status word

Bit	SW.15	SW.14	SW.13	SW.12	SW.11	SW.10	SW.9	SW.8	SW.7	SW.6	SW.5	SW.4	SW.3	SW.2	SW.1	SW.0
Name	TxPD	TxPD	-	-	-	-	-	-	-	Error	Limit 2		Limit 1		Overra	Underr
	0	0													nge	ange
	Toggle	State														

In addition to this, the consolidated "status" can be folded out through the "+" symbol, and the items of process data linked individually.

 Image: Status Image: Statu	Term 3 (EL3202-0000-0017)	Name		Туре	Size
	 RTD Inputs Channel 1 Status Inputs Channel 1 Status Inderrange Inderrange Inputs Channel 2 RTD Inputs Channel 2 WcState WcState 	 ♦↑ Status ♦↑ Value ♦↑ Status ♦↑ Value ♦↑ WcState ♦↑ State 	A	Status_4 INT Status_4 INT BOOL UINT	2.0 2.0 2.0 2.0 0.1 2.0
	 InfoData ♦↑ State 		A		

Fig. 143: EL32xx-0000-0017 process image in the TwinCAT 2.11 representation

The individual items of information can also be displayed in the overview window (A) on the right. By clicking on the button



in the menu bar the information can also be displayed there.

BECKHOFF

E. Term 3 (EL3202-0000-0017)	Name	Туре	Size
🖻 💱 RTD Inputs Channel 1	🔊 Status	Status_4096	2.0
i⊐ 🔊 Status	♦ ↑ Underrange	BOOL	0.1
	♦ † Overrange	BOOL	0.1
	♦î Limit 1	BIT2	0.2
¢† Limit 1	♦î Limit 2	BIT2	0.2
\$† Limit 2 \$† Error	♦↑ Error	BOOL	0.1
→ TxPDO State	♦TxPDO State	BOOL	0.1
↓ TXPDO State	♦↑ TxPDO To	BOOL	0.1
♦↑ Value	♦ † Value	INT	2.0
	🔊 Status	Status_4096	2.0
e State	♦↑ Underrange	BOOL	0.1
↓ WcState	♦ † Overrange	BOOL	0.1
🗆 😫 InfoData	♦î Limit 1	BIT2	0.2
\$† State	♦Î Limit 2	BIT2	0.2
	♦↑ Error	BOOL	0.1
	♦↑ TxPDO State	BOOL	0.1
	♦↑ TxPDO To	BOOL	0.1
	♦1 Value	INT	2.0
	♦ † WcState	BOOL	0.1
	♦ † State	UINT	2.0
	<mark>,</mark> ♦↑ AdsAddr	AMSADDRESS	8.0
	, <mark>\$</mark> ↑ netId	ARRAY [05] OF USINT	6.0
	♦î netId[0]	USINT	1.0
	♦î netId[1]	USINT	1.0
	♦î netId[2]	USINT	1.0
	♦Î netId[3]	USINT	1.0
	♦î netId[4]	USINT	1.0
	♦î netId[5]	USINT	1.0
	♦ î port	UINT	2.0

Fig. 144: Consolidated process image in the extended representation under TwinCAT 2.11

Notes

• The **consolidated representation** is only visible from TwinCAT 2.11 and above. For reasons of compatibility, if a EL32xx-xxxx-0017 (or later) is operated in earlier TwinCAT configurations, the individual process image is displayed, prepended with the identifier "Status__".

BECKHOFF

Term 2 (EL3202)	Name	Туре	Size
🖻 💱 RTD Inputs Channel 1	♦↑ StatusUnderrange	BOOL	0.1
	♦↑ StatusOverrange	BOOL	0.1
─	♦↑ Status_Limit 1	BIT2	0.2
\$† StatusLimit 1	♦↑ Status_Limit 2	BIT2	0.2
\$↑ StatusLimit 2	♦↑ StatusError	BOOL	0.1
	♦↑ StatusTxPDO State	BOOL	0.1
Status_TxPDO State	♦↑ StatusTxPDO Toggle	BOOL	0.1
◆ ↑ StatusTxPDO Toggle	♦ † Value	INT	2.0
IIIII ♦↑ Value	♦↑ StatusUnderrange	BOOL	0.1
	♦↑ StatusOverrange	BOOL	0.1
WcState	♦↑ Status_Limit 1	BIT2	0.2
	♦↑ Status_Limit 2	BIT2	0.2
↓ State	♦↑ StatusError	BOOL	0.1
	♦↑ StatusTxPDO State	BOOL	0.1
_ 311 1 1 2 1 2 2	♦↑ StatusTxPDO Toggle	BOOL	0.1
	♦1 Value	INT	2.0
	♦↑ WcState	BOOL	0.1
	♦ † State	UINT	2.0
	<mark>s∳</mark> î AdsAddr	AMSADD	8.0

Fig. 145: Consolidated process image represented under TwinCAT 2.10

- Revisions -0016 and -0017 do not depend on the revision of the firmware installed in the terminal. This means that terminals that were supplied as EL32xx-xxxx-0016 can also be operated with a "newer" -0017 configuration, and therefore can be addressed using the consolidated process image. This case of "upwards compatibility" is permitted for the EL32xx-xxxx-0016 and -0017.
- The easiest way to determine the revision that is installed in the terminal is through a scan of the EtherCAT system. The comparison report shows the differences.

Check Configuration		🖸 🖸 🕹 🖬 🖬 🖬
Found Items: Term 4 (EK1101) [EK1101-0000-0017] Term 7 (EL5021) [EL5021-0000-0017] Term 1 (EL3201) [EL3201-0000-0017] Term 9 (EL2202) [EL2202-0000-0016] Term 10 (EL9011)	Disable > Ignore > Delete > Copy Before > Copy After > Co	Configured Items: Term 2 (EK1101) [EK1101-0000-0017] Term 3 (EL5021) [EL5021-0000-0016] Term 8 (EL3201) [EL3201-0000-0016] Term 6 (EL9011)
Extended Information		

Fig. 146: Typical result after scanning an EtherCAT system

Explanation about fig. *"Typical result after scanning an EtherCAT system"*: According to the overview on the right, an EL3201-0000-0016 was found in the configuration (*.tsm file), whereas the overview on the left shows revision -0017. The general downward compatibility of the EL terminals ensures that this kind of application is possible.

6.7 Object description and parameterization

• Eth

EtherCAT XML Device Description

The display matches that of the CoE objects from the EtherCAT XML Device Description. We recommend downloading the latest XML file from the download area of the Beckhoff <u>website</u> and installing it according to installation instructions.

Parameterization via the CoE list (CAN over EtherCAT)

The terminal is parameterized via the CoE - Online tab (double-click on the respective object) or via the Process Data tab (assignment of PDOs). Please note the following general CoE information when using/manipulating the CoE parameters: - Keep a startup list if components have to be replaced - Differentiation between online/offline dictionary, existence of current XML description - Use "CoE reload" for resetting changes

6.7.1 Restore object

Index 1011 Restore default parameters

Index (hex)	Name	Meaning	Data type	Flags	Default
1011:0	Restore default parameters	Restore default settings	UINT8	RO	0x01 (1 _{dec})
1011:01		If this object is set to "0x64616F6C" in the set value dialog, all backup objects are reset to their delivery state.	UINT32	1	0x0000000 (0 _{dec})

6.7.2 Configuration data

Index 8000 RTD Settings Ch.1

Commissioning

Index (hex)	Name	Meaning		Data type	Flags	Default
8000:0	RTD Settings Ch.1	Maximu	m subindex	UINT8	RO	0x1B (27 _{dec})
8000:01	Enable user scale	User scaling is active.		BOOLEAN	RW	0x00 (0 _{dec})
8000:02	Presentation	0	Signed presentation	BIT3	RW	0x00 (0 _{dec})
		1	Absolute value with MSB as sign signed amount representation	_		
		2	High resolution (1/100°C) The value is output with a resolution of (1/100)°C			
8000:05	Siemens bits	The S5	bits are displayed in the three low-order bits	BOOLEAN	RW	0x00 (0 _{dec})
8000:06	Enable filter		ilter, which makes PLC-cycle-synchronous data ge unnecessary	BOOLEAN	RW	0x00 (0 _{dec})
8000:07	Enable limit 1	The stat	us bits are set in relation to Limit 1	BOOLEAN	RW	0x00 (0 _{dec})
8000:08	Enable limit 2	The stat	us bits are set in relation to Limit 2	BOOLEAN	RW	0x00 (0 _{dec})
8000:09	Enable automatic calibration	not impl	emented	BOOLEAN	RW	0x00 (0 _{dec})
8000:0A	Enable user calibration	Enabling	g of the user calibration	BOOLEAN	RW	0x00 (0 _{dec})
8000:0B	Enable vendor calibration	Enabling	g of the vendor calibration	BOOLEAN	RW	0x01 (1 _{dec})
8000:11	User scale offset	User sca	aling offset	INT16	RW	0x0000 (0 _{dec})
8000:12	User scale gain	The gair 2 ⁻¹⁶ .	ne gain of the user scaling. In has a fixed-point representation with a factor of I e 1 corresponds to 65535 (0x00010000).	INT32	RW	0x00010000 (65536 _{dec})
8000:13	Limit 1	First lim 0.1 °C)	t value for setting the status bits (resolution	INT16	RW	0x0000 (0 _{dec})
8000:14	Limit 2	Second 0.1 °C)	limit value for setting the status bits (resolution	INT16	RW	0x0000 (0 _{dec})
8000:15	Filter settings	This object determines the digital filter settings if it is active via Enable filter (Index <u>0x8000:06</u> [▶ <u>144</u>]). The possible settings are numbered consecutively. (see note below)		UINT16	RW	0x0000 (0 _{dec})
		0	50 Hz			
		1	60 Hz			
		2	100 Hz			
		3	500 Hz			
		4	1 kHz			
		5	2 kHz			
		6	3.75 kHz			
		7	7.5 kHz	1		
		8	15 kHz	1		
		9	30 kHz	1		
		10	5 Hz	1		
		11	10 Hz	1		

The filter properties are set only via index 0x8000:15

The filter frequencies are set for all RTD channels of the EL3204-0162 terminals centrally via index 0x8000:15 (channel 1).

1

BECKHOFF

Index (hex)	Name	Meaning		Data type	Flags	Default	
3000:16	Calibration interval			UINT16	RW	0x0000 (0 _{dec})	
8000:17	User calibration offset		bration offset	INT16	RW	0x0000 (0 _{dec})	
8000:18	User calibration gain	User cali	bration gain	UINT16	RW	0xFFFF (65535 _{dec})	
8000:19	RTD element	RTD elei	nent	UINT16	RW	0x0000 (0 _{dec})	
	[<u>23]</u>	0	Pt100 -200 °C to 850 °C			(000)	
		1	Ni100 -60 °C to 250 °C				
		2	Pt1000 -200 °C to 850 °C				
		3	Pt500 -200 °C to 850 °C				
		4	Pt200 -200 °C to 850 °C				
		5	Ni1000 -60 °C to 250 °C				
		6	Ni1000 100 °C: 1500 ohm (-30 to 160 °C)				
		7	Ni120 -60 °C to 320 °C				
		8	Output in ohm Resolution 1/16 ohm (10 4095 ohm)				
		9	Output in ohm Resolution 1/64 ohm (10 1047 ohm)				
		10-32	KT100/110/130/210/230 KTY10/11/13/16/19 KTY81/82-110,120,150 (-50150 °C) KTY81-121 KTY81-122 KTY81-151 KTY81-152 KTY81/82-210,220,250 KTY81-221 KTY81-252 KTY83-121 KTY83-121 KTY83-122 KTY83-151 KTY83-151 KTY83-152 KTY84-130,150 (-40300 °C) KTY84-151 KTY21/23-6 (-50150 °C) KTY1x-5 KTY1x-7 KTY21/23-5 KTY21/23-7				
8000:1A	Connection		on technology	UINT16	RW	0x0000 (0 _{dec})	
	technology [> 22]			-			
			1	3-wire connection (without effect, not to be used)			
		2	4-wire connection (without effect, not to be used)				
		3	not connected: sets the process data to 0 and switches off the LED				
8000:1B	Wire calibration 1/32 ohm [▶ 22]	Calibratio	on of the supply lines	INT16	RW	0x0000 (0 _{dec})	

Index 8010 RTD Settings Ch.2

Index (hex)	Name	Meaning]	Data type	Flags	Default
8010:0	RTD Settings Ch.2	Maximu	n subindex	UINT8	RO	0x1B (27 _{dec})
8010:01	Enable user scale	User sca	ling is active.	BOOLEAN	RW	0x00 (0 _{dec})
8010:02	Presentation	0	Signed presentation	BIT3	RW	0x00 (0 _{dec})
		1	Absolute value with MSB as sign signed amount representation			
		2	High resolution (1/100 C°) The value is output with a resolution of 1/100 °C			
8010:05	Siemens bits	The S5 I	bits are displayed in the three low-order bits	BOOLEAN	RW	0x00 (0 _{dec})
8010:06	Enable filter		ilter, which makes PLC-cycle-synchronous data e unnecessary	BOOLEAN	RW	0x00 (0 _{dec})
8010:07	Enable limit 1	The stat	us bits are set in relation to Limit 1	BOOLEAN	RW	0x00 (0 _{dec})
8010:08	Enable limit 2	The stat	us bits are set in relation to Limit 2	BOOLEAN	RW	0x00 (0 _{dec})
8010:09	Enable automatic calibration	not imple	emented	BOOLEAN	RW	0x00 (0 _{dec})
8010:0A	Enable user calibration	Enabling	of the user calibration	BOOLEAN	RW	0x00 (0 _{dec})
8010:0B	Enable vendor calibration	Enabling	of the vendor calibration	BOOLEAN	RW	0x01 (1 _{dec})
8010:11	User scale offset	User sca	ling offset	INT16	RW	0x0000 (0 _{dec})
8010:12	User scale gain	The gair 2 ⁻¹⁶ .	ne gain of the user scaling. I has a fixed-point representation with a factor of e 1 corresponds to 65535 (0x00010000).	INT32	RW	0x00010000 (65536 _{dec})
8010:13	Limit 1		t value for setting the status bits (resolution 0.1	INT16	RW	0x0000 (0 _{dec})
8010:14	Limit 2	,	limit value for setting the status bits (resolution	INT16	RW	0x0000 (0 _{dec})
8010:15	Filter settings	(see not	e below)	UINT16	RW	0x0000 (0 _{dec})



The filter properties are set only via index 0x8000:15

The filter frequencies are set for all RTD channels of the EL3204-0162 terminals centrally via index 0x8000:15 (channel 1).

Index (hex)	Name	Meaning		Data type	Flags	Default		
8010:16	Calibration interval	not imple	-	UINT16	RW	0x0000 (0 _{dec})		
8010:17	User calibration offset	· · ·	ibration offset	INT16	RW	0x0000 (0 _{dec})		
8010:18	User calibration gain		ibration gain	UINT16	RW	0xFFFF (65535 _{dec})		
8010:19	RTD element [23]	RTD ele	ment	UINT16	RW	0x0000 (0 _{dec})		
		0	Pt100 -200 °C to 850 °C					
		1	Ni100 -60 °C to 250 °C	_	_			
		2	Pt1000 -200 °C to 850 °C					
		3	Pt500 -200 °C to 850 °C					
		4	Pt200 -200 °C to 850 °C					
		5	Ni1000 -60 °C to 250 °C					
		6	Ni1000 100 °C: 1500 ohm (-30 to 160 °C)			0x0000 (0 _{dec})		
		7	Ni120 -60 °C to 320 °C					
		8	Output in ohm Resolution 1/16 ohm (0 4095 ohm)					
		9	Output in ohm Resolution 1/64 ohm (0 1047 ohm)					
8010:1A	Connection	10 - 32	KT100/110/130/210/230 KTY10/11/13/16/19 KTY81/82-110,120,150 (-50150 °C) KTY81-121 KTY81-122 KTY81-152 KTY81-152 KTY81-221 KTY81-222 KTY81-222 KTY81-251 KTY83-121 KTY83-122 KTY83-121 KTY83-151 KTY83-152 KTY84-130,150 (-40300 °C) KTY84-151 KTY21/23-6 (-50150 °C) KTY1x-5 KTY21/23-5 KTY21/23-7 ion technology		RW			
50 IU. IA	Connection technology [▶ 22]		Two-wire connection	UINT16		CACCOU (Udec)		
		0	3-wire connection (without effect, not to be used)	_				
		2 4-wire	4-wire connection (without effect, not to be used)	_				
		3	not connected: sets the process data to 0 and switches off the LED	-				
3010:1B	Wire calibration 1/32 ohm [▶_22]	Calibrati	on of the supply lines	INT16	RW	0x0000 (0 _{dec})		

Index 8020 AI Settings Ch. 3

Index (hex)	Name	Meaning	Data type	Flags	Default
8020:0	AI Settings Ch. 3	Maximum subindex	UINT8	RO	0x19 (25 _{dec})
8020:01	Enable user scale	User scaling is active.	BOOLEAN	RW	0x00 (0 _{dec})
8020:02	Presentation	0: Signed presentation 1: Unsigned presentation 2: Absolute value with MSB as sign Signed amount representation	BIT3	RW	0x00 (0 _{dec})
8020:05	Siemens bits	The S5 bits are displayed in the three low-order bits	BOOLEAN	RW	0x00 (0 _{dec})
8020:06	Enable filter	Enable filter, which makes PLC-cycle-synchronous data exchange unnecessary	BOOLEAN	RW	0x01 (1 _{dec})
8020:07	Enable limit 1	Limit 1 enabled	BOOLEAN	RW	0x00 (0 _{dec})
8020:08	Enable limit 2	Limit 2 enabled	BOOLEAN	RW	0x00 (0 _{dec})
8020:0A	Enable user calibration	Enabling of the user calibration	BOOLEAN	RW	0x00 (0 _{dec})
8020:0B	Enable vendor calibration	Enabling of the vendor calibration	BOOLEAN	RW	0x01 (1 _{dec})
8020:0E	Swap limit bits	Reversal of the limit bits	BOOLEAN	RW	0x00 (1 _{dec})
8020:11	User scale offset	User scaling offset	INT16	RW	0x0000 (0 _{dec})
8020:12	User scale gain	Gain of the user scaling. The gain has a fixed-point representation with the factor 2^{-16} . The value 1 corresponds to 65535_{dec} (0x00010000 _{hex}) and is limited to +/- 0x7FFFF	INT32	RW	0x00010000 (65536 _{dec})
8020:13	Limit 1	First limit value for setting the status bits	INT16	RW	0x0000 (0 _{dec})
8020:14	Limit 2	Second limit value for setting the status bits	INT16	RW	0x0000 (0 _{dec})
8020:15	Filter settings	This object determines the digital filter settings if it is active via Enable filter (Index <u>0x8020:06</u> [▶ <u>148]</u>). The possible settings are numbered consecutively. 0: 50 Hz FIR 1: 60 Hz FIR 2: IIR 1 3: IIR 2 4: IIR 3 5: IIR 4 6: IIR 5 7: IIR 6 8: IIR 7	UINT16	RW	0x0000 (0 _{dec})

i

The filter characteristics are set via index 0x8020:15

The filter frequencies are set for all AI channels of the EL3204-0162 terminals centrally via index 0x8020:15 (channel 1).

Index (hex)	Name	Meaning	Data type	Flags	Default
8020:17	User calibration offset	User calibration offset	INT16	RW	0x0000 (0 _{dec})
8020:18	User calibration gain	User calibration gain	INT16	RW	0x4000 (16384 _{dec})
8020:19		Setting the input range 0: 010 V 6: -10+10 V	INT32	RW	0x0000006 (6 _{dec})

Index 8030 AI Settings Ch. 4

Index (hex)	Name	Meaning	Data type	Flags	Default
8030:0	AI Settings Ch. 4	Maximum subindex	UINT8	RO	0x19 (25 _{dec})
8030:01	Enable user scale	User scaling is active.	BOOLEAN	RW	0x00 (0 _{dec})
8030:02	Presentation	0: Signed presentation 1: Unsigned presentation 2: Absolute value with MSB as sign Signed amount representation	BIT3	RW	0x00 (0 _{dec})
8030:05	Siemens bits	The S5 bits are displayed in the three low-order bits	BOOLEAN	RW	0x00 (0 _{dec})
8030:06	Enable filter	Enable filter, which makes PLC-cycle-synchronous data exchange unnecessary	BOOLEAN	RW	0x01 (1 _{dec})
8030:07	Enable limit 1	Limit 1 enabled	BOOLEAN	RW	0x00 (0 _{dec})
8030:08	Enable limit 2	Limit 2 enabled	BOOLEAN	RW	0x00 (0 _{dec})
8030:0A	Enable user calibration	Enabling of the user calibration	BOOLEAN	RW	0x00 (0 _{dec})
8030:0B	Enable vendor calibration	Enabling of the vendor calibration	BOOLEAN	RW	0x01 (1 _{dec})
8030:0E	Swap limit bits	Reversal of the limit bits	BOOLEAN	RW	0x00 (1 _{dec})
8030:11	User scale offset	User scaling offset	INT16	RW	0x0000 (0 _{dec})
8030:12	User scale gain	Gain of the user scaling. The gain has a fixed-point representation with the factor 2 ⁻¹⁶ . The value 1 corresponds to 65535 _{dec} (0x00010000 _{hex}) and is limited to +/- 0x7FFFF	INT32	RW	0x00010000 (65536 _{dec})
8030:13	Limit 1	First limit value for setting the status bits	INT16	RW	0x0000 (0 _{dec})
8030:14	Limit 2	Second limit value for setting the status bits	INT16	RW	0x0000 (0 _{dec})
8030:15	Filter settings	(see note below)	UINT16	RW	0x0000 (0 _{dec})



The filter characteristics are set via index 0x8020:15

The filter frequencies are set for all AI channels of the EL3204-0162 terminals centrally via index 0x8020:15 (channel 1).

Index (hex)	Name	Meaning	Data type	Flags	Default
8030:17	User calibration offset	User calibration offset	INT16	RW	0x0000 (0 _{dec})
8030:18	User calibration gain	User calibration gain	INT16	RW	0x4000 (16384 _{dec})
8030:19		5 1 5	INT32	RW	0x00000006 (6 _{dec})
		0: 010 V 6: -10+10 V			

6.7.3 Input data

Index 6000 RTD Inputs Ch.1

Index (hex)	Name	Meaning	Data type	Flags	Default
6000:0	RTD Inputs Ch.1	Maximum subindex	UINT8	RO	0x11 (17 _{dec})
6000:01	Underrange	The measuring range is undershot.	BOOLEAN	RO	0x00 (0 _{dec})
6000:02	Overrange	The measuring range is overshot.	BOOLEAN	RO	0x00 (0 _{dec})
6000:03	Limit 1	Limit value monitoring	BIT2	RO	0x00 (0 _{dec})
		0: not active 1: value is greater than limit value 2: value is smaller than limit value 3: value is equal to limit value			
6000:05	Limit 2	Limit value monitoring 0: not active 1: value is greater than limit value 2: value is smaller than limit value 3: value is equal to limit value	BIT2	RO	0x00 (0 _{dec})
6000:07	Error	The error bit is set if the data is invalid.	BOOLEAN	RO	0x00 (0 _{dec})
6000:0F	TxPDO State	Validity of the data of the associated TxPDO (0 = valid, 1 = invalid).	BOOLEAN	RO	0x00 (0 _{dec})
6000:10	TxPDO Toggle	The TxPDO toggle is toggled by the slave when the data of the associated TxPDO is updated.	BOOLEAN	RO	0x00 (0 _{dec})
6000:11	Value	Analog input value (resolution in 1/10 °C)	INT16	RO	0x0000 (0 _{dec})

Index 6010 RTD Inputs Ch.2

Index (hex)	Name	Meaning	Data type	Flags	Default
6010:0	RTD Inputs Ch.2	Maximum subindex	UINT8	RO	0x11 (17 _{dec})
6010:01	Underrange	The measuring range is undershot.	BOOLEAN	RO	0x00 (0 _{dec})
6010:02	Overrange	The measuring range is overshot.	BOOLEAN	RO	0x00 (0 _{dec})
6010:03	Limit 1	Limit value monitoring	BIT2	RO	0x00 (0 _{dec})
		0: not active 1: value is greater than limit value 2: value is smaller than limit value 3: value is equal to limit value			
6010:05	Limit 2	Limit value monitoring 0: not active 1: value is greater than limit value 2: value is smaller than limit value 3: value is equal to limit value	BIT2	RO	0x00 (0 _{dec})
6010:07	Error	The error bit is set if the data is invalid.	BOOLEAN	RO	0x00 (0 _{dec})
6010:0F	TxPDO State	Validity of the data of the associated TxPDO (0 = valid, 1 = invalid).	BOOLEAN	RO	0x00 (0 _{dec})
6010:10	TxPDO Toggle	The TxPDO toggle is toggled by the slave when the data of the associated TxPDO is updated.	BOOLEAN	RO	0x00 (0 _{dec})
6010:11	Value	Analog input value (resolution in 1/10 °C)	INT16	RO	0x0000 (0 _{dec})

Index 6020 Al Inputs Ch.3

Index (hex)	Name	Meaning	Data type	Flags	Default
6020:0	AI Inputs Ch.3	Maximum subindex	UINT8	RO	0x11 (17 _{dec})
6020:01	Underrange	The measuring range is undershot.	BOOLEAN	RO	0x00 (0 _{dec})
6020:02	Overrange	The measuring range is overshot.	BOOLEAN	RO	0x00 (0 _{dec})
6020:03	Limit 1	Limit value monitoring 0: not active 1: value is greater than limit value 2: value is less than limit value 3: value is equal to limit value	BIT2	RO	0x00 (0 _{dec})
6020:05	Limit 2	Limit value monitoring 0: not active 1: value is greater than limit value 2: value is less than limit value 3: value is equal to limit value	BIT2	RO	0x00 (0 _{dec})
6020:07	Error	The error bit is set if the data is invalid.	BOOLEAN	RO	0x00 (0 _{dec})
6020:0F	TxPDO State	Validity of the data of the associated TxPDO (0 = valid, 1 = invalid).	BOOLEAN	RO	0x00 (0 _{dec})
6020:10	TxPDO Toggle	The TxPDO toggle is toggled by the slave when the data of the associated TxPDO is updated.	BOOLEAN	RO	0x00 (0 _{dec})
6020:11	Value	The analog input data	INT16	RO	0x0000 (0 _{dec})

Index 6030 Al Inputs Ch.4

Index (hex)	Name	Meaning	Data type	Flags	Default
6030:0	AI Inputs Ch.4	Maximum subindex	UINT8	RO	0x11 (17 _{dec})
6030:01	Underrange	The measuring range is undershot.	BOOLEAN	RO	0x00 (0 _{dec})
6030:02	Overrange	The measuring range is overshot.	BOOLEAN	RO	0x00 (0 _{dec})
6030:03	Limit 1	Limit value monitoring 0: not active 1: value is greater than limit value 2: value is less than limit value 3: value is equal to limit value	BIT2	RO	0x00 (0 _{dec})
6030:05	Limit 2	Limit value monitoring 0: not active 1: value is greater than limit value 2: value is less than limit value 3: value is equal to limit value	BIT2	RO	0x00 (0 _{dec})
6030:07	Error	The error bit is set if the data is invalid.	BOOLEAN	RO	0x00 (0 _{dec})
6030:0F	TxPDO State	Validity of the data of the associated TxPDO (0 = valid, 1 = invalid).	BOOLEAN	RO	0x00 (0 _{dec})
6030:10	TxPDO Toggle	The TxPDO toggle is toggled by the slave when the data of the associated TxPDO is updated.	BOOLEAN	RO	0x00 (0 _{dec})
6030:11	Value	The analog input data	INT16	RO	0x0000 (0 _{dec})

6.7.4 Output data

The EL3204-0162 have no output objects

6.7.5 Information and diagnostic data

Index 800E RTD Internal data Ch.1

Index (hex)	Name	Meaning	Data type	Flags	Default
800E:0	RTD Internal data Ch.1	Maximum subindex	UINT8	RO	0x04 (4 _{dec})
800E:01	ADC raw value 1	ADC raw value 1	INT32	RO	0x0000000 (0 _{dec})
800E:02	Resistor 1	Resistance 1 (measured value of resistance sensor, resolution 1/32 ohm)	UINT16	RO	0x0000 (0 _{dec})
800E:03	ADC raw value 2	ADC raw value 2	INT32	RO	0x0000000 (0 _{dec})
800E:04	Resistor 2	Resistance 2 (measured value of the supply line, resolution 1/32 ohm)	UINT16	RO	0x0000 (0 _{dec})

Index 801E RTD Internal data Ch.2

Index (hex)	Name	Meaning	Data type	Flags	Default
801E:0	RTD Internal data Ch.2	Maximum subindex	UINT8	RO	0x04 (4 _{dec})
801E:01	ADC raw value 1	ADC raw value 1	INT32	RO	0x0000000 (0 _{dec})
801E:02	Resistor 1	Resistance 1 (measured value of resistance sensor, resolution 1/32 ohm)	UINT16	RO	0x0000 (0 _{dec})
801E:03	ADC raw value 2	ADC raw value 2	INT32	RO	0x0000000 (0 _{dec})
801E:04	Resistor 2	Resistance 2 (measured value of the supply line, resolution 1/32 ohm)	UINT16	RO	0x0000 (0 _{dec})

Index 802E Al Internal data Ch.1

Index (hex)	Name	Meaning	Data type	Flags	Default
802E:0	Al Internal data Ch.1	Maximum subindex	UINT8	RO	0x01 (1 _{dec})
802E:01	ADC raw value 1	ADC raw value 1	INT32	RO	0x0000000 (0 _{dec})

Index 803E AI Internal data Ch.2

Index (hex)	Name	Meaning	Data type	Flags	Default
803E:0	Al Internal data Ch.2	Maximum subindex	UINT8	RO	0x01 (1 _{dec})
803E:01	ADC raw value 2	ADC raw value 2	INT32	RO	0x0000000 (0 _{dec})

6.7.6 Manufacturer configuration data

Index 800F RTD Vendor data Ch.1

Index (hex)	Name	Meaning	Data type	Flags	Default
800F:0	RTD Vendor data Ch.1	Maximum subindex	UINT8	RO	0x06 (6 _{dec})
800F:01	Calibration offset	Vendor calibration offset	INT16	RW	0x0000 (0 _{dec})
800F:02	Calibration gain	Vendor calibration gain	UINT16	RW	0x9E50 (40528 _{dec})
800F:03	Calibration offset RL	Vendor calibration offset (input RL)	INT16	RW	0x0000 (0 _{dec})
800F:04	Calibration gain RL	Vendor calibration gain (input RL)	UINT16	RW	0x9E50 (40528 _{dec})
800F:05	Calibration offset 4- wire	Vendor calibration offset (4-wire connection technology) (not selectable)	INT16	RW	0x0000 (0 _{dec})
800F:06	Calibration gain 4- wire	Vendor calibration gain (4-wire connection technology) (not selectable)	UINT16	RW	0x9E50 (40528 _{dec})

Index 801F RTD Vendor data Ch.2

Index (hex)	Name	Meaning	Data type	Flags	Default
801F:0	RTD Vendor data Ch.2	Maximum subindex	UINT8	RO	0x06 (6 _{dec})
801F:01	Calibration offset	Vendor calibration offset	INT16	RW	0x0000 (0 _{dec})
801F:02	Calibration gain	Vendor calibration gain	UINT16	RW	0x9E50 (40528 _{dec})
801F:03	Calibration offset RL	Vendor calibration offset (input RL)	INT16	RW	0x0000 (0 _{dec})
801F:04	Calibration gain RL	Vendor calibration gain (input RL)	UINT16	RW	0x9E50 (40528 _{dec})
801F:05	Calibration offset 4- wire	Vendor calibration offset (4-wire connection technology) (not selectable)	INT16	RW	0x0000 (0 _{dec})
801F:06	Calibration gain 4- wire	Vendor calibration gain (4-wire connection technology) (not selectable)	UINT16	RW	0x9E50 (40528 _{dec})

Index 802F AI Vendor data Ch.1

Index (hex)	Name	Meaning	Data type	Flags	Default
802F:0	AI Vendor data Ch.1	Maximum subindex	UINT8	RO	0x02 (2 _{dec})
802F:01	Calibration offset	Vendor calibration offset	INT16	RW	0x0000 (0 _{dec})
802F:02	Calibration gain	Vendor calibration gain	UINT16	RW	0x0000 (0 _{dec})

Index 803F AI Vendor data Ch.2

Index (hex)	Name	Meaning	Data type	Flags	Default
803F:0	AI Vendor data Ch.2	Maximum subindex	UINT8	RO	0x02 (2 _{dec})
803F:01	Calibration offset	Vendor calibration offset	INT16	RW	0x0000 (0 _{dec})
803F:02	Calibration gain	Vendor calibration gain	UINT16	RW	0x0000 (0 _{dec})

6.7.7 Standard objects

The standard objects have the same meaning for all EtherCAT slaves.

Index 1000 Device type

Index (hex)	Name	Meaning	Data type	Flags	Default
1000:0		Device type of the EtherCAT slave: the Lo-Word contains the used CoE profile (5001). The Hi-Word contains the module profile according to the modular device profile.	UINT32	-	0x00001389 (5001 _{dec})

Index 1008 Device name

Index (hex)	Name	Meaning	Data type	Flags	Default
1008:0	Device name	Device name of the EtherCAT slave	STRING	RO	EL3204-0162

Index 1009 Hardware version

Index (hex)	Name	Meaning	Data type	Flags	Default
1009:0	Hardware version	Hardware version of the EtherCAT slave	STRING	RO	00

Index 100A Software version

Index (hex)	Name	Meaning	Data type	Flags	Default
100A:0	Software version	Firmware version of the EtherCAT slave	STRING	RO	01

Index 1018 Identity

Index (hex)	Name	Meaning	Data type	Flags	Default
1018:0	Identity	Information for identifying the slave	UINT8	RO	0x04 (4 _{dec})
1018:01	Vendor ID	Vendor ID of the EtherCAT slave	UINT32	RO	0x0000002 (2 _{dec})
1018:02	Product code	Product code of the EtherCAT slave	UINT32	RO	0x0C843052 (209989714 _{dec})
1018:03	Revision	Revision number of the EtherCAT slave; the Low Word (bit 0-15) indicates the special terminal number, the High Word (bit 16-31) refers to the device description	UINT32	RO	0x0000000 (0 _{dec})
1018:04	Serial number	Serial number of the EtherCAT slave; the Low Byte (bit 0-7) of the Low Word contains the year of production, the High Byte (bit 8-15) of the Low Word contains the week of production, the High Word (bit 16-31) is 0	UINT32	RO	0x0000000 (0 _{dec})

Index 10F0 Backup parameter handling

Index (hex)	Name	Meaning	Data type	Flags	Default
10F0:0		Information for standardized loading and saving of backup entries	UINT8	RO	0x01 (1 _{dec})
10F00:01	Checksum	Checksum across all backup entries of the EtherCAT slave	UINT32	RO	0x0000000 (0 _{dec})

Index 1802 AI TxPDO-Par Standard Ch.1

Index (hex)	Name	Meaning	Data type	Flags	Default
1802:0	AI TxPDO-Par Standard Ch.1	PDO parameter AI TxPDO 1	UINT8	RO	0x06 (6 _{dec})
1802:06	Exclude TxPDOs	Specifies the TxPDOs (index of TxPDO mapping objects) that must not be transferred together with TxPDO 1	OCTET- STRING[2]	RO	03 1A

Index 1803 AI TxPDO-Par Compact Ch. 1

Index (hex)	Name	Meaning	Data type	Flags	Default
1803:0	AI TxPDO-Par Compact Ch.1	PDO parameter AI TxPDO 2	UINT8	RO	0x06 (6 _{dec})
1803:06		Specifies the TxPDOs (index of TxPDO mapping objects) that must not be transferred together with TxPDO 2	OCTET- STRING[2]	RO	02 1A

Index 1804 AI TxPDO-Par Standard Ch.2

Index (hex)	Name	Meaning	Data type	Flags	Default
	AI TxPDO-Par Standard Ch.2	PDO parameter AI TxPDO 3	UINT8	RO	0x06 (6 _{dec})
1804:06		Specifies the TxPDOs (index of TxPDO mapping objects) that must not be transferred together with TxPDO 3	OCTET- STRING[2]	RO	05 1A

Index 1805 AI TxPDO-Par Compact Ch. 2

Index (hex)	Name	Meaning	Data type	Flags	Default
	AI TxPDO-Par Compact Ch.2	PDO parameter AI TxPDO 4	UINT8	RO	0x06 (6 _{dec})
1805:06		Specifies the TxPDOs (index of TxPDO mapping objects) that must not be transferred together with TxPDO 4	OCTET- STRING[2]	RO	04 1A

Index 1A00 RTD TxPDO-Map Ch.1

Index (hex)	Name	Meaning	Data type	Flags	Default
1A00:0	RTD TxPDO-Map Ch.1	PDO Mapping RTD TxPDO 1	UINT8	RW	0x09 (9 _{dec})
1A00:01	SubIndex 001	1. PDO Mapping entry (object 0x6000 (RTD Inputs Ch.1), entry 0x01 (Underrange))	UINT32	RW	0x6000:01, 1
1A00:02	SubIndex 002	2. PDO Mapping entry (object 0x6000 (RTD Inputs Ch.1), entry 0x02 (Overrange))	UINT32	RW	0x6000:02, 1
1A00:03	SubIndex 003	3. PDO Mapping entry (object 0x6000 (RTD Inputs Ch.1), entry 0x03 (Limit 1))	UINT32	RW	0x6000:03, 2
1A00:04	SubIndex 004	4. PDO Mapping entry (object 0x6000 (RTD Inputs Ch.1), entry 0x05 (Limit 2))	UINT32	RW	0x6000:05, 2
1A00:05	SubIndex 005	5. PDO Mapping entry (object 0x6000 (RTD Inputs Ch.1), entry 0x07 (Error))	UINT32	RW	0x6000:07, 1
1A00:06	SubIndex 006	6. PDO Mapping entry (7 bits align)	UINT32	RW	0x0000:00, 7
1A00:07	SubIndex 007	7. PDO Mapping entry (object 0x6000 (RTD Inputs Ch.1), entry 0x0F (TxPDO-State))	UINT32	RW	0x6000:0F, 1
1A00:08	SubIndex 008	8. PDO Mapping entry (object 0x6000 (RTD Inputs Ch.1), entry 0x10 (TxPDO-Toggle))	UINT32	RW	0x6000:10, 1
1A00:09	SubIndex 009	9. PDO Mapping entry (object 0x6000 (RTD Inputs Ch.1), entry 0x11 (Value))	UINT32	RW	0x6000:11, 16

Index 1A01 RTD TxPDO-Map Ch.2

Index (hex)	Name	Meaning	Data type	Flags	Default
1A01:0	RTD TxPDO-Map Ch.2	PDO Mapping RTD TxPDO 2	UINT8	RW	0x09 (9 _{dec})
1A01:01	SubIndex 001	1. PDO Mapping entry (object 0x6010 (RTD Inputs Ch.2), entry 0x01 (Underrange))	UINT32	RW	0x6010:01, 1
1A01:02	SubIndex 002	2. PDO Mapping entry (object 0x6010 (RTD Inputs Ch.2), entry 0x02 (Overrange))	UINT32	RW	0x6010:02, 1
1A01:03	SubIndex 003	3. PDO Mapping entry (object 0x6010 (RTD Inputs Ch.2), entry 0x03 (Limit 1))	UINT32	RW	0x6010:03, 2
1A01:04	SubIndex 004	4. PDO Mapping entry (object 0x6010 (RTD Inputs Ch.2), entry 0x05 (Limit 2))	UINT32	RW	0x6010:05, 2
1A01:05	SubIndex 005	5. PDO Mapping entry (object 0x6010 (RTD Inputs Ch.2), entry 0x07 (Error))	UINT32	RW	0x6010:07, 1
1A01:06	SubIndex 006	6. PDO Mapping entry (7 bits align)	UINT32	RW	0x0000:00, 7
1A01:07	SubIndex 007	7. PDO Mapping entry (object 0x6010 (RTD Inputs Ch.2), entry 0x0F (TxPDO-State))	UINT32	RW	0x6010:0F, 1
1A01:08	SubIndex 008	8. PDO Mapping entry (object 0x6010 (RTD Inputs Ch.2), entry 0x10 (TxPDO-Toggle))	UINT32	RW	0x6010:10, 1
1A01:09	SubIndex 009	9. PDO Mapping entry (object 0x6010 (RTD Inputs Ch.2), entry 0x11 (Value))	UINT32	RW	0x6010:11, 16

Index 1A02 AI TxPDO-Map Standard Ch.1

Index (hex)	Name	Meaning	Data type	Flags	Default
1A02:0	AI TxPDO-Map Standard Ch.1	PDO Mapping AI TxPDO 1	UINT8	RW	0x0A (10 _{dec})
1A02:01	SubIndex 001	1. PDO Mapping entry (object 0x6020 (AI Inputs Ch.1), entry 0x01 (Underrange))	UINT32	RW	0x6020:01, 1
1A02:02	SubIndex 002	2. PDO Mapping entry (object 0x6020 (AI Inputs Ch.1), entry 0x02 (Overrange))	UINT32	RW	0x6020:02, 1
1A02:03	SubIndex 003	3. PDO Mapping entry (object 0x6020 (Al Inputs Ch.1), entry 0x03 (Limit 1))	UINT32	RW	0x6020:03, 2
1A02:04	SubIndex 004	4. PDO Mapping entry (object 0x6020 (AI Inputs Ch.1), entry 0x05 (Limit 2))	UINT32	RW	0x6020:05, 2
1A02:05	SubIndex 005	5. PDO Mapping entry (object 0x6020 (Al Inputs Ch.1), entry 0x07 (Error))	UINT32	RW	0x6020:07, 1
1A02:06	SubIndex 006	6. PDO Mapping entry (1 bit align)	UINT32	RW	0x0000:00, 1
1A02:07	SubIndex 007	7. PDO Mapping entry (6 bits align)	UINT32	RW	0x0000:00, 6
1A02:08	SubIndex 008	8. PDO Mapping entry (object 0x1802 (AI TxPDO-Par Standard Ch.1), entry 0x07 (TxPDO-State))	UINT32	RW	0x1802:07, 1
1A02:09	SubIndex 009	9. PDO Mapping entry (object 0x1802 (AI TxPDO-Par Standard Ch.1), entry 0x09 (TxPDO-Toggle))	UINT32	RW	0x1802:09, 1
1A02:0A	SubIndex 010	10. PDO Mapping entry (object 0x6020 (Al Inputs Ch.1), entry 0x11 (Value))	UINT32	RW	0x6020:11, 16

Index 1A03 AI TxPDO-Map Compact Ch.1

Index (hex)	Name	Meaning	Data type	Flags	Default
	AI TxPDO-Map Compact Ch. 1	PDO Mapping AI TxPDO 2	UINT8	RW	0x01 (1 _{dec})
1A03:09		1. PDO Mapping entry (object 0x6020 (AI Inputs Ch.1), entry 0x11 (Value))	UINT32	RW	0x6020:11, 16

Index 1A04 AI TxPDO-Map Standard Ch.2

Index (hex)	Name	Meaning	Data type	Flags	Default
1A04:0	AI TxPDO-Map Standard Ch.2	PDO Mapping AI TxPDO 3	UINT8	RO	0x0A (10 _{dec})
1A04:01	SubIndex 001	1. PDO Mapping entry (object 0x6030 (AI Inputs Ch.2), entry 0x01 (Underrange))	UINT32	RO	0x6030 :01, 1
1A04:02	SubIndex 002	2. PDO Mapping entry (object 0x6030 (AI Inputs Ch.2), entry 0x02 (Overrange))	UINT32	RO	0x6030 :02, 1
1A04:03	SubIndex 003	3. PDO Mapping entry (object 0x6030 (AI Inputs Ch.2), entry 0x03 (Limit 1))	UINT32	RO	0x6030 :03, 2
1A04:04	SubIndex 004	4. PDO Mapping entry (object 0x6030 (AI Inputs Ch.2), entry 0x05 (Limit 2))	UINT32	RO	0x6030:05, 2
1A04:05	SubIndex 005	5. PDO Mapping entry (object 0x6030 (AI Inputs Ch.2), entry 0x07 (Error))	UINT32	RO	0x6030 :07, 1
1A04:06	SubIndex 006	6. PDO Mapping entry (1 bit align)	UINT32	RO	0x0000:00, 1
1A04:07	SubIndex 007	7. PDO Mapping entry (6 bits align)	UINT32	RO	0x0000:00, 6
1A04:08	SubIndex 008	8. PDO Mapping entry (object 0x1804 (AI TxPDO-Par Standard Ch.2), entry 0x07 (TxPDO-State))	UINT32	RO	0x1804:07, 1
1A04:09	SubIndex 009	9. PDO Mapping entry (object 0x1804 (AI TxPDO-Par Standard Ch.2), entry 0x09 (TxPDO-Toggle))	UINT32	RO	0x1804:09, 1
1A04:0A	SubIndex 010	10. PDO Mapping entry (object 0x6030 (Al Inputs Ch.2), entry 0x11 (Value))	UINT32	RW	0x6030 :11, 16

Index 1A05 AI TxPDO-Map Compact Ch.2

Index (hex)	Name	Meaning	Data type	Flags	Default
1A05:0	AI TxPDO Map Compact Ch.2	PDO Mapping AI TxPDO 4	UINT8	RO	0x01 (1 _{dec})
1A05:01	SubIndex 001	1. PDO Mapping entry (object 0x6030 (Al Inputs), entry 0x11 (Value))	UINT32	RO	0x6030 :11, 16

Index 1C00 Sync manager type

Index (hex)	Name	Meaning	Data type	Flags	Default
1C00:0	Sync manager type	Using the Sync Managers	UINT8	RO	0x04 (4 _{dec})
1C00:01	SubIndex 001	Sync-Manager Type Channel 1: Mailbox Write	UINT8	RO	0x01 (1 _{dec})
1C00:02	SubIndex 002	Sync-Manager Type Channel 2: Mailbox Read	UINT8	RO	0x02 (2 _{dec})
1C00:03	SubIndex 003	Sync-Manager Type Channel 3: Process Data Write (Outputs)	UINT8	RO	0x03 (3 _{dec})
1C00:04	SubIndex 004	Sync-Manager Type Channel 4: Process Data Read (Inputs)	UINT8	RO	0x04 (4 _{dec})

Index 1C12 RxPDO assign

Index (hex)	Name	Meaning	Data type	Flags	Default
1C12:0	RxPDO assign	PDO Assign Outputs	UINT8	RW	0x00 (0 _{dec})

Index 1C13 TxPDO assign

Index (hex)	Name	Meaning	Data type	Flags	Default
1C13:0	TxPDO assign	PDO Assign Inputs	UINT8	RW	0x04 (4 _{dec})
1C13:01	Subindex 001	1. allocated TxPDO (contains the index of the associated TxPDO mapping object)	UINT16	RW	0x1A00 (6656 _{dec})
1C13:02	Subindex 002	2. allocated TxPDO (contains the index of the associated TxPDO mapping object)	UINT16	RW	0x1A01 (6657 _{dec})
1C13:03	Subindex 003	3. allocated TxPDO (contains the index of the associated TxPDO mapping object)	UINT16	RW	0x1A02 (6658 _{dec})
1C13:04	Subindex 004	4. allocated TxPDO (contains the index of the associated TxPDO mapping object)	UINT16	RW	0x1A04 (6660 _{dec})

Index 1C33 SM input parameter

Index (hex)	Name	Meaning	Data type	Flags	Default
1C33:0	SM input parameter	Synchronization parameters for the inputs	UINT8	RO	0x20 (32 _{dec})
1C33:01	Sync mode	Current synchronization mode:	UINT16	RW	0x0022 (34 _{dec})
		• 0: Free Run			
		• 1: Synchron with SM 3 event (no outputs available)			
		2: DC - Synchron with SYNC0 Event			
		 3: DC - Synchron with SYNC1 Event 			
		 34: Synchron with SM 2 event (outputs available) 			
1C33:02	Cycle time	Cycle time (in ns):	UINT32	RW	0x000F4240
1000.02		Free Run: cycle time of the local timer	0111132	1.1.1	(100000_{dec})
		Synchronous with SM 2 Event: cycle time of the master			
		DC-Mode: SYNC0/SYNC1 Cycle Time			
1C33:03	Shift time	Time between SYNC0 event and reading of the inputs (in ns, only DC mode)	UINT32	RW	0x00000384 (900 _{dec})
1C33:04	Sync modes	Supported synchronization modes:	UINT16	RO	0xC007
	supported	Bit 0: Free Run is supported			(49159 _{dec})
		 Bit 1: Synchron with SM 2 Event is supported (outputs available) 			
		Bit 1: Synchron with SM 3 Event is supported (no outputs available)			
		• Bit 2-3 = 01: DC-Mode is supported			
		 Bit 4-5 = 01: Input Shift through local event (outputs available) 			
		 Bit 4-5 = 10: Input Shift with SYNC1 event (no outputs available) 			
		 Bit 14 = 1: dynamic times (measurement through writing of <u>0x1C33:08 [▶ 159]</u>) 			
1C33:05	Minimum cycle time	Minimum cycle time (in ns)	UINT32	RO	0x00002710 (10000 _{dec})
1C33:06	Calc and copy time	Time between reading of the inputs and availability of the inputs for the master (in ns, only DC mode)	UINT32	RO	0x00000000 (0 _{dec})
1C33:07	Max. Delay time	Min. time between SYNC1 event and the reading of the inputs (in ns, DC mode only)	UINT32	RO	0x00000384 (900 _{dec})
1C33:08	Command	0: Measurement of the local cycle time is stopped	UINT16	RW	0x0000 (0 _{dec})
		• 1: Measurement of the local cycle time is started			
		The entries <u>0x1C33:03</u> [▶ <u>159]</u> , 0x1C33:06, <u>0x1C33:09</u>			
		[▶ <u>159</u>] are updated with the maximum measured values. For a subsequent measurement the measured values are reset			
1C33:09	Max. Delay time	Max. time between SYNC1 event and the reading of the inputs (in ns, DC mode only)	UINT32	RO	0x0000000 (0 _{dec})
1C33:0B	SM event missed counter	Number of missed SM events in OPERATIONAL (DC mode only)	UINT16	RO	0x0000 (0 _{dec})
1C33:0C	Cycle exceeded counter	Number of occasions the cycle time was exceeded in OPERATIONAL (cycle was not completed in time or the next cycle began too early)	UINT16	RO	0x0000 (0 _{dec})
1C33:0D	Shift too short counter	Number of occasions that the interval between SYNC0 and SYNC1 event was too short (DC mode only)	UINT16	RO	0x0000 (0 _{dec})
1C33:20	Sync error	The synchronization was not correct in the last cycle (outputs were output too late; DC mode only)	BOOLEAN	RO	0x00 (0 _{dec})

Index F000 Modular device profile

Index (hex)	Name	Meaning	Data type	Flags	Default
F000:0	Modular device profile	General information for the modular device profile	UINT8	RO	0x02 (2 _{dec})
F000:01	Module index distance	Index distance of the objects of the individual channels	UINT16	RO	0x0010 (16 _{dec})
F000:02	Maximum number of modules	Number of channels	UINT16	RO	0x0004 (4 _{dec})

BECKHOFF

Index F008 Code word

Index (hex)	Name	Meaning	Data type	Flags	Default
F008:0	Code word	currently reserved	UINT32		0x0000000 (0 _{dec})

Index F010 Module list

Index (hex)	Name	Meaning	Data type	Flags	Default
F008:0	Module list	Max. Subindex	UINT32	RW	0x04 (4 _{dec})
F010:01	Subindex 001	RDT profiles	UINT32	RW	0x00000140 (320 _{dec})
F010:02	Subindex 002	RDT profiles	UINT32	RW	0x00000140 (320 _{dec})
F010:03	Subindex 003	AI profiles	UINT32	RW	0x0000012C (300 _{dec})
F010:04	Subindex 004	AI profiles	UINT32	RW	0x0000012C (300 _{dec})

7.1 Firmware compatibility

Beckhoff EtherCAT devices are delivered with the latest available firmware version. Compatibility of firmware and hardware is mandatory; not every combination ensures compatibility. The overview below shows the hardware versions on which a firmware can be operated.

Note

- It is recommended to use the newest possible firmware for the respective hardware
- Beckhoff is not under any obligation to provide customers with free firmware updates for delivered products.

NOTICE

Risk of damage to the device!

Pay attention to the instructions for firmware updates on the <u>separate page [> 163]</u>.

If a device is placed in BOOTSTRAP mode for a firmware update, it does not check when downloading whether the new firmware is suitable.

This can result in damage to the device! Therefore, always make sure that the firmware is suitable for the hardware version!

EL3204-0162					
Hardware (HW)	Firmware (FW)	Revision no.	Release date		
00	01	EL3202-0162-0016	2012/04		
00 - 05*	01*	EL3204-0162-0017	2012/08		
		EL3204-0162-0018	2014/07		
		EL3204-0162-0019	2016/08		

*) This is the current compatible firmware/hardware version at the time of the preparing this documentation. Check on the Beckhoff web page whether more up-to-date <u>documentation</u> is available.

Also see about this

■ Firmware Update EL/ES/EM/ELM/EP/EPP/ERPxxxx [▶ 163]

RFCK

7.2 Firmware Update EL/ES/EM/ELM/EP/EPP/ERPxxxx

This section describes the device update for Beckhoff EtherCAT slaves from the EL/ES, ELM, EM, EK, EP, EPP and ERP series. A firmware update should only be carried out after consultation with Beckhoff support.

NOTICE

Only use TwinCAT 3 software!

A firmware update of Beckhoff IO devices must only be performed with a TwinCAT 3 installation. It is recommended to build as up-to-date as possible, available for free download on the <u>Beckhoff website</u>.

To update the firmware, TwinCAT can be operated in the so-called FreeRun mode, a paid license is not required.

The device to be updated can usually remain in the installation location, but TwinCAT has to be operated in the FreeRun. Please make sure that EtherCAT communication is trouble-free (no LostFrames etc.).

Other EtherCAT master software, such as the EtherCAT Configurator, should not be used, as they may not support the complexities of updating firmware, EEPROM and other device components.

Storage locations

An EtherCAT slave stores operating data in up to three locations:

• Each EtherCAT slave has a device description, consisting of identity (name, product code), timing specifications, communication settings, etc.

This device description (ESI; EtherCAT Slave Information) can be downloaded from the Beckhoff website in the download area as a <u>zip file</u> and used in EtherCAT masters for offline configuration, e.g. in TwinCAT.

Above all, each EtherCAT slave carries its device description (ESI) electronically readable in a local memory chip, the so-called **ESI EEPROM**. When the slave is switched on, this description is loaded locally in the slave and informs it of its communication configuration; on the other hand, the EtherCAT master can identify the slave in this way and, among other things, set up the EtherCAT communication accordingly.

NOTICE

Application-specific writing of the ESI-EEPROM

The ESI is developed by the device manufacturer according to ETG standard and released for the corresponding product.

- Meaning for the ESI file: Modification on the application side (i.e. by the user) is not permitted.

- Meaning for the ESI EEPROM: Even if a writeability is technically given, the ESI parts in the EEPROM and possibly still existing free memory areas must not be changed beyond the normal update process. Especially for cyclic memory processes (operating hours counter etc.), dedicated memory products such as EL6080 or IPC's own NOVRAM must be used.

- Depending on functionality and performance EtherCAT slaves have one or several local controllers for processing I/O data. The corresponding program is the so-called **firmware** in *.efw format.
- In some EtherCAT slaves the EtherCAT communication may also be integrated in these controllers. In this case the controller is usually a so-called **FPGA** chip with *.rbf firmware.

Customers can access the data via the EtherCAT fieldbus and its communication mechanisms. Acyclic mailbox communication or register access to the ESC is used for updating or reading of these data.

The TwinCAT System Manager offers mechanisms for programming all three parts with new data, if the slave is set up for this purpose. Generally the slave does not check whether the new data are suitable, i.e. it may no longer be able to operate if the data are unsuitable.

Simplified update by bundle firmware

The update using so-called **bundle firmware** is more convenient: in this case the controller firmware and the ESI description are combined in a *.efw file; during the update both the firmware and the ESI are changed in the terminal. For this to happen it is necessary

• for the firmware to be in a packed format: recognizable by the file name, which also contains the revision number, e.g. ELxxxx-xxxx_REV0016_SW01.efw

- for password=1 to be entered in the download dialog. If password=0 (default setting) only the firmware update is carried out, without an ESI update.
- for the device to support this function. The function usually cannot be retrofitted; it is a component of many new developments from year of manufacture 2016.

Following the update, its success should be verified

- ESI/Revision: e.g. by means of an online scan in TwinCAT ConfigMode/FreeRun this is a convenient way to determine the revision
- Firmware: e.g. by looking in the online CoE of the device

NOTICE

Risk of damage to the device!

- ✓ Note the following when downloading new device files
- a) Firmware downloads to an EtherCAT device must not be interrupted
- b) Flawless EtherCAT communication must be ensured. CRC errors or LostFrames must be avoided.
- c) The power supply must adequately dimensioned. The signal level must meet the specification.
- ⇒ In the event of malfunctions during the update process the EtherCAT device may become unusable and require re-commissioning by the manufacturer.

7.2.1 Device description ESI file/XML

NOTICE

Attention regarding update of the ESI description/EEPROM

Some slaves have stored calibration and configuration data from the production in the EEPROM. These are irretrievably overwritten during an update.

The ESI device description is stored locally on the slave and loaded on start-up. Each device description has a unique identifier consisting of slave name (9 characters/digits) and a revision number (4 digits). Each slave configured in the System Manager shows its identifier in the EtherCAT tab:

🕀 🙀 SYSTEM - Configuration	CO. I DHARCAT		
📴 NC - Configuration	General EtherCAT	Process Data Startu	p CoE - Online Online
🗄 📲 PLC - Configuration	Туре:	EL3204 4Ch. Ana. In	put PT100 (RTD)
🚍 🎒 I/O Devices	Product/Revision:	EL3204-0000-0016	
ia	Auto Inc Addr:	FFFF	
🛁 🕂 Device 2-Image-Info	EtherCAT Addr:	1002	Advanced Settings
। Inputs Image: InfoData Image: InfoData Image: Image:	Previous Port:	Term 1 (EK1101) - B	

Fig. 147: Device identifier consisting of name EL3204-0000 and revision -0016

The configured identifier must be compatible with the actual device description used as hardware, i.e. the description which the slave has loaded on start-up (in this case EL3204). Normally the configured revision must be the same or lower than that actually present in the terminal network.

For further information on this, please refer to the EtherCAT system documentation.

Update of XML/ESI description

The device revision is closely linked to the firmware and hardware used. Incompatible combinations lead to malfunctions or even final shutdown of the device. Corresponding updates should only be carried out in consultation with Beckhoff support.

Display of ESI slave identifier

The simplest way to ascertain compliance of configured and actual device description is to scan the EtherCAT boxes in TwinCAT mode Config/FreeRun:

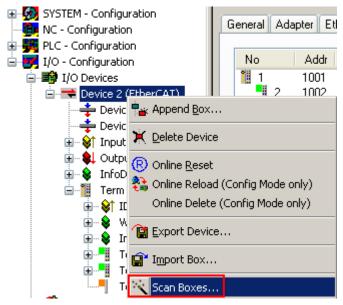


Fig. 148: Scan the subordinate field by right-clicking on the EtherCAT device

If the found field matches the configured field, the display shows

TwinCAT	System Manager 👘 🔯
(į)	Configuration is identical
	ок

Fig. 149: Configuration is identical

otherwise a change dialog appears for entering the actual data in the configuration.

Check Configuration			×
Found Items:	Disable > Ignore > Delete > Copy Before > Copy After > Co	Configured Items:	

Fig. 150: Change dialog

In this example in Fig. *Change dialog*, an EL3201-0000-**0017** was found, while an EL3201-0000-**0016** was configured. In this case the configuration can be adapted with the *Copy Before* button. The *Extended Information* checkbox must be set in order to display the revision.

Changing the ESI slave identifier

The ESI/EEPROM identifier can be updated as follows under TwinCAT:

- Trouble-free EtherCAT communication must be established with the slave.
- The state of the slave is irrelevant.
- Right-clicking on the slave in the online display opens the *EEPROM Update* dialog, Fig. *EEPROM Update*

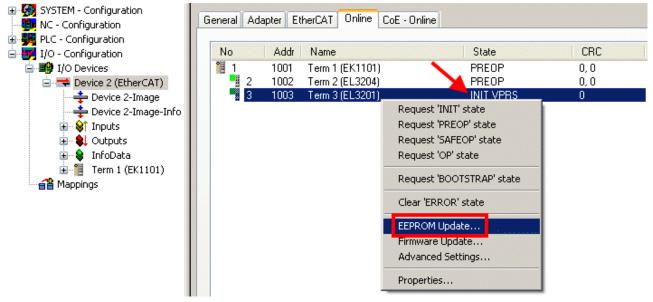


Fig. 151: EEPROM Update

The new ESI description is selected in the following dialog, see Fig. *Selecting the new ESI*. The checkbox *Show Hidden Devices* also displays older, normally hidden versions of a slave.

DLUNIIUI I

Write EEPROM		×
Available EEPROM Descriptions:	A Show Hidden Devices	
B	ance	5

Fig. 152: Selecting the new ESI

A progress bar in the System Manager shows the progress. Data are first written, then verified.

The change only takes effect after a restart. Most EtherCAT devices read a modified ESI description immediately or after startup from the INIT. Some communication settings such as distributed clocks are only read during power-on. The EtherCAT slave therefore has to be switched off briefly in order for the change to take effect.

7.2.2 Firmware explanation

Determining the firmware version

Determining the version via the TwinCAT System Manager

The TwinCAT System Manager shows the version of the controller firmware if the master can access the slave online. Click on the E-Bus Terminal whose controller firmware you want to check (in the example terminal 2 (EL3204)) and select the tab *CoE Online* (CAN over EtherCAT).

CoE Online and Offline CoE

Two CoE directories are available:

• online: This is offered in the EtherCAT slave by the controller, if the EtherCAT slave supports this. This CoE directory can only be displayed if a slave is connected and operational.

• offline: The EtherCAT Slave Information ESI/XML may contain the default content of the CoE. This CoE directory can only be displayed if it is included in the ESI (e.g. "Beckhoff EL5xxx.xml").

The Advanced button must be used for switching between the two views.

In Fig. *Display of EL3204 firmware version* the firmware version of the selected EL3204 is shown as 03 in CoE entry 0x100A.

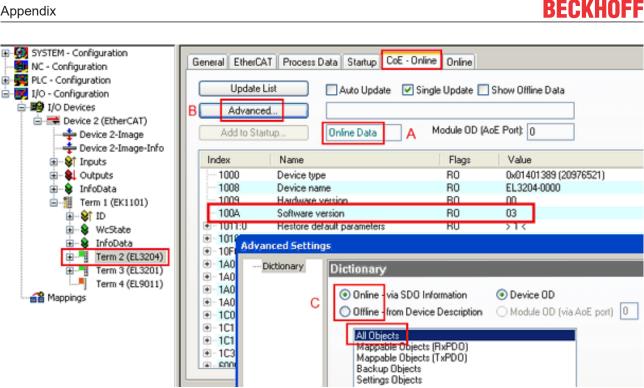


Fig. 153: Display of EL3204 firmware version

In (A) TwinCAT 2.11 shows that the Online CoE directory is currently displayed. If this is not the case, the Online directory can be loaded via the Online option in Advanced Settings (B) and double-clicking on AllObjects.

7.2.3 Updating controller firmware *.efw

CoE directory

The Online CoE directory is managed by the controller and stored in a dedicated EEPROM, which is generally not changed during a firmware update.

Switch to the Online tab to update the controller firmware of a slave, see Fig. Firmware Update.

BECKHOFF

SYSTEM - Configuration NC - Configuration For the second secon	Pre-Op S	afe-Op B Cu	DE - Online Online urrent State: equested State: Open	BOOT			22
G - Q Outputs G - Q InfoData G - Q InfoData G - Q ID G - Q InfoData G - Q InfoDa	DLL Status Port A: Carrier / C Port B: No Carrier Port C: No Carrier Port D: No Carrier File Access over EtherC/ Download	/ Closed / Closed / Closed	Look in: My Recent Documents Desktop	EL3204_0	S.efw	○ ⑦ P ■	
с	♦↑ Underrange ♦↑ Overrange ♦↑ Limit 1 ♦↑ Limit 2 ♦↑ TxPDO State ♦↑ TxPDO Toggle ♦↑ Yalue ♦↑ Westate ♦↑ State	Online 0 1 0x0 (0) 0x0 (0) 1 0 0x2134 <850.000> 1 0x0003 (3) 00 00 00 03 01 E	EigD at My Computer My Network	File name: Files of type:	EL3204_06.efw EtherCAT Firmware F	₩ ile <mark>= (*.efw)</mark>	Open Cancel


Fig. 154: Firmware Update

Proceed as follows, unless instructed otherwise by Beckhoff support. Valid for TwinCAT 2 and 3 as EtherCAT master.

• Switch TwinCAT system to ConfigMode/FreeRun with cycle time >= 1 ms (default in ConfigMode is 4 ms). A FW-Update during real time operation is not recommended.


Microsoft Visual Studio	Microsoft Visual Studio
Load I/O Devices	Activate Free Run
Yes No	Yes No

• Switch EtherCAT Master to PreOP

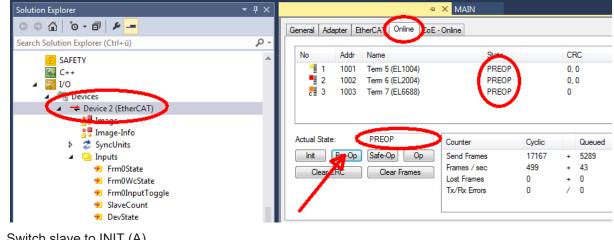

- Switch slave to INIT (A)
- Switch slave to BOOTSTRAP

- Check the current status (B, C)
- Download the new *efw file (wait until it ends). A password will not be necessary usually.



- · After the download switch to INIT, then PreOP
- Switch off the slave briefly (don't pull under voltage!)
- Check within CoE 0x100A, if the FW status was correctly overtaken.

7.2.4 FPGA firmware *.rbf

If an FPGA chip deals with the EtherCAT communication an update may be accomplished via an *.rbf file.

- · Controller firmware for processing I/O signals
- FPGA firmware for EtherCAT communication (only for terminals with FPGA)

The firmware version number included in the terminal serial number contains both firmware components. If one of these firmware components is modified this version number is updated.

Determining the version via the TwinCAT System Manager

The TwinCAT System Manager indicates the FPGA firmware version. Click on the Ethernet card of your EtherCAT strand (Device 2 in the example) and select the *Online* tab.

The *Reg:0002* column indicates the firmware version of the individual EtherCAT devices in hexadecimal and decimal representation.

👼 TwinCAT System Manager		
<u>File Edit Actions View Options Help</u>		
] 🗅 📂 📽 🔚 🍜 🖪 👗 🛍 🛍	🗟 M 👌 🔜 🙃 🗸 🏄) 🙆 🤣 💱 🔨 🚳 🖹
SYSTEM - Configuration GNC - Configuration	General Adapter EtherCAT C	Dnline
NC - Configuration	No Addr Name	State CRC Reg:0002 📐
	1 1001 Term 1 (EK11	00) OP 0 0x0002(11)
🖃 👿 I/O - Configuration	📕 2 1002 Term 2 (EL10	
E-B I/O Devices	📲 3 1003 Term 3 (EL20	
Device 2 (EtherCAT)	4 1004 Term 4 (EL31	
🕂 🕂 Device 2-Image	5 1005 Term 5 (EL41	
🕂 Device 2-Image-Info	4 1004 Term 4 (EL31 5 1005 Term 5 (EL41 6 1006 Term 6 (EL50 7 1007 Term 7 (EL67	
	7 1007 Term 7 (EL67	51) OP 0 0x000C(12)
Dutputs	Actual State: 0P	Send Frames: 74237
⊡… 😵 InfoData ⊡…∰ Term 1 (EK1100)	Init Pre-Op Safe-Op	Op Frames / sec: 329
at Mappings	Clear CRC Clear Fr	ames Lost Frames: 0
		Address Type 🛛 In Size 🛛 🔺
		.001 EK1100 0.0 0 🔜
		.002 EL2004 0.0 0
	3 Term 3 (EL2004) 1	.003 EL2004 0.0 0
J	4 Term 4 (EL5001) 1	.004 EL5001 5.0 0 💌
Ready		Local () Free Run

Fig. 155: FPGA firmware version definition

If the column *Reg:0002* is not displayed, right-click the table header and select *Properties* in the context menu.




Fig. 156: Context menu Properties

The *Advanced Settings* dialog appears where the columns to be displayed can be selected. Under *Diagnosis/***Online View** select the *'0002 ETxxxx Build'* check box in order to activate the FPGA firmware version display.

BECKHOFF

Advanced Settings		×
Diagnosis Online View Emergency Scan	Online View	0000 Add
,		OK Abbrechen

Fig. 157: Dialog Advanced Settings

Update

For updating the FPGA firmware

- of an EtherCAT coupler the coupler must have FPGA firmware version 11 or higher;
- of an E-Bus Terminal the terminal must have FPGA firmware version 10 or higher.

Older firmware versions can only be updated by the manufacturer!

Updating an EtherCAT device

The following sequence order have to be met if no other specifications are given (e.g. by the Beckhoff support):

• Switch TwinCAT system to ConfigMode/FreeRun with cycle time >= 1 ms (default in ConfigMode is 4 ms). A FW-Update during real time operation is not recommended.


BECKHOFF

 In the TwinCAT System Manager select the terminal for which the FPGA firmware is to be updated (in the example: Terminal 5: EL5001) and
 click the Advanced Settings button in the EtherCAT tob.

click the Advanced Settings button in the EtherCAT tab:

🗾 TwinCAT System Manager				_ 🗆 🗵
<u>File Edit Actions View Options Help</u>				
] 🗅 🚅 📽 🔚 🍜 🖪 👗 🖻 🖻	B 🖊 👌	🚇 🙃 🗸 💣 🙆 🧕). 🔁 🔨 💽	💊 🖹
SYSTEM - Configuration CNC - Configuration CNC - Configuration FLC - Configuration I/O - Configuration I/O - Configuration I/O Devices I/O Devices I/O Devices Device 2-Image Device 2-Image I/O Device 2-		erCAT Process Data Sta EL5001 1K. SSI En sion: EL5001-0000-0000 ess: FFFC	rtup CoE - Onli ncoder) Advanced Set	ne Online
	http://www.be	:ckhoff.de/german/default.htr	n?EtherCAT/EL5	<u>5001.htm</u>
🗄 🖳 😵 Channel 1	Name	Online	Туре	Size
	 ♦↑ Status ♦↑ Value ♦↑ WcState ♦↑ State ♦↑ AdsAddr 	0x41 (65) 0x00000000 (0) 0 0x0008 (8) AC 10 03 F3 03 01 ED 03	BYTE UDINT BOOL UINT AMSADDRESS	1.0 4.0 0.1 2.0 8.0
Ready	[▲]		Local () Con	Fig Mode

• The *Advanced Settings* dialog appears. Under *ESC Access/E²PROM*/FPGA click on *Write FPGA* button:

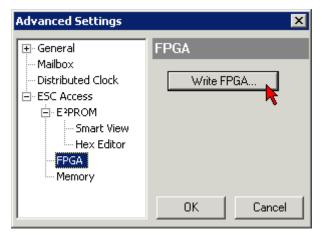

• Select the file (*.rbf) with the new FPGA firmware, and transfer it to the EtherCAT device:

Open	<u>?</u> ×
Search in: 🔁 FirmWare	💽 🔮 🤣 🔝 -
SocCOM_T1_EBUS_BGA_LVTTL	_F2_S4_BLD12.rbf
<u> </u>	
File name: A_LVTL_F2_S4_BLD1;	2.rbf Open
File type: FPGA File (*.rbf)	Cancel
	///

- Wait until download ends
- Switch slave current less for a short time (don't pull under voltage!). In order to activate the new FPGA firmware a restart (switching the power supply off and on again) of the EtherCAT device is required.
- · Check the new FPGA status

NOTICE

Risk of damage to the device!

A download of firmware to an EtherCAT device must not be interrupted in any case! If you interrupt this process by switching off power supply or disconnecting the Ethernet link, the EtherCAT device can only be recommissioned by the manufacturer!

7.2.5 Simultaneous updating of several EtherCAT devices

The firmware and ESI descriptions of several devices can be updated simultaneously, provided the devices have the same firmware file/ESI.

No Addr Name 1 1001 Term 5 (EK1101) 2 1002 Term 6 (EL3102) 3 1003 Term 7 (EL3102) 4 1004 Term 8 (EL3102) 5 1005 Term 9 (EL3102) Request 'INIT's Request 'SAFEC Request 'OP' state Request 'BOOTS Clear 'ERROR's EEPROM Update	o" state oP' state ate STRAP' state tate

Fig. 158: Multiple selection and firmware update

Select the required slaves and carry out the firmware update in BOOTSTRAP mode as described above.

7.3 Restoring the delivery state

To restore the delivery state (factory settings) of CoE objects for EtherCAT devices ("slaves"), the CoE object *Restore default parameters*, SubIndex 001 can be used via EtherCAT master (e.g. TwinCAT) (see Fig. *Selecting the Restore default parameters PDO*).

ener	al EtherCAT	DC Process Data Plc	Startup	, CoE -	Online Online		
	Update Lis	st 🗌 Auto Update	∠ Single (Jpdate [Show Offline Data		
Advanced							
	Add to Startu	up Online Data	Moo	dule OD	(AoE Port): 0		
Ind	ex	Name		Flags	Value	Unit	-
	1000	Device type		RO	0x00001389 (5001)		
	1008	Device name		RO	EL5101		
	1009	Hardware version		RO	27		
	100A	Software version		RO	18		
	1011:0	Restore default parameters		RO	>1<		
	1011:01	SubIndex 001		RW	0x0000000 (0)		
÷	1018:0	Identity 🔨		RO	> 4 <		
÷	10F0:0	Backup parameter handling		RO	>1<		
÷	1400:0	RxPDO-Par Outputs		RO	> 6 <		

Fig. 159: Selecting the Restore default parameters PDO

Set Value Dia	log X
Dec: Hex:	1684107116 OK 0x64616F6C Cancel
Float:	1.6634185e+22
Bool:	0 1 Hex Edit
Binary:	6C 6F 61 64 4
Bit Size:	○1 ○8 ○16 ●32 ○64 ○?

Fig. 160: Entering a restore value in the Set Value dialog

Double-click on *SubIndex 001* to enter the Set Value dialog. Enter the reset value **1684107116** in field *Dec* or the value **0x64616F6C** in field *Hex* (ASCII: "load") and confirm with *OK* (Fig. *Entering a restore value in the Set Value dialog*).

- All changeable entries in the slave are reset to the default values.
- The values can only be successfully restored if the reset is directly applied to the online CoE, i.e. to the slave. No values can be changed in the offline CoE.
- TwinCAT must be in the RUN or CONFIG/Freerun state for this; that means EtherCAT data exchange takes place. Ensure error-free EtherCAT transmission.
- No separate confirmation takes place due to the reset. A changeable object can be manipulated beforehand for the purposes of checking.
- This reset procedure can also be adopted as the first entry in the startup list of the slave, e.g. in the state transition PREOP->SAFEOP or, as in Fig. *CoE reset as a startup entry*, in SAFEOP->OP.

All backup objects are reset to the delivery state.



Alternative restore value

In some older terminals (FW creation approx. before 2007) the backup objects can be switched with an alternative restore value: Decimal value: 1819238756, Hexadecimal value: 0x6C6F6164.

An incorrect entry for the restore value has no effect.

7.4 Support and Service

Beckhoff and their partners around the world offer comprehensive support and service, making available fast and competent assistance with all questions related to Beckhoff products and system solutions.

Beckhoff's branch offices and representatives

Please contact your Beckhoff branch office or representative for local support and service on Beckhoff products!

The addresses of Beckhoff's branch offices and representatives round the world can be found on her internet pages: <u>www.beckhoff.com</u>

You will also find further documentation for Beckhoff components there.

Support

The Beckhoff Support offers you comprehensive technical assistance, helping you not only with the application of individual Beckhoff products, but also with other, wide-ranging services:

- support
- · design, programming and commissioning of complex automation systems
- and extensive training program for Beckhoff system components

Hotline:	+49 5246 963 157
e-mail:	support@beckhoff.com
web:	www.beckhoff.com/support

Service

The Beckhoff Service Center supports you in all matters of after-sales service:

- · on-site service
- repair service
- · spare parts service
- · hotline service

Hotline:	+49 5246 963 460
e-mail:	service@beckhoff.com
web:	www.beckhoff.com/service

Headquarters Germany

Beckhoff Automation GmbH & Co. KG

Hülshorstweg 20 33415 Verl Germany

Phone:	+49 5246 963 0
e-mail:	info@beckhoff.com
web:	www.beckhoff.com

More Information: www.beckhoff.com/EL3204-0162

Beckhoff Automation GmbH & Co. KG Hülshorstweg 20 33415 Verl Germany Phone: +49 5246 9630 info@beckhoff.com www.beckhoff.com

